

Moreton Bay Regional Council – Pine Rivers Shire

Planning Scheme Policy

PSP22 Development Contributions for Trunk Infrastructure
– Water Supply

Moreton Bay Regional Council – Pine Rivers Shire

PSP22 Development Contributions for Trunk Infrastructure – Water Supply

ADOPTION

Pine Rivers Shire Council adopted this planning scheme policy on 19 June 2006.

COMMENCEMENT

This planning scheme policy took effect from 15 December 2006.

Amendment 2/2008

ADOPTION OF AMENDMENT

Moreton Bay Regional Council adopted this amendment to the planning scheme policy on 19 August 2008.

COMMENCEMENT OF AMENDMENT

This amendment to the planning scheme policy took effect from 1 September 2008.

Amendment 1/2009

ADOPTION OF AMENDMENT

Moreton Bay Regional Council adopted this amendment to the planning scheme policy on 8 September 2009.

COMMENCEMENT OF AMENDMENT

This amendment to the planning scheme policy took effect from 29 October 2009.

I, Daryl Hitzman, A/Chief Executive Officer, of the Moreton Bay Regional Council, hereby certify that this document is a true copy of the original.



Daryl Hitzman
A/Chief Executive Officer

TABLE OF CONTENTS

HEAD OF POWER	1
OBJECTIVE	1
DEFINITIONS / APPLICATION	1
POLICY STATEMENT	1
1 SCOPE	1
2 BACKGROUND INFORMATION.....	2
3 WATER SUPPLY METHODOLOGY	2
3.1 METHODOLOGY	2
3.2 WATER SUPPLY SERVICE CATCHMENTS	3
3.3 WATER SUPPLY DEMAND ASSUMPTIONS	3
4 WATER SUPPLY PLAN FOR TRUNK INFRASTRUCTURE	6
4.1 WATER SUPPLY TRUNK INFRASTRUCTURE NETWORK.....	6
4.2 WATER SUPPLY TRUNK INFRASTRUCTURE VALUATIONS.....	6
SCHEDULE A: DEMAND FACTORS.....	11
SCHEDULE B: INFRASTRUCTURE CONTRIBUTION RATES.....	14
SCHEDULE C: SERVICE CATCHMENTS.....	15
SCHEDULE D: NETWORK ASSETS	38
SCHEDULE E: DESIRED STANDARDS OF SERVICE.....	61
REVIEW TRIGGERS.....	64
RESPONSIBILITY.....	64
VERSION CONTROL.....	64

PSP 22 – DEVELOPMENT CONTRIBUTIONS FOR TRUNK INFRASTRUCTURE – WATER SUPPLY

Head of Power

This document is a Planning Scheme Policy for the purposes of the *Integrated Planning Act 1997* (the Act) and is made in compliance with the process prescribed in Schedule 3 of the Act.

Objective

The objective of this policy is to apportion the cost of Water Supply Trunk Infrastructure over all benefiting development (existing and future) commensurate with the demand or load that existing and future development will place on existing and planned future infrastructure while ensuring a reasonable and equitable distribution of the costs of Water Supply Trunk Infrastructure works between Council and developers of land in the former Pine Rivers Shire.

Definitions / Application

Application

This policy applies to all applications for development which has been made assessable against the *PineRiversPlan* and which will utilise any part of the Water Supply Trunk Infrastructure Network. For the purposes of this policy, the extent of the Water Supply Trunk Infrastructure Network within the former Pine Rivers Shire is shown in Schedule D.

The policy outlines the basis of Council's Infrastructure Contributions Regime for the Water Supply Trunk Infrastructure Network in the former Pine Rivers Shire. It is to be read in conjunction with Planning Scheme Policy PSP21 Development Contributions for Trunk Infrastructure – Administration Policy.

Payment of any monetary contribution under this policy will in no way relieve the development proponent from any requirement under a condition of development approval to undertake non-trunk works or to connect the development to trunk infrastructure. Nothing contained in this policy precludes Council and the development proponent from entering into an infrastructure agreement in regard to the matters dealt with by this policy.

Definitions

The definitions of applicable terms are contained in PSP21 Development Contributions for Trunk Infrastructure – Administration Policy. Where a term used in this policy is not defined in PSP21 that term shall, unless the context indicates or requires otherwise, have the meaning assigned to it in the *PineRiversPlan* or in the *Integrated Planning Act 1997*.

Policy Statement

1 Scope

This policy sets out the basis for determining the amount of Development Contributions for Water Supply Trunk Infrastructure which Council will impose as conditions of development approval. The provisions of this policy shall apply to applications for development within the Shire which will utilise Water Supply Trunk Infrastructure either immediately or at some time in the future. This policy:

- is to be read in conjunction with Planning Scheme Policy PSP21 Development Contributions for Trunk Infrastructure – Administration Policy;
- specifies the assumptions made in determining the rate of the contribution payable towards the cost of Water Supply Trunk Infrastructure within Council's Designated Infrastructure Service Area (DISA);
- lists the land use, density and demand assumptions made for predicting demand and planning the Water Supply Trunk Infrastructure Network;
- specifies the works, structures or equipment, which the Council determines to be Water Supply Trunk Infrastructure;
- establishes the estimated cost of construction and any required augmentation of the Water Supply Trunk Infrastructure Network in respect of which contributions are to be made; and
- lists the applicable Demand Factors and Schedules of Infrastructure Contributions Rates.

2 Background Information

The methodology used in establishing the amount of required Trunk Infrastructure Contributions under this policy is based on the report by John Wilson and Partners, "PINE WATER Priority Infrastructure Plan, Water Supply & Sewerage", September 2005 (the Study Report) which was formally adopted by the former Pine Rivers Shire Council on 26 September 2005. The Study Report comprises:-

- (1) Part 1 - Executive Summary (September 2005);
- (2) Part 2 - Main Report (September 2005);
- (3) Part 3 - Detailed Maps (September 2005); and
- (4) Part 4 - Calculations and Supporting Data (September 2005).

The policy methodology has also been informed by:-

- Pine Water, Update of Existing and Ultimate Demand Forecast in Water Supply Model and Provision of a 15 Year Capital Works Program, Final Report November 2006 (MWH);
- MWH, PIP Population Update Report, August 2007; and
- Moreton Bay Water, Hydraulic Solution and Capital Works Program 2008/09.

3 Water Supply Methodology

3.1 Methodology

The methodology used for determining the rate of Infrastructure Contributions for Water Supply applied under this policy is based upon the approach set out in the Department of Local Government and Planning's IPA Guidelines 1/04 and 2/04 (dated 4 October 2004) and the Standard Infrastructure Charges Schedule Nov 2008.

In summary, Infrastructure Contribution Rates for the Water Supply Trunk Infrastructure Network have been derived in the following manner:-

- (a) determine the service catchments for Trunk Infrastructure Delivery;
- (b) estimate the amount of new development, or the planned / ultimate population and resulting demand on the network within each service catchment¹;
- (c) determine the Trunk Infrastructure likely to be needed to service the development or planned / ultimate population within the service catchment to deliver the Desired Standard of Service (DSS) outlined in Schedule E of this policy. Where water supply trunk infrastructure is shared between service catchments, the cost of these infrastructure components has been apportioned in proportion to the relative demands;
- (d) determine the current replacement costs for existing Trunk Infrastructure, and the future establishment costs for required future Trunk Infrastructure in net present values for each service catchment; and
- (e) derive the applicable Infrastructure Contribution Rates by dividing the total network costs in net present values by the total discounted 'ultimate' demand on the network in the service catchment, thereby producing a rate per selected demand unit.

The contribution rate, for each particular service catchment, was determined by applying the formula:-

$$CR_{\text{Catchment}} = (\text{Asset Values}) / (\text{Demand})$$

Where:-

CR_{Catchment}	=	Contribution Rate for an individual service catchment (expressed in \$/EPW)
Asset Values	=	Value of Catchment's Assets (\$)
	=	Σ(Current Replacement Cost of Existing assets at 01-01-2009 x proportion of the asset utilised by the service catchment) + Σ (net present value at 01-01-2009 of future assets x proportion of the asset utilised by the service catchment)
Demand	=	Σ(Existing Demand in the service catchment at 01-01-2009) + (Net Present Value at 01-01-2009 of the Future Demand to Ultimate Development) (expressed in EPW)

¹ Note: For this network 'ultimate' demand represents demand at the end of the period to full development of the Shire assuming densities consistent with the Planning Scheme and the Dakabin, Mango Hill and Griffin Local Area Plans.

This methodology applies an equitable distribution of trunk infrastructure costs between Council (on behalf of the existing community), and entities proposing new development. Each development proponent will only be responsible for meeting the establishment costs of that proportion of the water supply trunk infrastructure network planned to be consumed by that entity's development proposal.

3.2 Water Supply Service Catchments

The Designated Infrastructure Service Area (DISA) for the former Pine Rivers Shire has been divided into the Water Supply Service Catchments shown in Table 3.2A:-

Table 3.2A - Water Supply Service Catchments

WATER SUPPLY SERVICE CATCHMENTS	SHORT NAME
DAYBORO	DAY
ALBANY CREEK LLZ	ACL
ALBANY CREEK HLZ	ALC
CLEAR MOUNTAIN HLZ	CMH
DAKABIN	DKB
EATONS HILL HLZ	EAH
GRIFFIN	GRF
HILLS LLZ	HLA
HILLS HLZ	HLH
KALLANGUR	KAL
MANGO HILL	MHL
NORTH LAKES	NLK
PETRIE	PET
SAMFORD DOWNS	SAD
SAMFORD VILLAGE	SAM
STRATHPINE / LAWNTON LLZ	STR

The extent of each of the Service Catchments is shown graphically on the maps contained in Schedule C.

The North Lakes development at Mango Hill and the development of the former CSIRO land in the Samford Valley are subject to infrastructure agreements, and, as such, are specifically excluded from the scope of this policy.

While it is acknowledged that these catchments do impose a load on existing trunk infrastructure, and that load is likely to increase over time until the development in those areas is completed, appropriate mechanisms have been included in the Contributions regime adopted under this policy to ensure that the costs associated with this load are not passed onto other development.

3.3 Water Supply Demand Assumptions

Approach to Demand and Load Modelling

The reports referred to in Section 2 of this policy document both assumed demand across the whole Shire and the most cost effective strategy for servicing those demand areas as well as providing a valuable input into aligning Council's Capital Works Programs with assumed growth rates. These reports cover the full anticipated extent of urban areas within the Shire up to the planning horizon of this policy.

As part of the revisions undertaken to produce this version of the policy, new Demand and Load Models for Water Supply, consistent with the Planning Assumptions documented in PSP21 Section 3 were built. The demand for 2026 was compared to the changes in demand indicated in Council's previously adopted Water Master Plan for the period 2006 to full development of the Shire assuming densities consistent with the Planning Scheme and the Dakabin, Mango Hill and Griffin Local Area Plans – this being termed 'ultimate' development. Council's consultants advised that the differences were minor. The Hydraulics Models have been re-run to reflect the new Desired Standards of Service and the permanent water restrictions imposed for SEQ by the State.

The determination of demand and load for residential zoned land was based on population numbers assumed for the land. Demand and load for non-residential zoned land was derived from land use zoning and an assumed number of Equivalent Persons (Water) per hectare per zone as outlined in Table 3.3A. The

rate of growth of non-residential demand was linked directly to the growth in employment on the cadastral base.

Water Supply Demand Assumptions

The Demand Projections, Capacity Planning and Infrastructure Contribution Rates developed for the Water Supply Network are expressed in the Standard Demand Units of 'Equivalent Person (Water)' (EPW).

One EPW equates 296 litres per person per day in accordance with the permanent water restrictions in place in South East Queensland.

For Non-Residential Demand, the assumptions for each zone expressed in EPWs per hectare are also shown in Table 3.3A. They have been verified by averaging water billing data for the years 2004-2005 (Level 1 Water Restrictions only) by land use, zone and site area and reflect the average or, if higher, allowable consumption.

Table 3.3A - Water Demand Assumptions for Residential and Non-Residential Areas

Planning Scheme Zone	Assumed Development Density in EPW's/ha
RESIDENTIAL A	Population Forecast as per Planning Assumptions
RESIDENTIAL B	Population Forecast as per Planning Assumptions
SPECIAL RESIDENTIAL	Population Forecast as per Planning Assumptions
PARK RESIDENTIAL	Population Forecast as per Planning Assumptions
RURAL RESIDENTIAL	Population Forecast as per Planning Assumptions
CENTRAL BUSINESS	30
COMMERCIAL	30
LOCAL BUSINESS	30
NEIGHBOURHOOD FACILITIES	30
URBAN VILLAGE	30
VILLAGE CENTRE	30
HOME INDUSTRY	10
SERVICE INDUSTRY	15
GENERAL INDUSTRY	30
EXTRACTIVE INDUSTRY	15
FUTURE URBAN	30
RURAL ZONE (COAST AND RIVER LANDS LOCALITY)	7.5
RURAL ZONE (URBAN, MAJOR EMPLOYMENT CENTRE, CATCHMENT, RURAL LIVING, VILLAGE, MT SUMMIT AND FORESTS LOCALITIES)	7.5
CONSERVATION	0
PARK AND OPEN SPACE	5
SPORTS AND RECREATION	15
SPECIAL FACILITIES	15
SPECIAL PURPOSES	15

Projected Water Supply Demand

Projected ultimate NPV demand for the water supply trunk network is shown in Table 3.3B. To satisfy the discounted cash flow methodology requirements of calculating the infrastructure contribution rates, existing demand is added to the value of future demand which has been indexed for anticipated fluctuations in construction costs (generally increases) and discounted for cost of capital, resulting in NPV Demand.

Table 3.3B –NPV Demand in EPWs by Water Supply Service Catchment²

Service Catchment	Actual			NPV		
	RES ULTIMATE	NONRES ULTIMATE	TOTAL ULTIMATE	RES ULTIMATE	NONRES ULTIMATE	TOTAL ULTIMATE
ALBANY CREEK HLZ	5,727	5,765	11,492	11,584	1,641	13,226
ALBANY CREEK LLZ	10,633	1,667	12,299	6,425	2,917	9,342
CLEAR MOUNTAIN HLZ	11,744	3,227	14,971	12,024	1,635	13,659
DAKABIN	9,848	3,049	12,898	9,432	2,874	12,306
DAYBORO	2,653	926	3,579	2,564	908	3,471
EATONS HILL HLZ	3,702	107	3,810	4,282	105	4,387
GRIFFIN	21,632	404	22,037	20,127	379	20,507
HILLS HLZ	3,071	250	3,321	3,265	239	3,504
HILLS LLZ	19,829	4,489	24,318	21,285	8,518	29,803

² Differences between the total value and the sum of the column can occur due to values being displayed without cents. Background calculations including cents are correct.

Service Catchment	Actual			NPV		
	RES ULTIMATE	NONRES ULTIMATE	TOTAL ULTIMATE	RES ULTIMATE	NONRES ULTIMATE	TOTAL ULTIMATE
KALLANGUR	36,020	13,672	49,692	39,159	12,110	51,270
MANGO HILL	15,470	1,018	16,487	14,855	952	15,807
NORTH LAKES	17,612	13,016	30,629	23,689	11,152	34,841
PETRIE	8,112	4,606	12,718	9,209	4,152	13,361
SAMFORD	2,667	393	3,060	1,020	405	1,425
SAMFORD DOWNS	3,520	634	4,154	2,105	701	2,806
STRATHPINE / LAWNTON LLZ	38,097	33,270	71,367	40,222	23,867	64,089
	210,336	86,493	296,830	221,247	72,555	293,802

4 Water Supply Plan For Trunk Infrastructure

4.1 Water Supply Trunk Infrastructure Network

The following Infrastructure items as shown on the maps contained in Schedule D of this policy are deemed to be Trunk Infrastructure for the purpose of planning and funding of the Trunk Water Supply Network:-

- (1) pumping stations and trunk mains to transport the treated water to distribution or storage reservoirs or elevated tanks;
- (2) distribution or non-regional storage reservoirs and elevated tanks;
- (3) chlorination and rechlorination equipment;
- (4) trunk delivery and distribution infrastructure (generally 300mm diameter mains and larger) which transports the water from distribution or storage reservoirs to the reticulation system, or which provides a general benefit to the water supply scheme;
- (5) local control and monitoring systems;
- (6) the following specific items of Infrastructure within the rural residential areas:-
 - the 250mm diameter main which traverses Bunya Road and thence runs northwards to supply the Bergin and Wongam Creek area;
 - the 200mm and 220mm diameter mains supplying reservoirs in Samford Village and Samford Downs;
- (7) the 100mm and 150mm diameter mains at Dayboro from:-
 - the intake wells to the treatment plants;
 - the treatment plants to the Low Level Zone reservoir; and
 - the Low Level Zone No. 1 (Roderick St) reservoirs to the High Level Zone reservoir at Sellin Road; and
- (8) bulk water meters, pressure and flow control valves as well as the telemetry/SCADA systems which provide system monitoring and/or control.

Assets are also grouped into 'Active' and 'Passive' Assets:

Active water infrastructure assets consist mainly of above ground visible assets such as treatment plants, pumping stations, reservoirs and dams.

Passive water infrastructure assets consist of underground assets such as trunk mains, reticulation mains, pipe fittings and property connections.

The various elements of this Trunk Infrastructure are shown on the maps in Schedule D and are tabulated in Section 4.2.

Specific Exclusions

The North Pine Dam WTP is situated in the Pine Rivers Shire but it is neither owned nor operated by Council. Treated water from this facility is supplied to Council under a Bulk Supply Agreement. Hence, this facility has been excluded from infrastructure contribution calculations on the grounds that establishment costs are recovered by the current owner/operator through the water tariff detailed in the Bulk Supply Agreement.

4.2 Water Supply Trunk Infrastructure Valuations

Costing information for existing Passive Assets

Valuations of existing water mains and other passive assets listed in this policy are based on a report titled "Water and Sewerage Mains Unit Costs" dated March 2006 prepared by Consultant Cardno Limited. The unit rates provided therein only take into account pipe diameter and depth. Refinements such as type of soil, water table, acid sulphate soil, urban or rural etc are not considered but the rates do include 20% oncost for construction in sand in an urban residential area. Valuations of water mains include an allowance for connections, valves and hydrants. The valuations shown in Tables 4.2A and 4.2B have been derived directly from the June 2006 asset valuations for Pine Water's assets and are higher than those calculated using the

rates reported in Cardno's March 2006 report due to escalation from March 2006 to January 2009 based on Rawlinson's Construction Index for Brisbane.

Costing information for existing Active Assets

Current replacement value of existing active assets was determined 'in house' using the criteria contained within the definition of the 'establishment cost of trunk infrastructure' in IPA.

Costing information for Planned Future Assets

Costs for Future Assets have been derived using the estimates in the current Capital Works Program escalated to reflect values current at 1 January 2009.

Table 4.2A – Water Supply Trunk Infrastructure Establishment Cost³

Network Value (current at 01 January 2009)	
Existing Assets	\$130,749,426
Future Infrastructure	\$34,761,498
TOTAL	\$165,510,923

Existing Water Supply Asset Schedule

Table 4.2B - Existing Active Trunk Water Supply Assets ⁴

Existing Active Assets	Network Cost (current at 1 January 2009)
MAJOR ASSETS	
Bulk Water Meters	\$294,444
RESERVOIRS & TANKS	
Albany Creek High Level Reservoir - 6.8ML	\$1,978,482
Albany Creek Low Level Reservoir No. 1 - 2.25ML	\$1,188,519
Albany Creek Low Level Reservoir No. 2 - 9ML	\$2,325,784
Barber Road H. L. Reservoir (New) - 4.6ML	\$1,698,414
Barber Road L. L. Reservoir - 4.5ML	\$1,541,879
Boundary Rd Reservoir No 2 - 32ML	\$5,490,733
Boundary Road Reservoir No 1- 18.2ML	\$3,469,215
Clear Mountain Reservoir No. 1 - 2ML	\$1,029,092
Clear Mountain Reservoir No. 2 - 5ML	\$1,579,834
Clear Mountain Reservoir No. 3 - 7ML	\$1,791,558
Clear Mtn Res No 1 - 9ML	\$225,851
Dayboro High Level	\$232,744
Dayboro High Level Reservoir - 1.25ML	\$566,787
Dayboro Low Level	\$452,961
Eatons Hill Reservoir - 8.4ML	\$2,302,651
Eatons Hill Tower - 0.45ML	\$1,380,812
Hutton Road Reservoir No. 2 - 15.5ML	\$3,312,798
Hutton Road Reservoir, No. 1 - 9ML	\$2,345,475
Ira Buckby - Reservoir No 1- 24ML	\$4,001,726
Ira Buckby 60ML Reservoir	\$9,329,656
Kallangur Tower - 0.25ML	\$459,268
Mt Mee Reservoir -1.8ML	\$71,415
Petrie Tower Water Station - 0.45 ML	\$1,380,559
Samford Downs Reservoir No. 1 - 1ML	\$759,085
Samford Downs Reservoir No. 2 - 2.40ML	\$1,169,489
Samford Downs Reservoir No. 3 (Bygott's Rd)- 4.2ML	\$1,553,404
Torrens Road Tower- 0.15ML	\$310,751
W640 Pressure Valves	\$16,231
WP5230 - Dayboro Rd - below dam	\$2,452,231
WP6140 - Kallangur	\$1,229,776
WP6190 - Kallangur High Level	\$359,382
WP6280 - Torrens Rd, Petrie	\$211,489
WP6300 - James Cash Park, Eatons Hill	\$690,839
WP6310 - Eatons Hill	\$145,628

³ Values in this table exclude any water trunk infrastructure directly attributable to the North Lakes catchment as these are subject to a separate agreement and charge.

⁴ Differences between the total value and the sum of the column can occur due to values being displayed without cents. Background calculations including cents are correct.

Existing Active Assets	Network Cost (current at 1 January 2009)
WP6400 - Albany Creek High Level WP	\$966,863
WP6500 - Albany Creek, Low Level	\$1,701,726
WP6510 - Ira Buckby Rd	\$856,120
WP6630 - Barber Rd	\$574,985
WP6700 - Strathpine Booster WP	\$2,650,859
WP6810 - Dayboro LL Res PS	\$201,878
WP7100 - Regent St	\$1,211,120
WP7600 - Gibbons Rd, Samford	\$521,570
System Leakage Management	\$2,582,500
	\$68,616,587

Future Water Supply Trunk infrastructure

Table 4.2C Future Asset Schedule ⁵

Project ID	Project Name	Anticipated Commencement of Construction	Service Catchment	NPV - 01 January 2009
WATER SUPPLY PROGRAMME				
PIPWS0029	Source Augmentation - Dayboro	2009	Dayboro	\$4,000
NEW RESERVOIRS				
PIPWS0002	RES-03, Dayboro LLZ Res No 2 near the existing reservoir site (1.5MI)	2009/2010	Dayboro	\$698,222
PIPWS0003	RES-04, Boundary Road Reservoir No 3 (24MI)	2010/2012	Petrie/Kallangur	\$2,045,140
MAINS				
PIPWS0031	WM-NLC, (500mm x 2800m) Main for feed from North Link Main Connector	2009/2012	Petrie/Kallangur	\$3,395,714
PIPWS0032	Flow Modulated Valve - RCC Main Protheroe Road	2009	Petrie/Kallangur	\$61,000
PIPWS0006	WM-BA01, (750mm x 2600m) Hughes Road (Boundary Road Res to Old Gympie Road)	2009	Petrie/Kallangur	\$3,563,763
PIPWS0007	WM-KW01, (750mm x 1300m) Old Gympie Road (Hughes Road to White Horse Road)	2009	Petrie/Kallangur	\$2,500,000
PIPWS0008	WM-WA01, (750mm x 2300m) Old Gympie Road (White Horse Road to Anzac Avenue)	2009	Petrie/Kallangur	\$5,552,289
PIPWS0009	WM-KN02, (600mm x 180m) - Hughes Road (Old Gympie Road to Goodwin Road)	2009	Petrie/Kallangur	\$416,200
PIPWS0010	WM-OB01, (750 mm x 864m) Kerr Road Main (Old Gympie Road-Balstrup Road)	2009	Petrie/Kallangur	\$1,553,504
PIPWS0011	WM-BR01, (750mm x 62m) Boundary Road Reservoir intake Main	2016	Petrie/Kallangur	\$138,393
PIPWS0038	WM-BY01, (300 mm x 428m) Anzac Avenue across the Creek to Brays Road	2009	Petrie/Kallangur	\$330,000
PIPWS0015	WM-NS02A, (450mm x 911m) North South Arterial Road up to Kinsellas Road East	2009	Petrie/Kallangur	\$848,431
PIPWS0033	WM-NS02B, (375mm x 410m) Kinsellas Road East to Future Transport corridor	2010	Petrie/Kallangur	\$457,527
PIPWS0016	WM-DG01, (300mm x 408m) Dohles Rocks Road (across Bruce Highway)	2009/2011	Petrie/Kallangur	\$425,602
PIPWS0039	WM-KRE, (375mm x 1250m) Water trunk main along Kinsellas Road East	2009/2011	Petrie/Kallangur	\$1,286,753
PIPWS0034	WM-MVR, (300mm x 1650m) Water trunk main along Maryvale Road	2009/2011	Petrie/Kallangur	\$1,682,677
PIPWS0035	WM-FWC, (300mm x 2300m) Water trunk main for Freshwater Creek development	2009/2011	Petrie/Kallangur	\$2,335,920
PIPWS0036	WM-DHN, (300mm x 1220m) Water trunk main along Dohles Rocks Road & Henry Road	2009/2011	Petrie/Kallangur	\$1,237,263
PIPWS0037	WM-KRM, (450mm x 120m) Duplication of main from Kallangur Booster Pumps	2017	Petrie/Kallangur	\$86,201
PIPWS0019	WM-BR02, (1200 m x 150mm) - Buranda Road Loop	2009/2010	Clear Mountain/Samford	\$698,387
PIPWS0028	WM-JM01, (178m x 100mm) - Fire Flow Deficiency Jancy Court	2009/2010	Clear Mountain/Samford	\$79,731

⁵ Differences between the total value and the sum of the column can occur due to values being displayed without cents. Background calculations including cents are correct.

Project ID	Project Name	Anticipated Commencement of Construction	Service Catchment	NPV - 01 January 2009
PIPWS0022	WM-LR01, (150mm x 1030m) Extension of supply main to reservoir site	2009/2010	Dayboro	\$1,423,655
DISINFECTION BOOSTER STATIONS				
PIPWS0024	Disinfection booster system (most likely at Albany Creek LL Res., complex.)	2009/2010	Hills	\$2,247,863
SYSTEM LOSS MANAGEMENT				
	System loss management (40% subsidy deducted)	2009/2012	All	\$1,693,265
Total				\$34,761,497

Table 4.2E Asset Costs Allocated to Service Catchments⁶

	ALBANY CREEK LLZ	ALBANY CREEK HLZ	CLEAR MTN HLZ	DAYBORO	EATONS HILL HLZ	HILLS HLZ	HILLS LLZ	KALLANGUR	PETRIE	SAMFORD VILLAGE	SAMFORD DOWNS	STRATHPINE LAWNTON LLZ	DAKABIN	GRIFFIN	MANGO HILL	TOTALS
TOTAL COSTS:																
SERVICE CATCHMENT-ACTIVE-EXISTING(Jan 2009)	\$4,894,429	\$6,464,040	\$5,686,707	\$1,559,618	\$5,118,429	\$2,526,840	\$9,534,577	\$5,360,735	\$1,965,028	\$426,840	\$4,892,007	\$17,586,221	\$1,168,271	\$1,663,195	\$1,351,993	\$70,198,930
SERVICE CATCHMENT-PASSIVE-EXISTING(Jan 2009)	\$1,822,348	\$5,107,155	\$3,041,741	\$0	\$801,954	\$1,305,935	\$8,594,251	\$10,664,434	\$3,437,467	\$1,265,724	\$2,599,896	\$14,333,642	\$1,297,127	\$1,573,209	\$4,705,612	\$60,550,496
SERVICE CATCHMENT-FUTURE (Jan 2009)	\$553,464	\$86,480	\$787,698	\$2,148,573	\$28,685	\$207,594	\$1,765,671	\$9,993,947	\$513,339	\$90,986	\$18,347	\$419,055	\$2,415,511	\$9,887,279	\$5,844,868	\$34,761,498
SERVICE CATCHMENT-TOTAL (Jan 2009)	\$7,270,242	\$11,657,675	\$9,516,146	\$3,708,190	\$5,949,068	\$4,040,368	\$19,894,500	\$26,019,116	\$5,915,834	\$1,783,550	\$7,510,251	\$32,338,917	\$4,880,910	\$13,123,683	\$11,902,473	\$165,510,923
EQUIVALENT TENEMENTS (ET's)																
NPV of ultimate Demand (in EPW)	9,342	13,226	13,659	3,471	4,387	3,504	29,803	51,270	13,361	1,425	2,806	64,089	12,306	20,507	15,307	258,963
CHARGES																
SERVICE CATCHMENT-ACTIVE-EXISTING(June 2006)	\$524	\$489	\$416	\$449	\$1,167	\$721	\$320	\$105	\$147	\$300	\$1,743	\$274	\$95	\$81	\$86	
SERVICE CATCHMENT-PASSIVE-EXISTING(June 2006)	\$195	\$386	\$223	\$0	\$183	\$373	\$288	\$208	\$257	\$988	\$927	\$224	\$105	\$77	\$298	
SERVICE CATCHMENT-FUTURE (June 2006)	\$59	\$7	\$58	\$619	\$7	\$59	\$59	\$195	\$38	\$64	\$7	\$7	\$196	\$482	\$370	
SERVICE CATCHMENT-TOTAL (June 2006)	\$778	\$881	\$697	\$1,068	\$1,356	\$1,153	\$668	\$507	\$443	\$1,252	\$2,676	\$505	\$397	\$640	\$753	

⁶ Differences between the total value and the sum of the column can occur due to values being displayed without cents. Background calculations including cents are correct.

Schedule A: Demand Factors

Demand factors are calculated based on defined uses within the jurisdiction of each relevant planning scheme, and are therefore unique to each district within the Moreton Bay Regional Council shire area.

Table A - Demand Factors for Water Supply Infrastructure Contributions

	DEMAND FACTORS FOR MCUs - <i>PineRiversPlan</i> Land use	DEMAND FACTOR	COMMENT
1	Accommodation Units		Refer Motel
2	Adult Product Shop		Refer Shop
3	Agriculture		Assess Impact on Application
4	Airstrip		Assess Impact on Application
5	Animal Accommodation		Assess Impact on Application
6	Aquaculture		Assess Impact on Application
7	Associated Unit	1.65 EPW/du	JWP 1995 - Multiunit Dwellings (single level, semi-detached)
8	Bed and Breakfast Accommodation		Assess Impact on Application
9	Bulk Garden Supplies	10 EPW/ha	JWP 1995 - Warehouses and Bulk Stores
10	Camping Grounds		Assess Impact on Application
11	Car Depot		Assess Impact on Application
12	Car Park		Assess Impact on Application
13	Caravan/Transportable Home Park	50 EPW/ha	JWP 1995
14	Caretaker's Residence	2.9 EPW/du	Refer Detached House
15	Cattery		Assess Impact on Application
16	Cemetery	2.3 EPW/ha	JWP 1995
17	Child Care Centre	0.10 EPW/licensed child and each staff member at planned capacity	JWP 1995 - Child Care Excluding Kindergartens
18	Commercial Services		Assess Impact on Application
	Video Store		Assess Impact on Application
19	Community Facilities		Assess Impact on Application
20	Concrete Batching Plant		Assess Impact on Application
21	Contractor's Depot	5 EPW/ha	JWP 1995 - Builders Yard and Contractors Yard
22	Crematorium		Assess Impact on Application
23	Dairy		Assess Impact on Application
24	Detached House	2.9 EPW/du	
25	Display Home	2.9 EPW/du	
26	Domestic Storage	2 EPW/Domestic Storage Building	JWP 1995 - Outbuildings
27	Duplex Dwelling	5.8 EPW/duplex	
28	Educational Establishment	0.15 EPW / student and each staff member at planned capacity	Includes Kindergarten
29	Environmental Park	N/A	
30	Estate Sales Office		Refer Office
31	Extractive Industry		Assess Impact on Application
32	Farm Forestry		Assess Impact on Application
33	Fast Food Delivery Service		Assess Impact on Application
34	Food Outlet - Restaurant	0.04 EPW / m ² GFA	
	Drive Through	0.05 EPW / m ² GFA	
35	Funeral Parlour		Assess Impact on Application
36	General Industry		Assess Impact on Application
37	Hardware Shop	0.03 EPW / m ² GFA	
38	Hazardous and Offensive Industry (other than below)		Assess Impact on Application
	Oil Depot & Refinery	5 EPW/ha	JWP 1995 - Oil Depot & Refinery

	DEMAND FACTORS FOR MCUs - <i>PineRiversPlan</i> Land use	DEMAND FACTOR	COMMENT
39	High Density Multiple Dwelling Units (0.8 floor area ratio)	1.65 EPW/du	JWP 1995 - Multiunit Dwelling (Flats, multilevel)
40	Home Business		Assess Impact on Application
41	Hospital	0.05 EPW / m ² GFA	
42	Hotel	0.04 EPW / m ² GFA	
43	Indoor Entertainment and Sport		Assess Impact on Application
	Squash Courts		Assess Impact on Application
	Tennis Courts		Assess Impact on Application
	Gymnasiums & Other		Assess Impact on Application
44	Infill Housing	2.9 EPW/du	
45	Institution		Assess Impact on Application
46	Intensive Animal Husbandry		Assess Impact on Application
47	Kennels		Assess Impact on Application
48	Local Utilities	N/A	
49	Low Density Multiple Dwelling Units	2.9 EPW/du	
50	Major Telecommunication Facility		Assess Impact on Application
51	Market		Assess Impact on Application
52	Medium Density Multiple Dwelling Units (0.5 floor area ratio)	1.65 EPW/du	
53	Motel		Assess Impact on Application
54	Motor Sport		Assess Impact on Application
55	Night Club		Refer Restaurant
56	Non-Intensive Animal Husbandry		Assess Impact on Application
57	Office (other than below)	0.015 EPW / m ² GFA	
	Bank	0.015 EPW / m ² GFA	
	Doctor / Dentist Surgery	0.023 EPW / m ² GFA	
	Medical Centre	0.025 EPW / m ² GFA	
58	Outdoor Recreation (other than below)		
	Sports Club / Facilities	10 EPW/ha	JWP 1995 - Sports Club / Facilities
	Sportsground and Racecourse	5 EPW/ha	JWP 1995 - Sportsground and Racecourse
	Tennis Courts		Assess Impact on Application
59	Outdoor Sales		Assess Impact on Application
60	Park	N/A	
61	Passenger Terminal		Assess Impact on Application
62	Pensioner Units	1.35 EPW/du	JWP 1995 - Multiunit Dwelling (Flats, multilevel)
63	Place of Worship		Assess Impact on Application
64	Public Utilities		Assess Impact on Application
65	Radio Station		Refer Office
66	Recycling Depot	N/A	
67	Retail Nursery		Assess Impact on Application, but 70-100 EPW/ha would seem reasonable based on real world examples
68	Retirement Village		Assess Impact on Application
69	Road Purposes	N/A	
70	Rural Industry		Assess Impact on Application
71	Salvage Yard		Assess Impact on Application
72	Service Industry		Assess Impact on Application
73	Service Station	0.023 EPW / m ² GFA	
74	Shooting		Assess Impact on Application
75	Shop		
a	Standalone Retail Shop / Convenience Store	0.023 EPW / m ² GFA	
b	Local Shopping Centre (Convenience	0.023 EPW / m ² GFA	

		DEMAND FACTOR	COMMENT
	DEMAND FACTORS FOR MCUs - PineRiversPlan Land use		
	Shopping Centre)		
c	Central Business Shopping Centre (incl. Supermarket)	0.023 EPW / m ² GFA	
d	Major Shopping Centre	0.023 EPW / m ² GFA	
76	Showroom (other than below)	0.01 EPW / m ² GFA	
	Fruit and Vegetable store >300m ²	0.025 EPW / m ² GFA	
77	Simulated Conflict		Assess Impact on Application
78	Special Use		Assess Impact on Application
79	Stock Sales Yard		Assess Impact on Application
80	Tourist Cabins		Access Impact on Application
81	Vehicle Sales	10 EPW/ha	JWP 1995 - Sales Area Outdoors (Dealers and Car and Boats etc)
82	Veterinary Clinic	0.025 EPW / m ² GFA	
83	Veterinary Hospital	0.025 EPW / m ² GFA	
84	Warehouse	10 EPW/ha	JWP 1995 - Warehouses & Bulk Stores
	DEMAND FACTOR FOR RALs		
	Residential A & Future Urban		
	Lot Size ≤1200m ² – (can accommodate Duplex)	5.8 EPW/lot	15 du/ha developable area
	Lot Size < 1200m ² - to accommodate Associated Unit	4.55 EPW/lot	15 du/ha developable area
	Lot Size < 1200m ² - single dwelling	2.9 EPW/lot	15 du/ha developable area
	Residential B & Future Urban		
	Residential B ≤600m ²	4.55 EPW/lot	35 du/ha developable area
	Residential B lots >600m ²	101.5 EPW/ha developable area	35 du/ha developable area
	Special Residential Urban (1250m ²)	4.55 EPW/lot	6 du/ha developable area
	Special Residential Non-Urban	4.55 EPW/lot	1.25 du/ha developable area
	Park Residential	4.55 EPW/lot	1.25 du/ha developable area
	Rural Residential	N/A	N/A
	Future Urban		Refer Residential A & B
	Central Business	30 EPW/ha site area	Water Planning Assumptions
	Commercial	30 EPW/ha site area	Water Planning Assumptions
	Local Business	30 EPW/ha site area	Water Planning Assumptions
	Neighbourhood Facilities	30 EPW/ha site area	Water Planning Assumptions
	Urban Village	30 EPW/ha site area	Water Planning Assumptions
	Village Centre	30 EPW/ha site area	Water Planning Assumptions
	Home Industry	10 EPW/ha site area	Water Planning Assumptions
	Service Industry	15 EPW/ha site area	Water Planning Assumptions
	General Industry	30 EPW/ha site area	Water Planning Assumptions
	Extractive Industry	15 EPW/ha site area	Water Planning Assumptions
	Rural (Coast & Riverlands Locality.)	7.5 EPW/ha site area	Water Planning Assumptions
	Rural (Urban, Major Employment Centre, Catchment, Rural Living, Village, Mt Summit and Forest Localities)	7.5 EPW/ha site area	Water Planning Assumptions
	Conservation	0 EPW/ha site area	Water Planning Assumptions
	Park & Open Space	N/A	Water Planning Assumptions
	Sports & Recreation	15 EPW/ha site area	Water Planning Assumptions
	Special Purposes	15 EPW/ha site area	Water Planning Assumptions

Schedule B: Infrastructure Contribution Rates

Table B –Water Supply - Infrastructure Contribution Rates (ICR's)


Service Catchment		ICR / (\$EPW)
DAYBORO	DAY	\$1,068
ALBANY CREEK LLZ	ACL	\$778
ALBANY CREEK HLZ	ALC	\$881
CLEAR MTN HLZ	CMH	\$697
EATONS HILL HLZ	EAH	\$1,356
HILLS HLZ	HLA	\$1,153
HILLS LLZ	HLH	\$668
KALLANGUR	KAL	\$507
PETRIE	PET	\$443
SAMFORD VILLAGE	SAM	\$1,252
SAMFORD DOWNS	SAD	\$2,676
STRATHPINE LAWNTON LLZ	STR	\$505
DAKABIN	DAK	\$397
GRIFFIN	GRN	\$640
MANGO HILL	MGH	\$753


Schedule C: Service Catchments

Historic Version
PineRiversPlan

MAP SHEET INDEX

Pine Rivers Shire

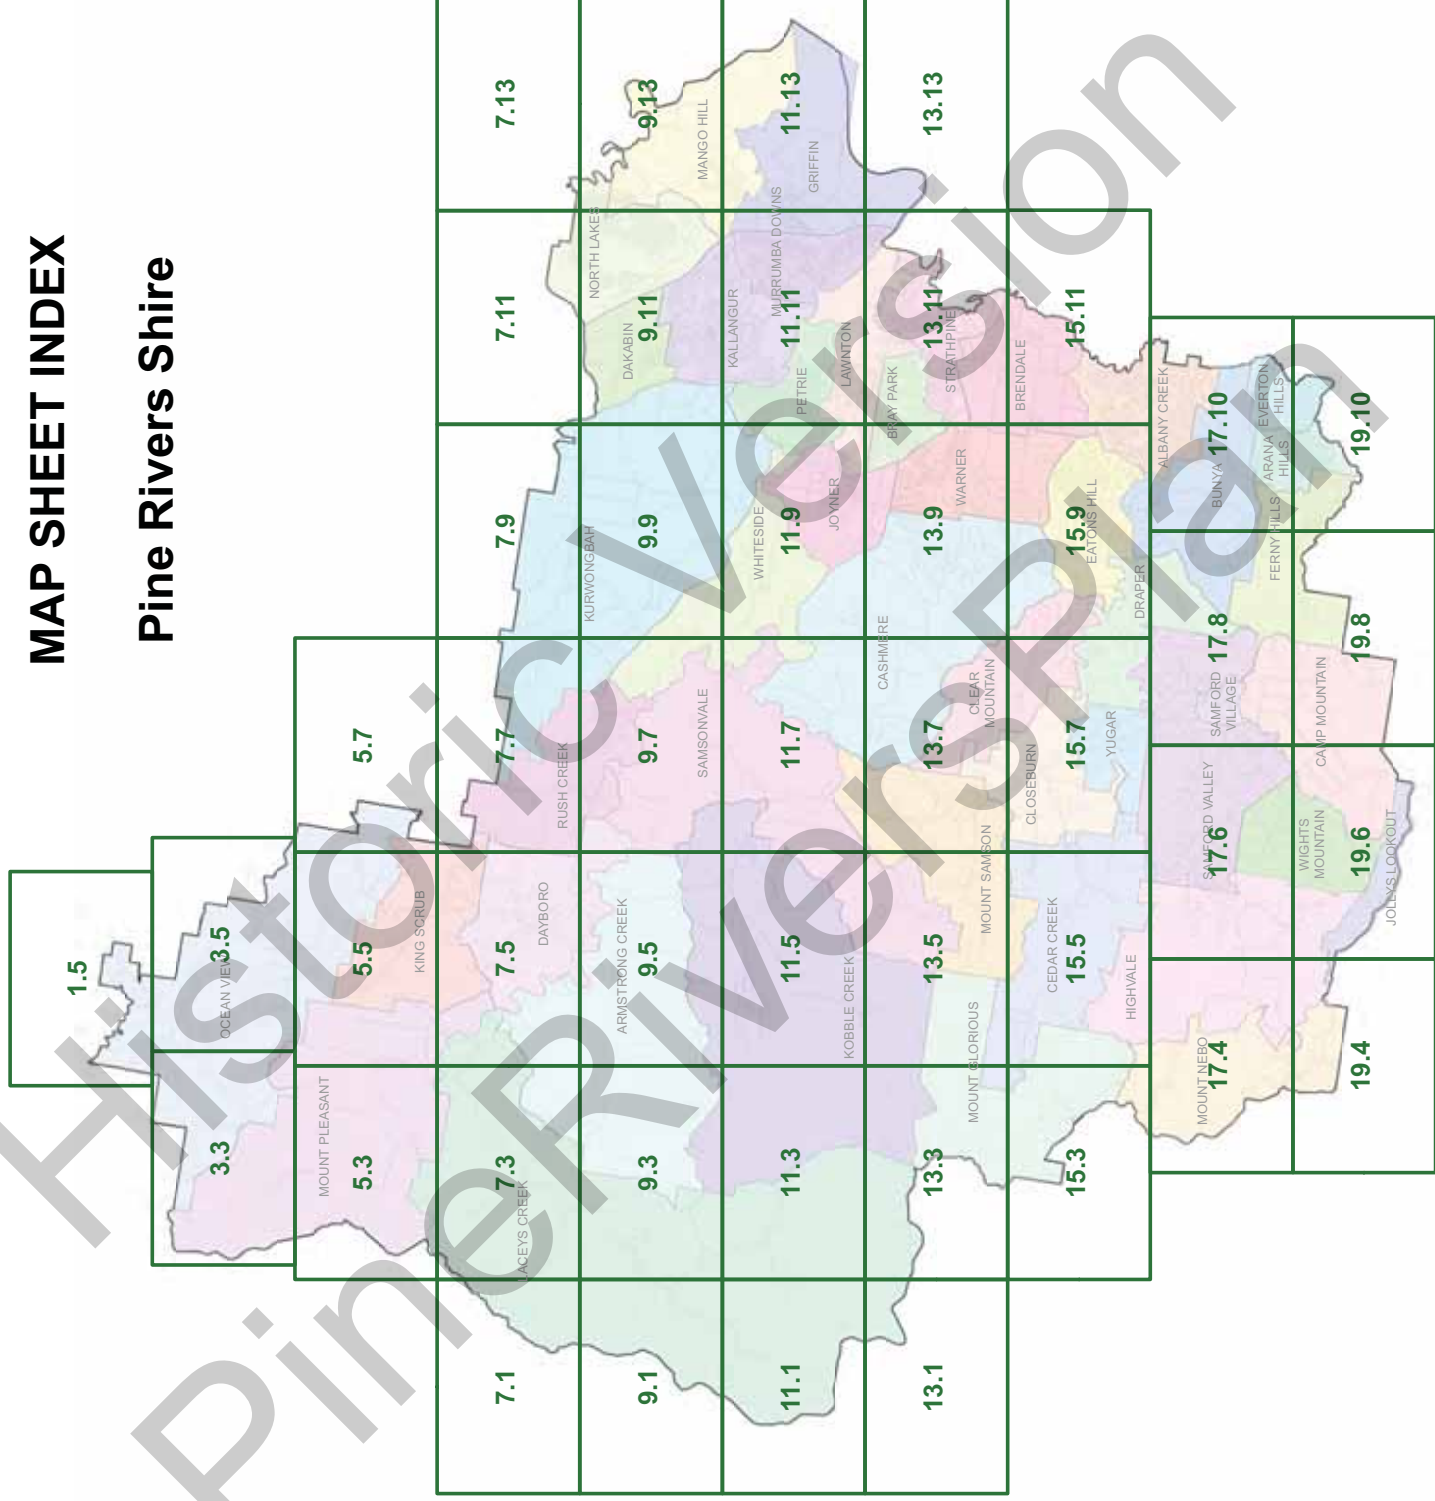

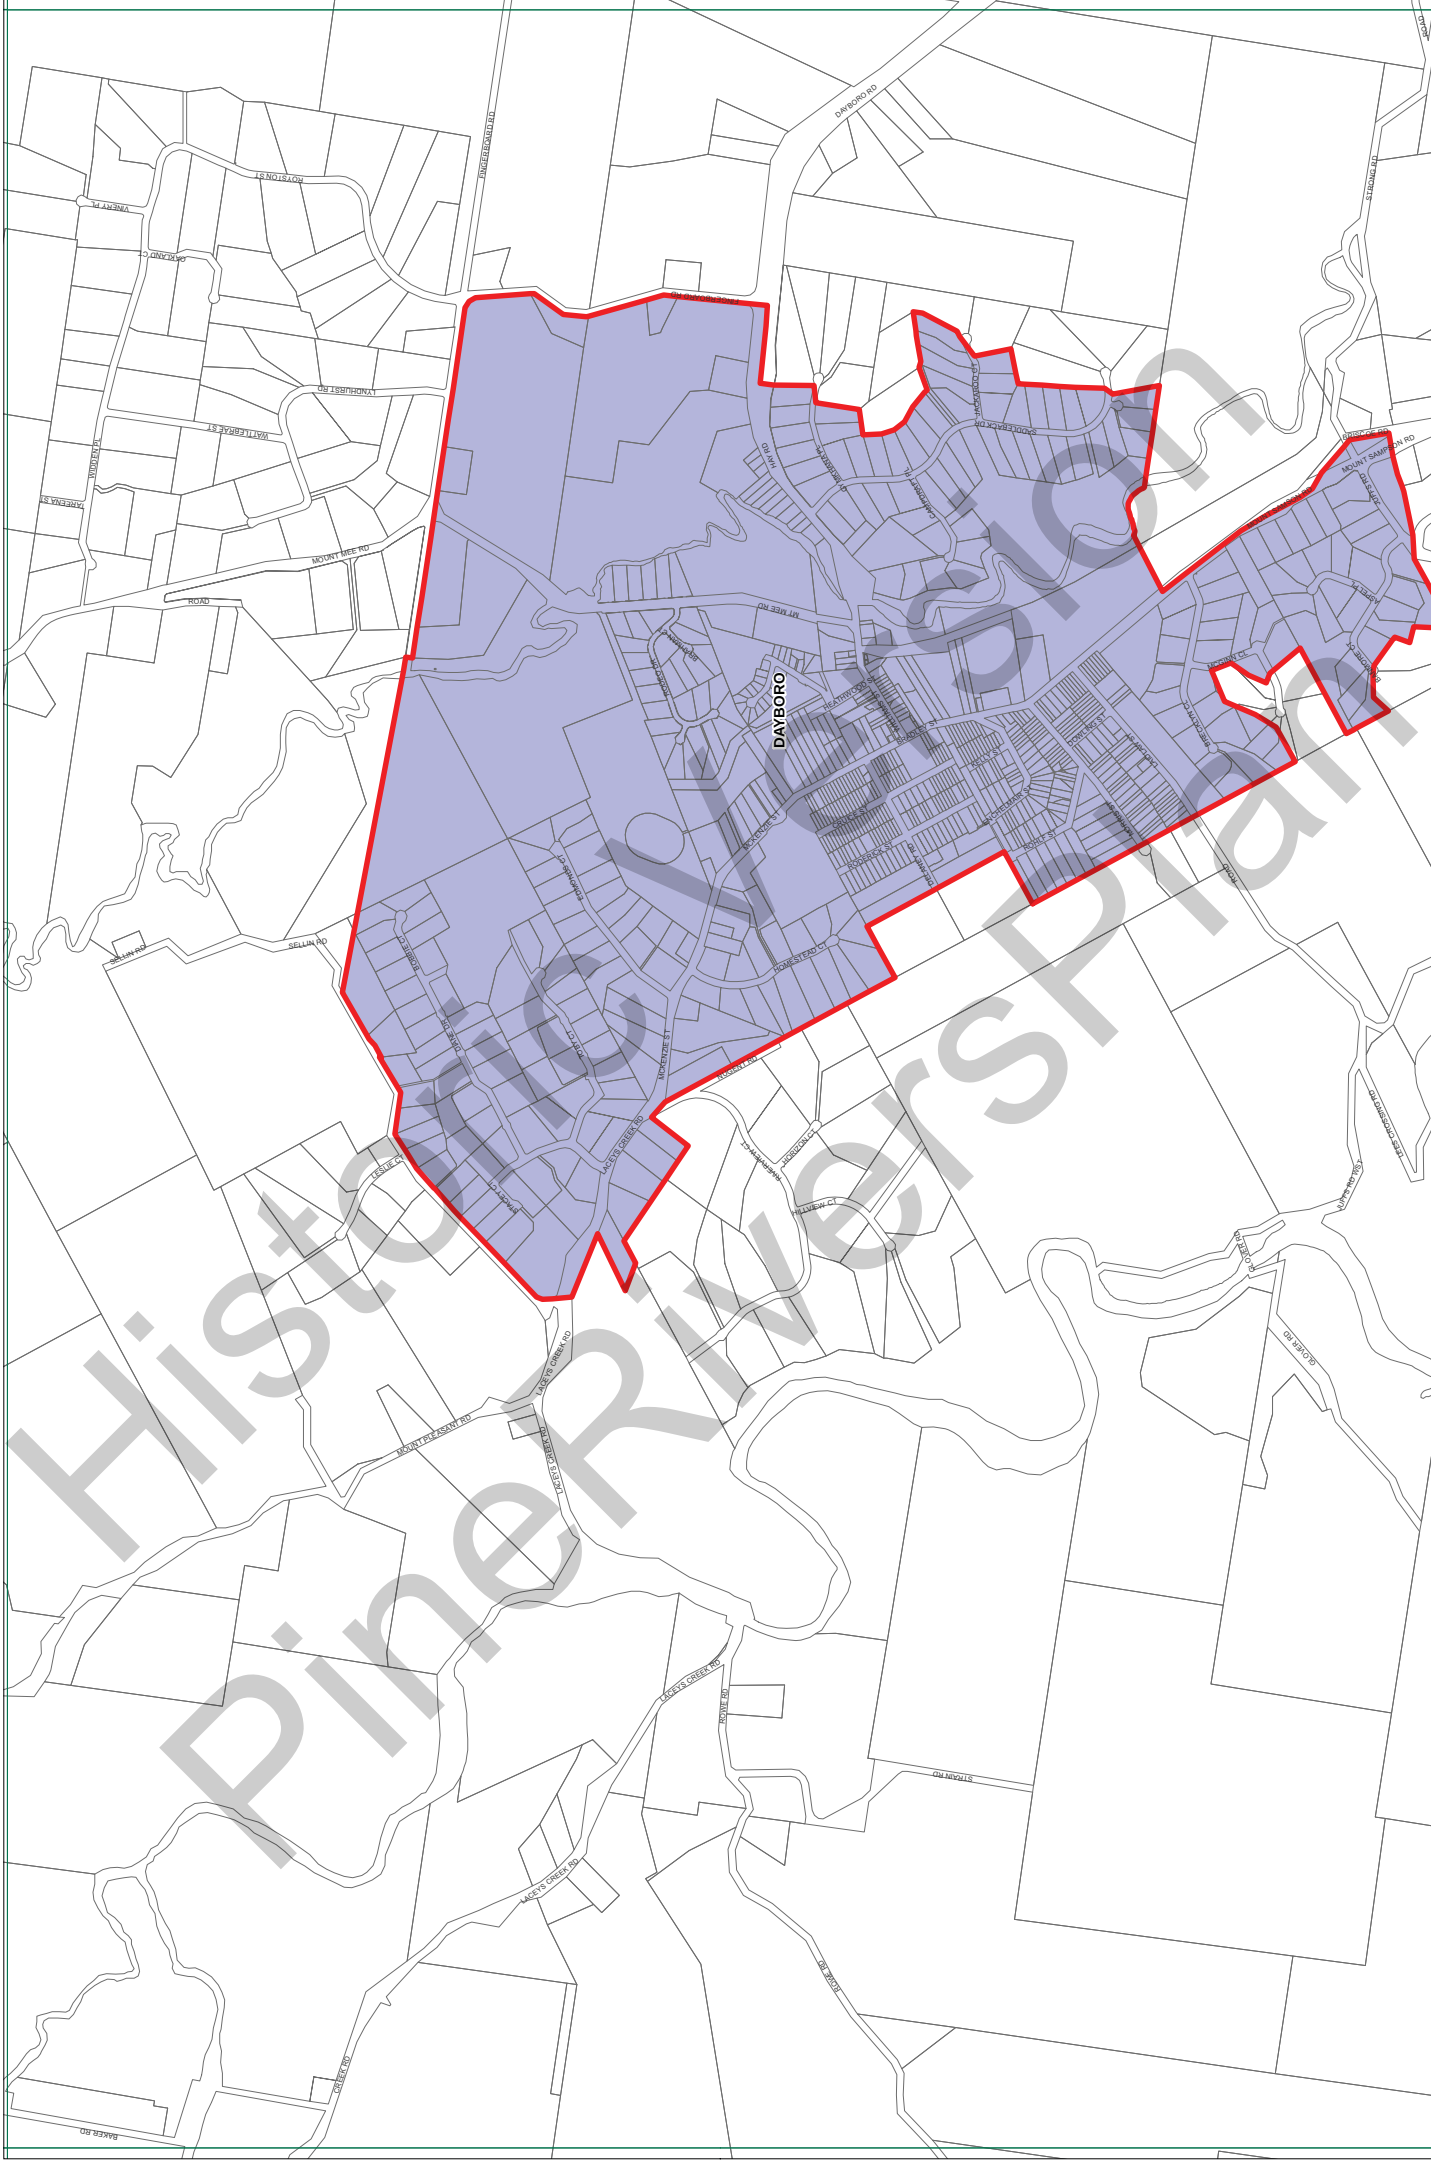


0 62.5 125 250 375 500
Metres
Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and do not constitute a warranty or guarantee of accuracy.
The Council is not responsible for any errors or omissions in the map. Mapping details are for
general information only and do not constitute a warranty or guarantee of accuracy. Mapping details
are for general information only and do not constitute a warranty or guarantee of accuracy. Mapping
details are for general information only and do not constitute a warranty or guarantee of accuracy.
Council (and its officers and agents) expressly disclaims responsibility for any loss or damage
arising from the use of this map.

Regional Water Catchments
DAYBORO
PINE CENTRAL


Local Water Catchments
EATONS HILL HLZ
PETRIE
SAMFORD
NORTH LAKES
HILLS HLZ
HILLS HLZ
KALLANGUR
NGC
DAYBORO
CLEAR MOUNTAIN HLZ
ALBANY CREEK HLZ
ALBANY CREEK HLZ



5.3	5.5	5.7
7.3	7.5	7.7
9.3	9.5	9.7

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS
Map Number 7.5

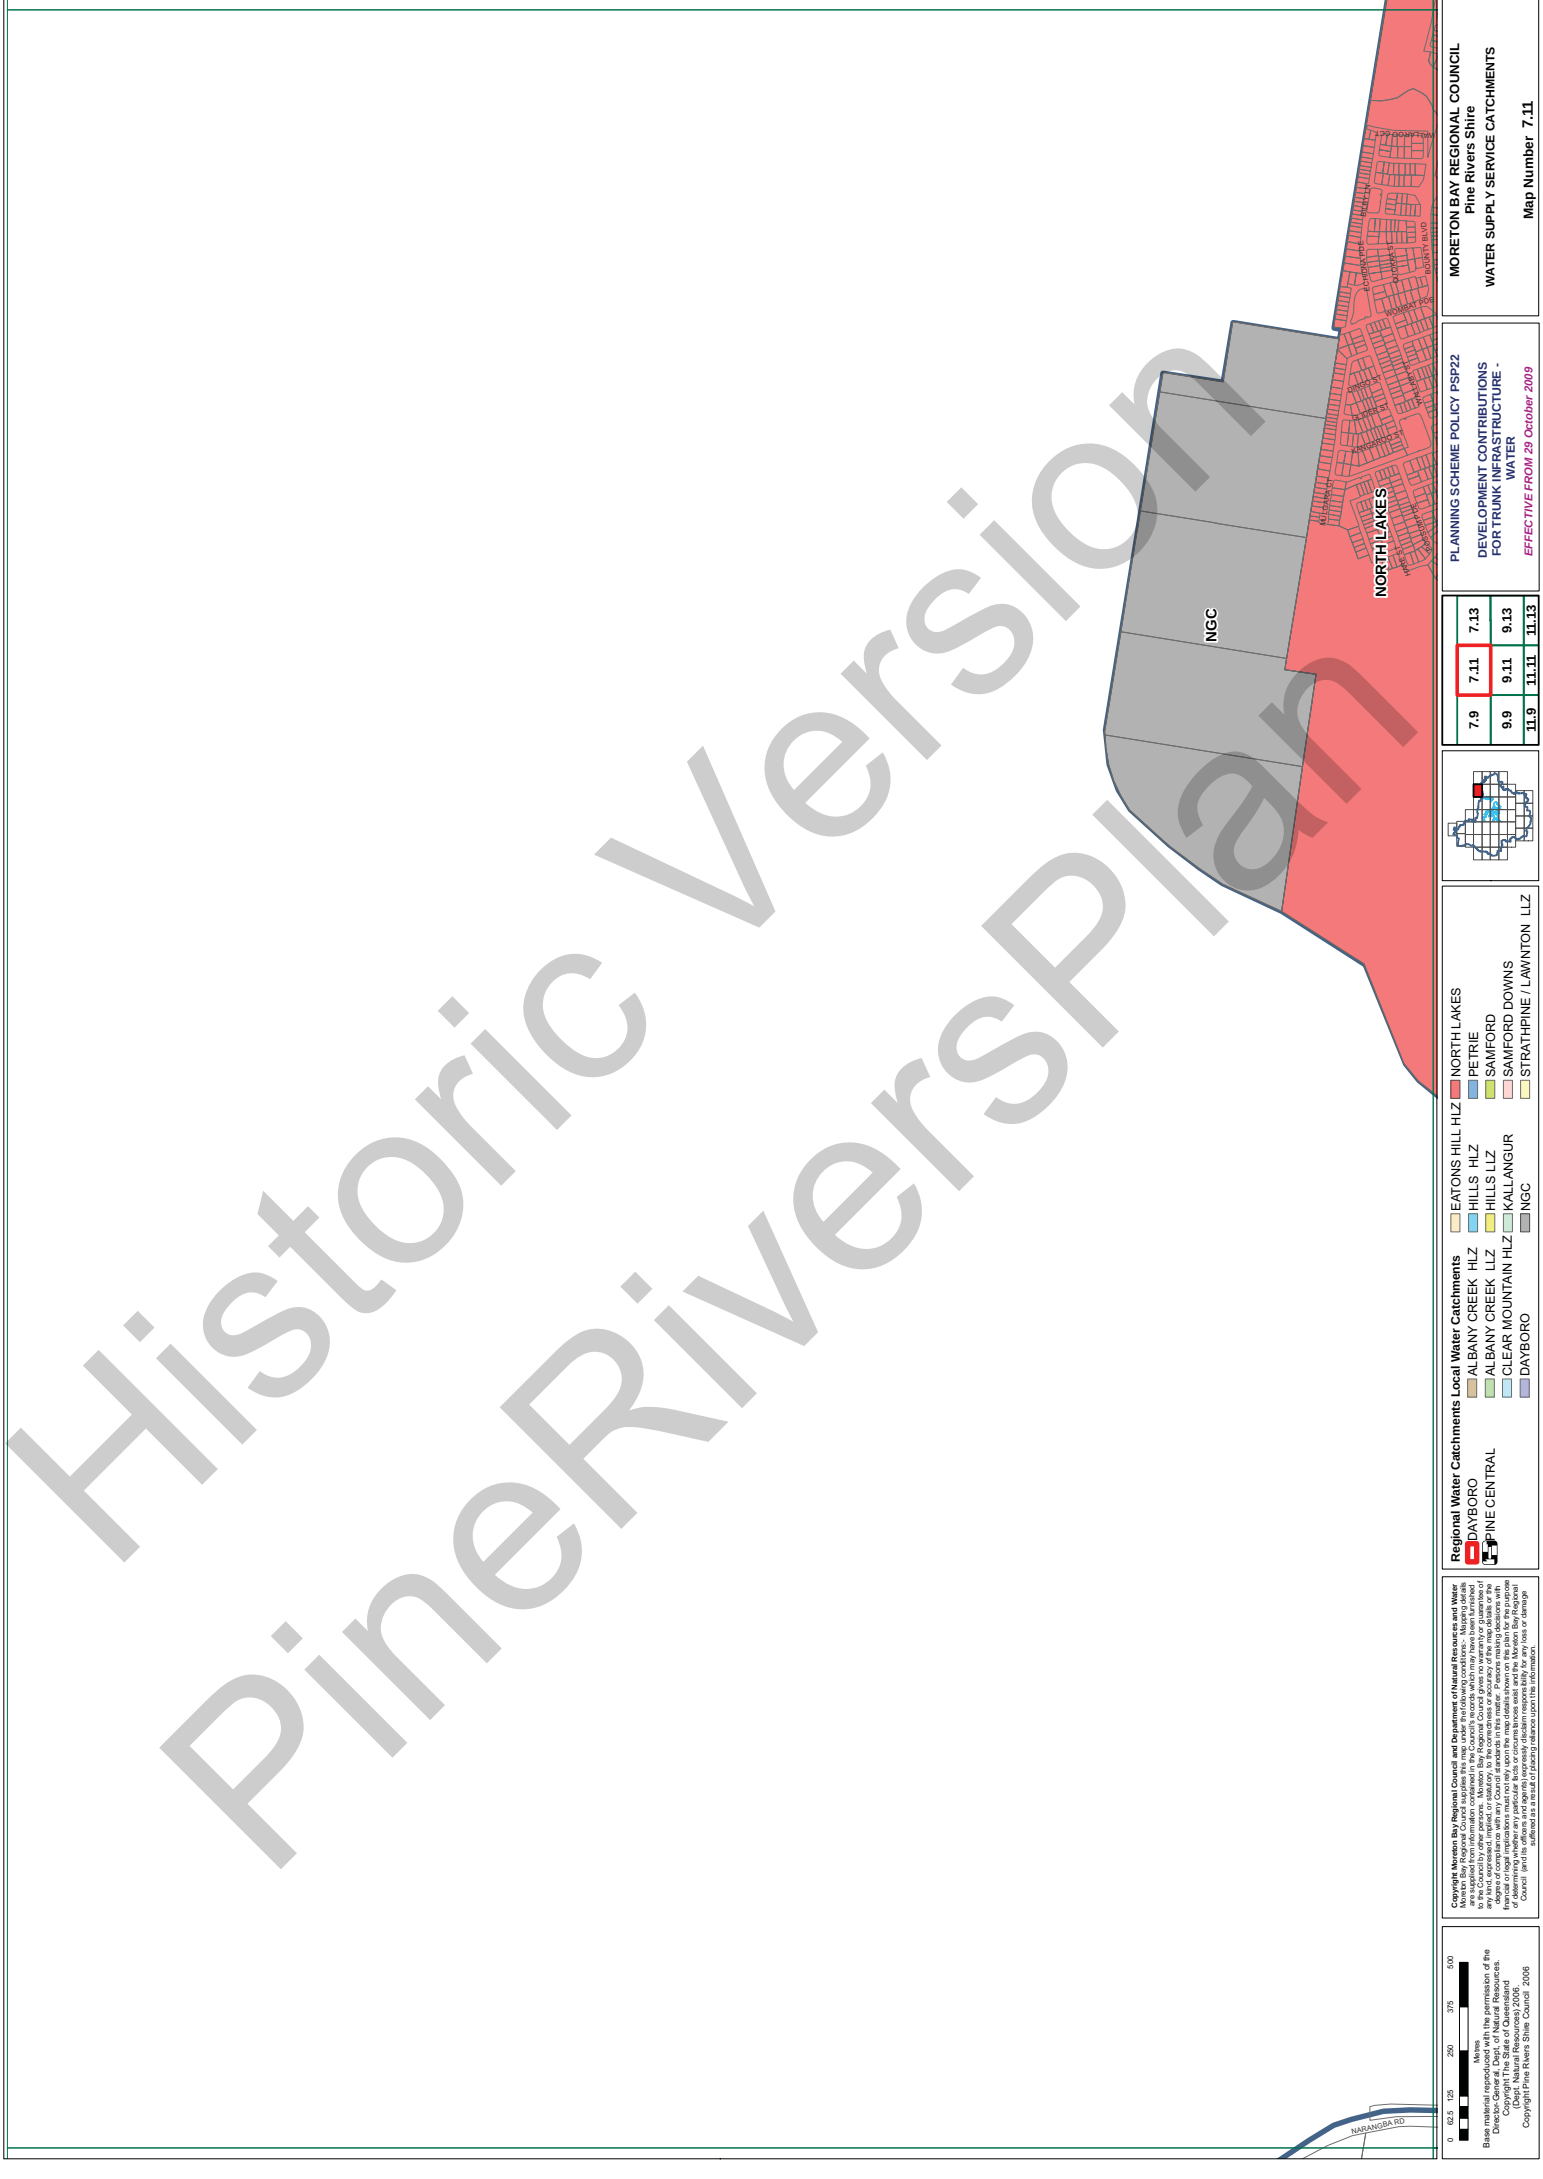

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

7.9	7.11	7.13
9.9	9.11	9.13
11.9	11.11	11.13




Regional Water Catchments Local Water Catchments

DAYBORO NORTH LAKES
PETRE
SAMFORD
KALLANGUR
NGC
EATONS HILL HLZ
HILLS HLZ
HILLS LLZ
ALBANY CREEK HLZ
ALBANY CREEK LLZ
CLEAR MOUNTAIN HLZ
DAYBORO
STRATHPINE / LAWINTON LLZ

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and are not to be used for any purpose other than that for which
they were prepared. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness of the information contained in this map. The user of the map
accepts full responsibility for any loss or damage arising from the use of the map.
Council (and its officers and agents) expressly disclaims responsibility for any loss or damage
arising from the use of the map.

0 62.5 125 250 375 500
Metres
Scale
Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006

Historic Version
PineRiversPlan

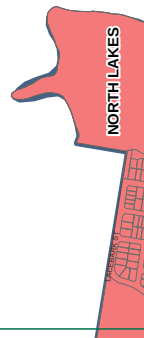


0 62.5 125 250 375 500
Metres
Scale
Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and are not to be used for any purpose other than that for which
they were prepared. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness. Moreton Bay Regional Council is not responsible for any errors or
omissions or for any consequences arising from the use of this map. Persons making decisions on
the basis of this map do so at their own risk. The map is not to be used for any purpose
other than that for which it was prepared. Moreton Bay Regional Council is not responsible for
any errors or omissions or for any consequences arising from the use of this map. Moreton
Bay Regional Council (and its officers and agents) expressly disclaims responsibility for any loss or damage
arising from the use of this map. (PSP22) 29/10/2009


Regional Water Catchments Local Water Catchments
DAYBORO
PINE CENTRAL

- EATONS HILL HLZ
- ALBANY CREEK HLZ
- ALBANY CREEK HLZ
- CLEAR MOUNTAIN HLZ
- DAYBORO
- HILLS HLZ
- HILLS LLZ
- KALLANGUR
- NGC
- NORTH LAKES
- PETRIE
- SAMFORD
- SAMFORD DOWNS
- STRATHPINE / LAWINTON LLZ



7.11	7.13
9.11	9.13

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

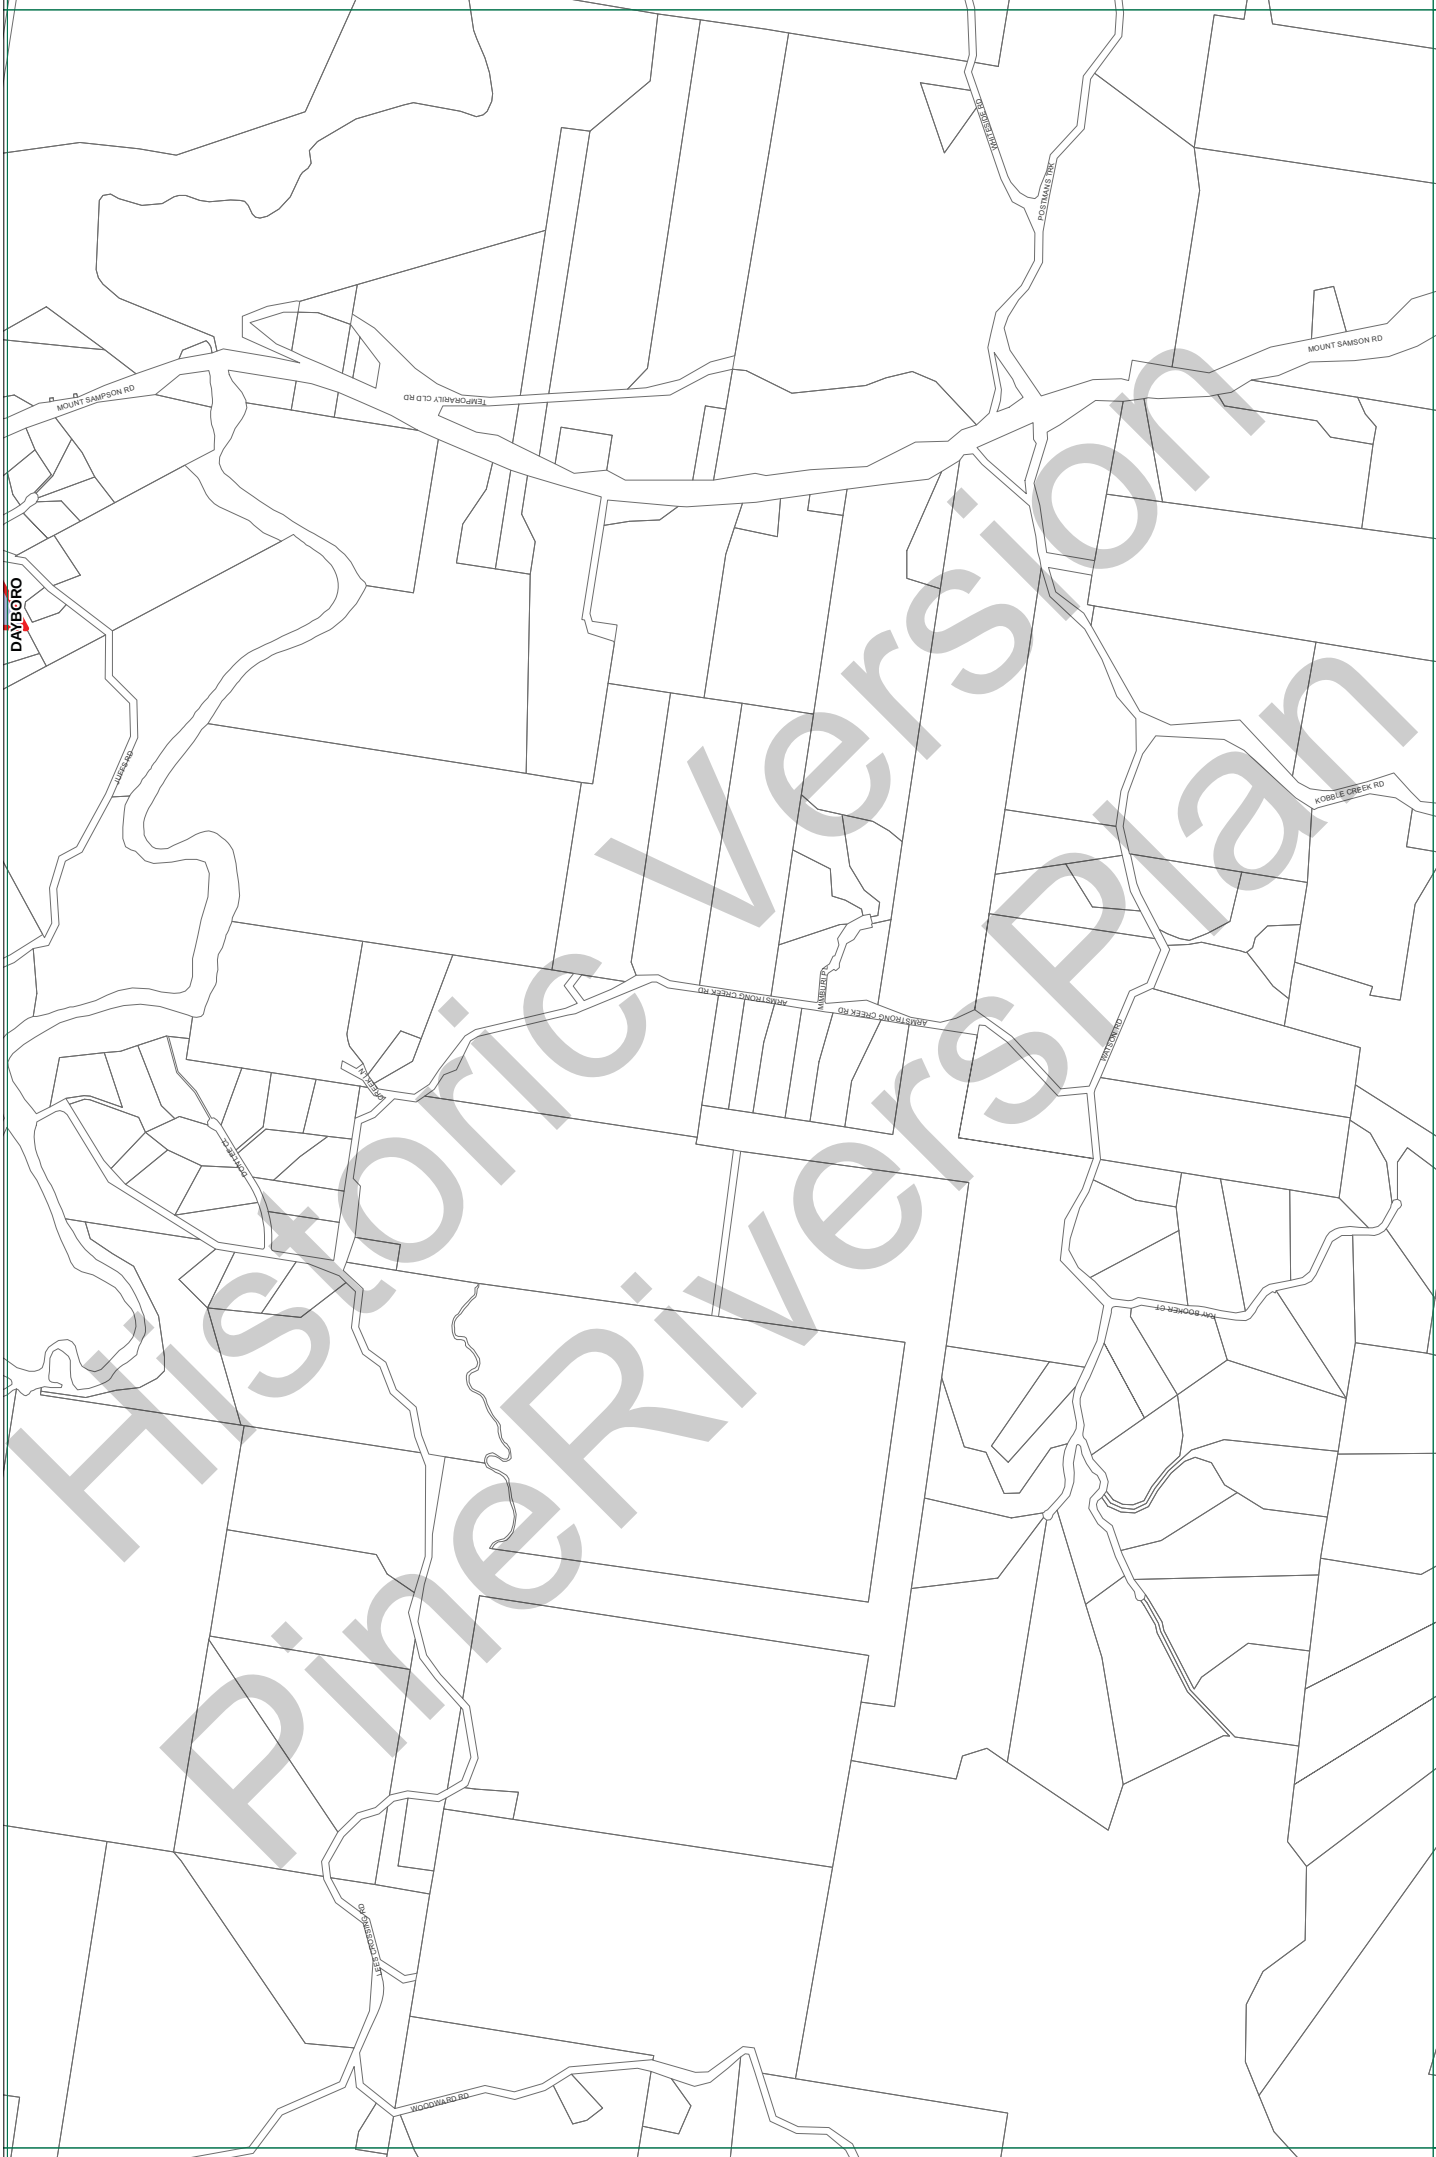

0 62.5 125 250 375 500
Metres

Base material supplied by permission of the
Director-General, Dept. of Natural Resources.
Copyright © The State of Queensland 2006
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and are not to be used for any purpose other than that for which they
were prepared. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness. Moreton Bay Regional Council is not responsible for any errors or
omissions or for any consequences arising from the use of this map. Moreton Bay Regional Council
accepts no liability for any loss or damage, whether direct or indirect, arising from the use of this map.

Regional Water Catchments Local Water Catchments

DAYBORO
PINE CENTRAL

ALBANY CREEK HLZ
ALBANY CREEK HLZ
CLEAR MOUNTAIN HLZ
DAYBORO


EATONS HILL HLZ
HILLS HLZ
HILLS HLZ
KALLANGUR
NGC

NORTH LAKES
PETRIE
SAMFORD
SAMFORD DOWNS
STRATHPINE / LAWINTON LLZ

Planning Scheme Policy PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

7.3	7.5	7.7
9.3	9.5	9.7
11.3	11.5	11.7

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS
Map Number 9.5

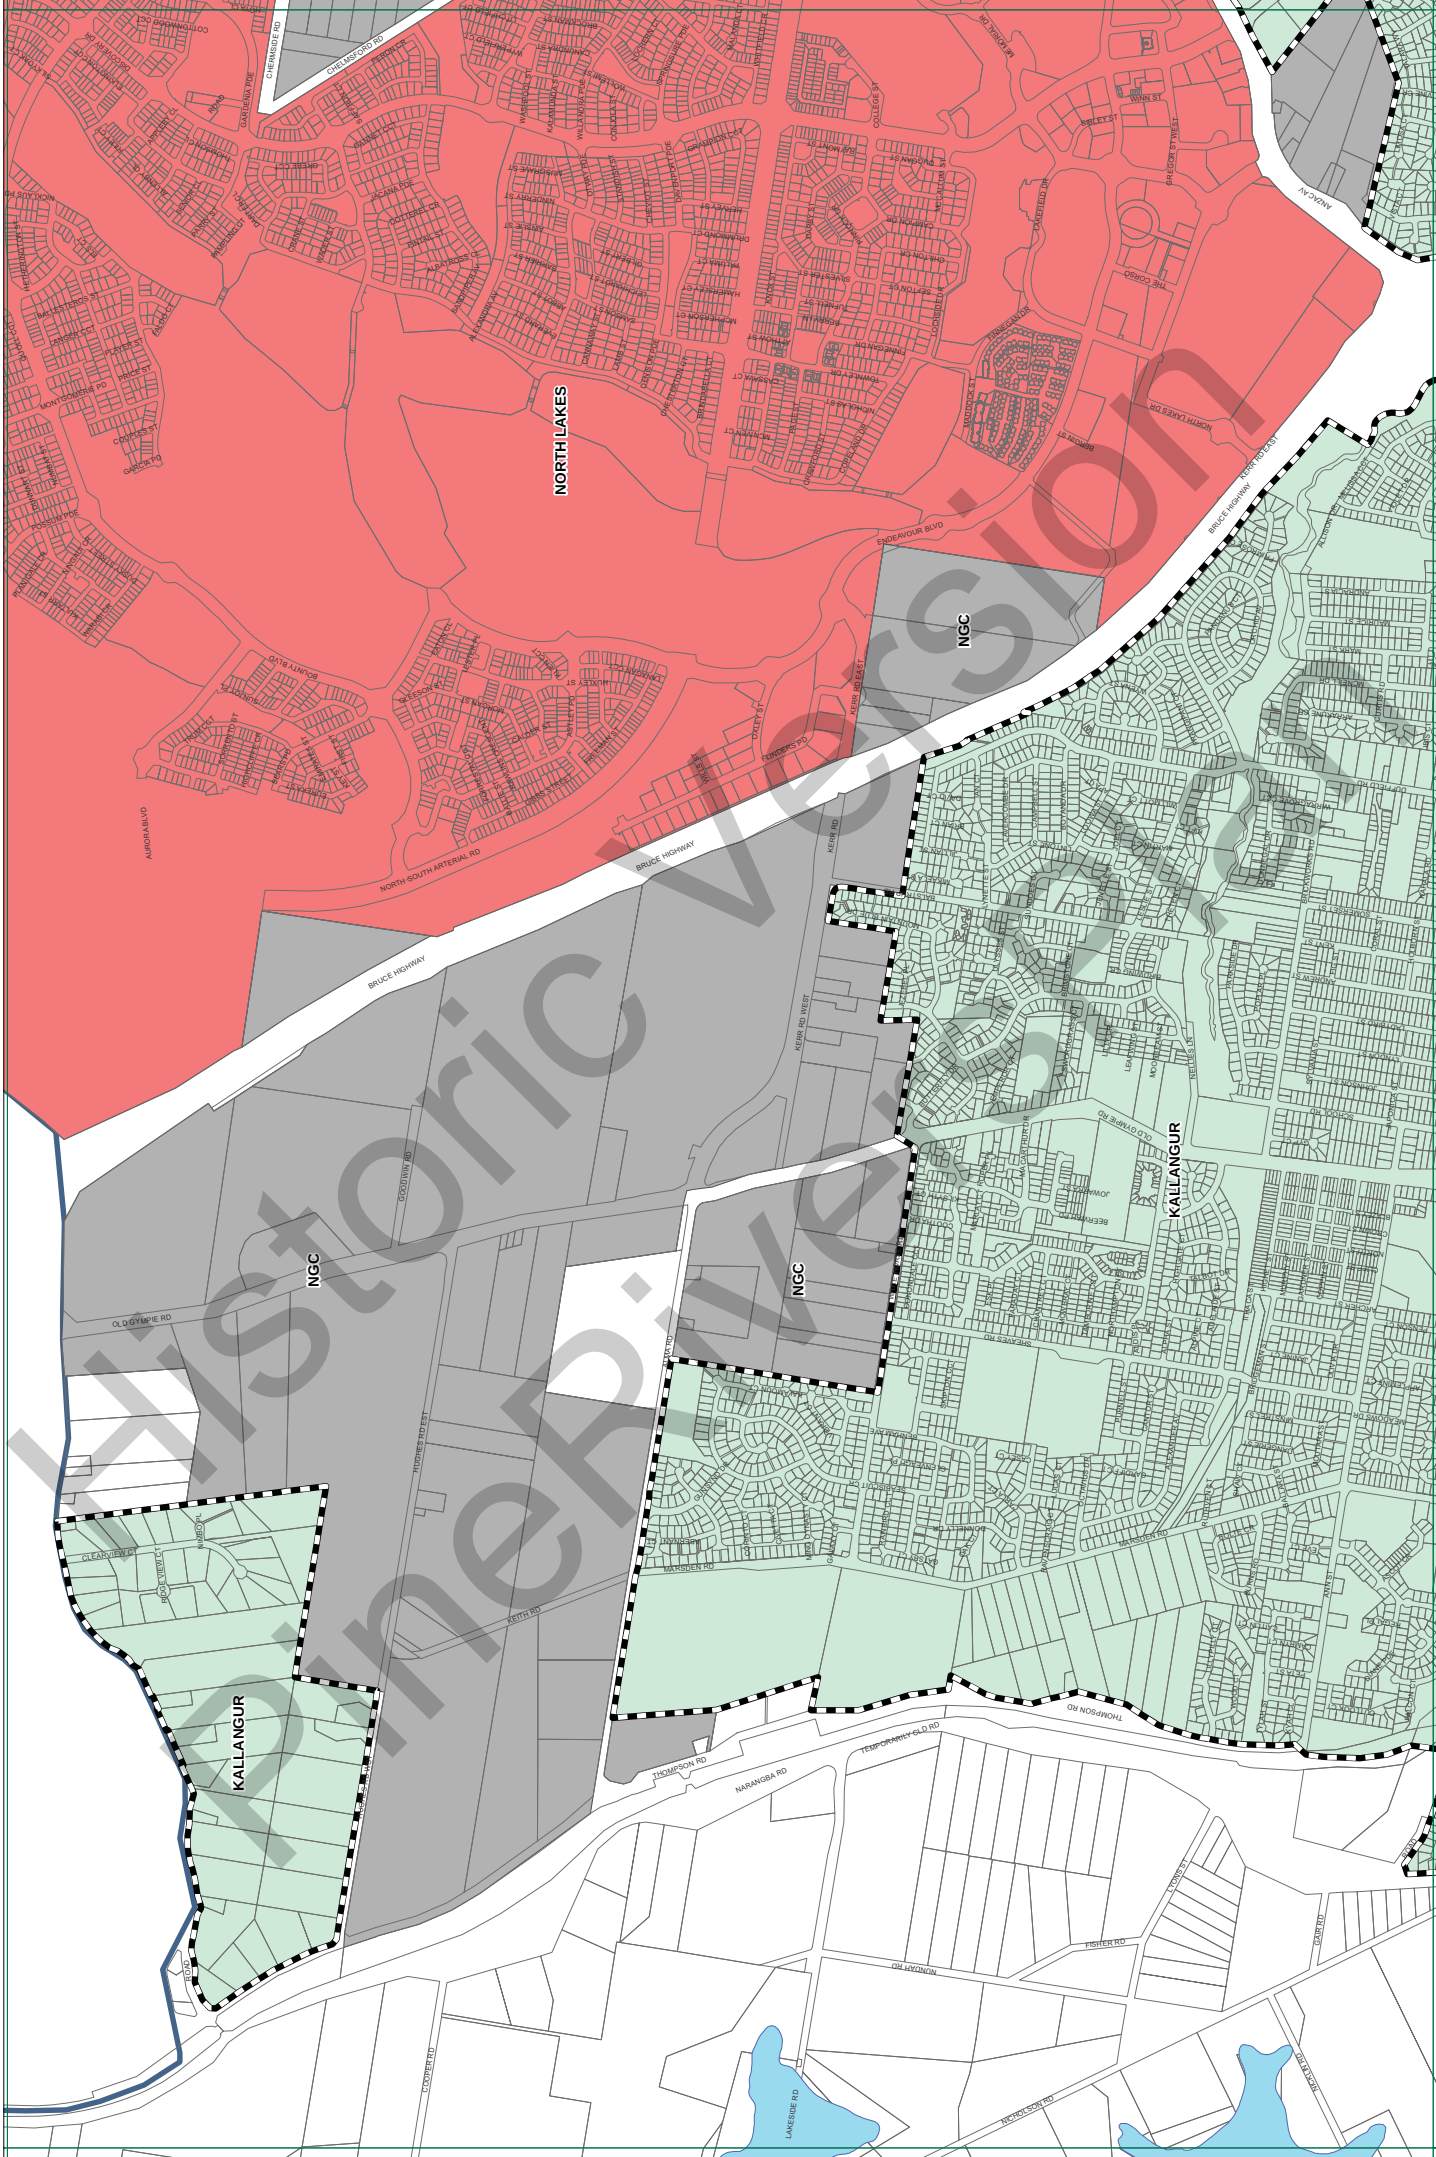


0 62.5 125 250 375 500
Metres

Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and do not constitute a warranty or guarantee of accuracy.
The Council is not responsible for any errors or omissions. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness. Moreton Bay Regional Council is not responsible for any errors or omissions.
Persons making decisions with
reference to map information must rely upon the map details shown on the plan for the purpose
intended. The Council and its officers and agents expressly disclaim responsibility for any loss or damage
caused by reliance upon the map details shown on the plan for the purpose intended.


Regional Water Catchments Local Water Catchments
DAYBORO
PINE CENTRAL

- EATONS HILL HLZ
- PETRIE
- ALBANY CREEK HLZ
- ALBANY CREEK LLZ
- CLEAR MOUNTAIN HLZ
- DAYBORO
- HILLS HLZ
- HILLS LLZ
- KALLANGUR
- NGC
- NORTH LAKES
- SAMFORD
- SAMFORD DOWNS
- STRATHPINE / LAWINTON LLZ



7.9	7.11	7.13
9.9	9.11	9.13
11.9	11.11	11.13

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

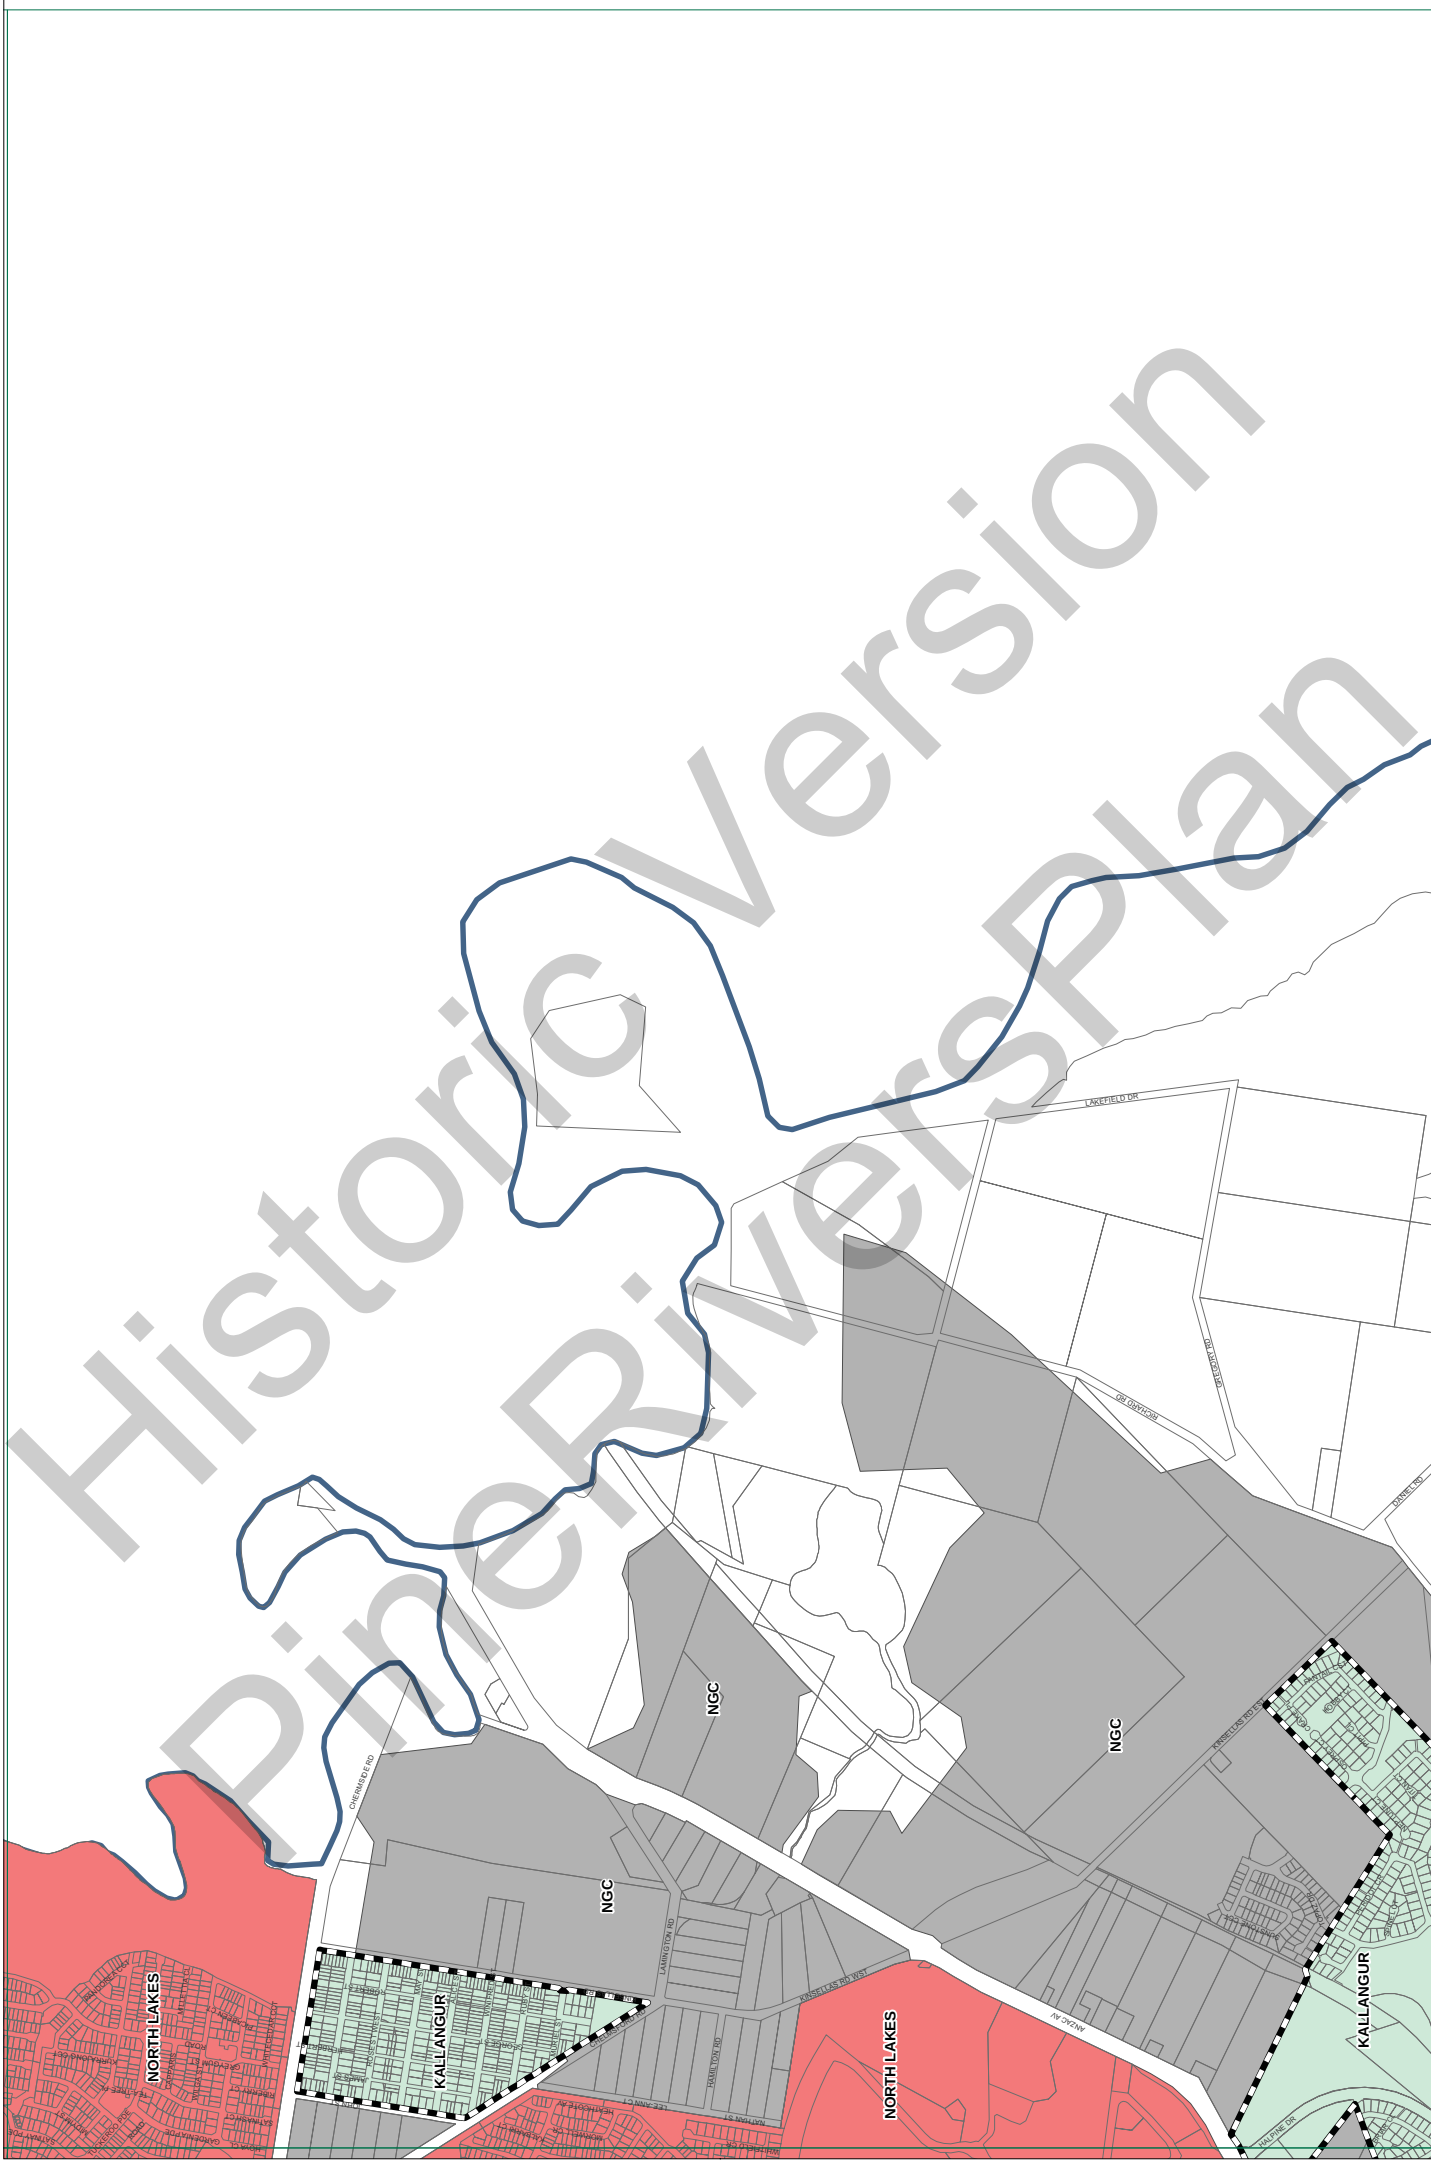

0 62.5 125 250 375 500
Metres

Base material sourced from the Department of Natural Resources and Environment, Queensland, under the permission of the Director-General, Dept. of Natural Resources.
Copyright © The State of Queensland 2006
Copyright Pine Rivers Shire Council 2006


Regional Water Catchments Local Water Catchments

- EATONS HILL HLZ
- ALBANY CREEK HLZ
- HILLS HLZ
- CLEAR MOUNTAIN HLZ
- DAYBORO
- NORTH LAKES
- PETRIE
- SAMFORD
- STRAITHPINE / LAWINTON / LLZ

Planning Scheme Policy PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

7.9	7.11	7.13
9.9	9.11	9.13
11.9	11.11	11.13

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS
Map Number 9.13

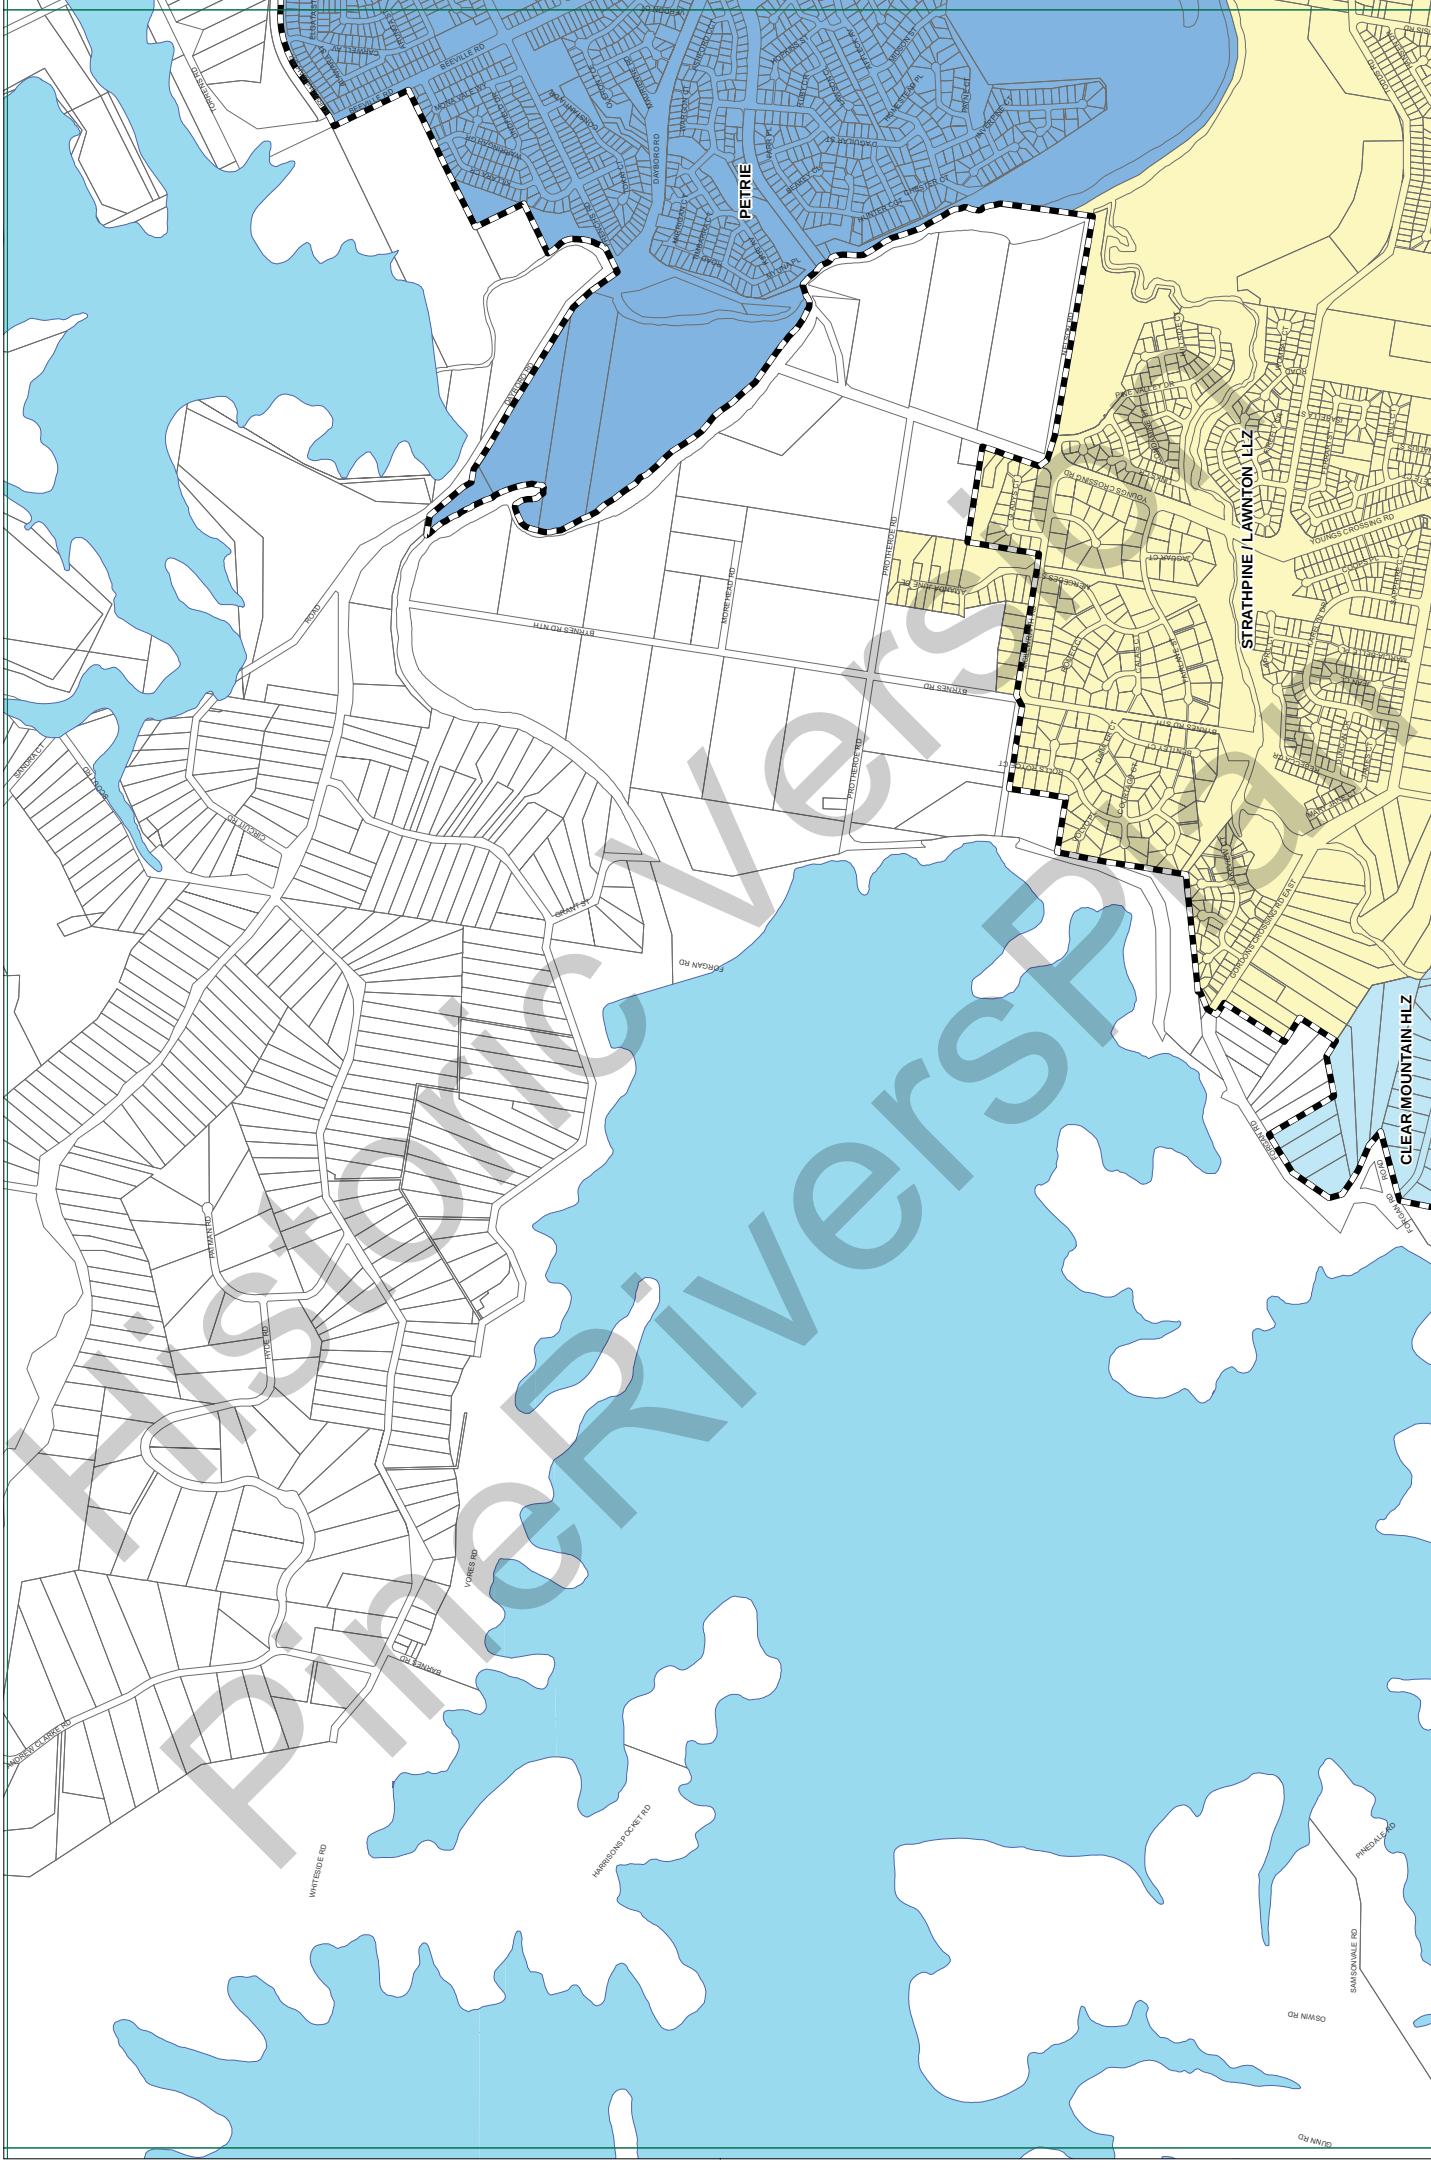


0 62.5 125 250 375 500
Metres
Scale
Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and are not to be used for any purpose other than that for which
they were prepared. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness. Moreton Bay Regional Council is not responsible for any errors or
omissions or for any consequences arising from the use of this map. Moreton Bay Regional
Council and its officers and agents accept no responsibility for any loss or damage
resulting from the use of this map.

Regional Water Catchments Local Water Catchments
DAYBORO
PINE CENTRAL


- EATONS HILL HLZ
- HILLS HLZ
- ALBANY CREEK HLZ
- ALBANY CREEK HLZ
- CLEAR MOUNTAIN HLZ
- DAYBORO
- NORTH LAKES
- PETRIE
- SAMFORD
- HILLS LLZ
- KALLANGUR
- CLEAR MOUNTAIN HLZ
- DAYBORO
- NGC
- STRATHPINE / LAWINTON LLZ



9.7	9.9	9.11
11.7	11.9	11.11
13.7	13.9	13.11

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS
Map Number 11.9

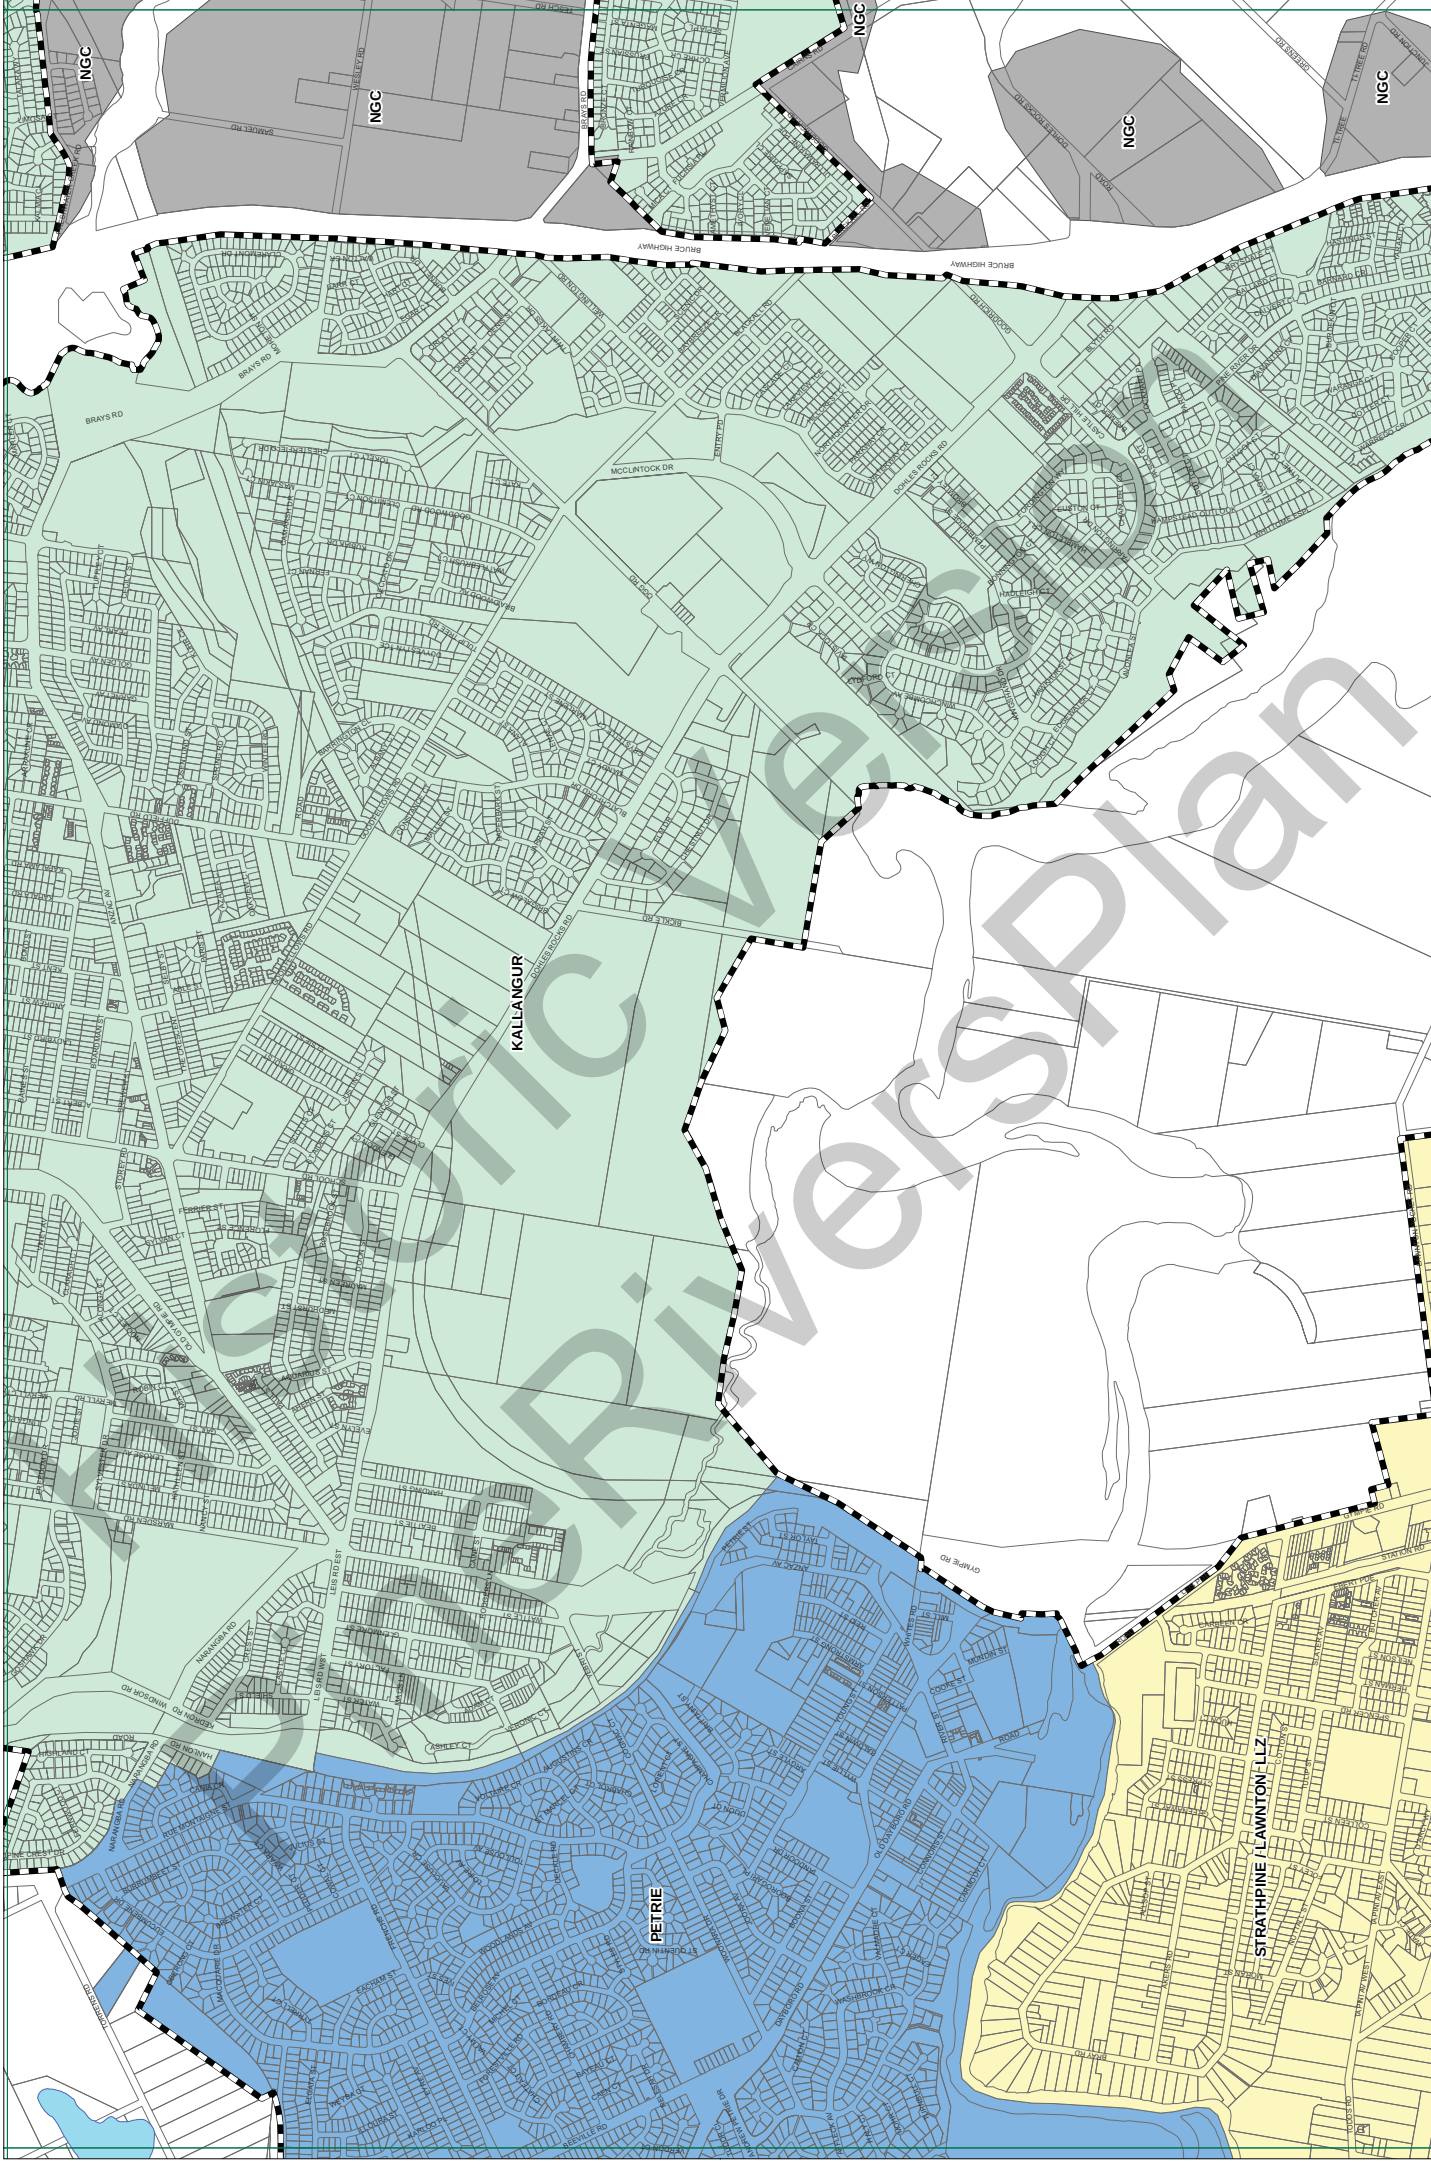

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water.
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details are for general information only and are not to be used for legal purposes. Moreton Bay Regional Council gives no warranty or guarantee of accuracy or completeness. Users of this map should be aware that the map is a representation of the current state of affairs and is subject to change without notice. Moreton Bay Regional Council is not responsible for any loss or damage arising from the use of this map.

0 62.5 125 250 375 500
Metres

Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright © The State of Queensland
2006

Copyright Pine Rivers Shire Council 2006

Regional Water Catchments Local Water Catchments

- DAYBORO
- PINE CENTRAL
- EATONS HILL HLZ
- PETRIE
- SAMFORD
- NORTH LAKES
- ALBANY CREEK HLZ
- HILLS HLZ
- HILLS LLZ
- CLEAR MOUNTAIN HLZ
- KALLANGUR
- DAYBORO
- STRATHPINE / LAWNTON LLZ

Planning Scheme Policy PSP22



DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER

EFFECTIVE FROM 29 October 2009

9.9	9.11	9.13
11.9	11.11	11.13
13.9	13.11	13.13

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS


Map Number 11.11

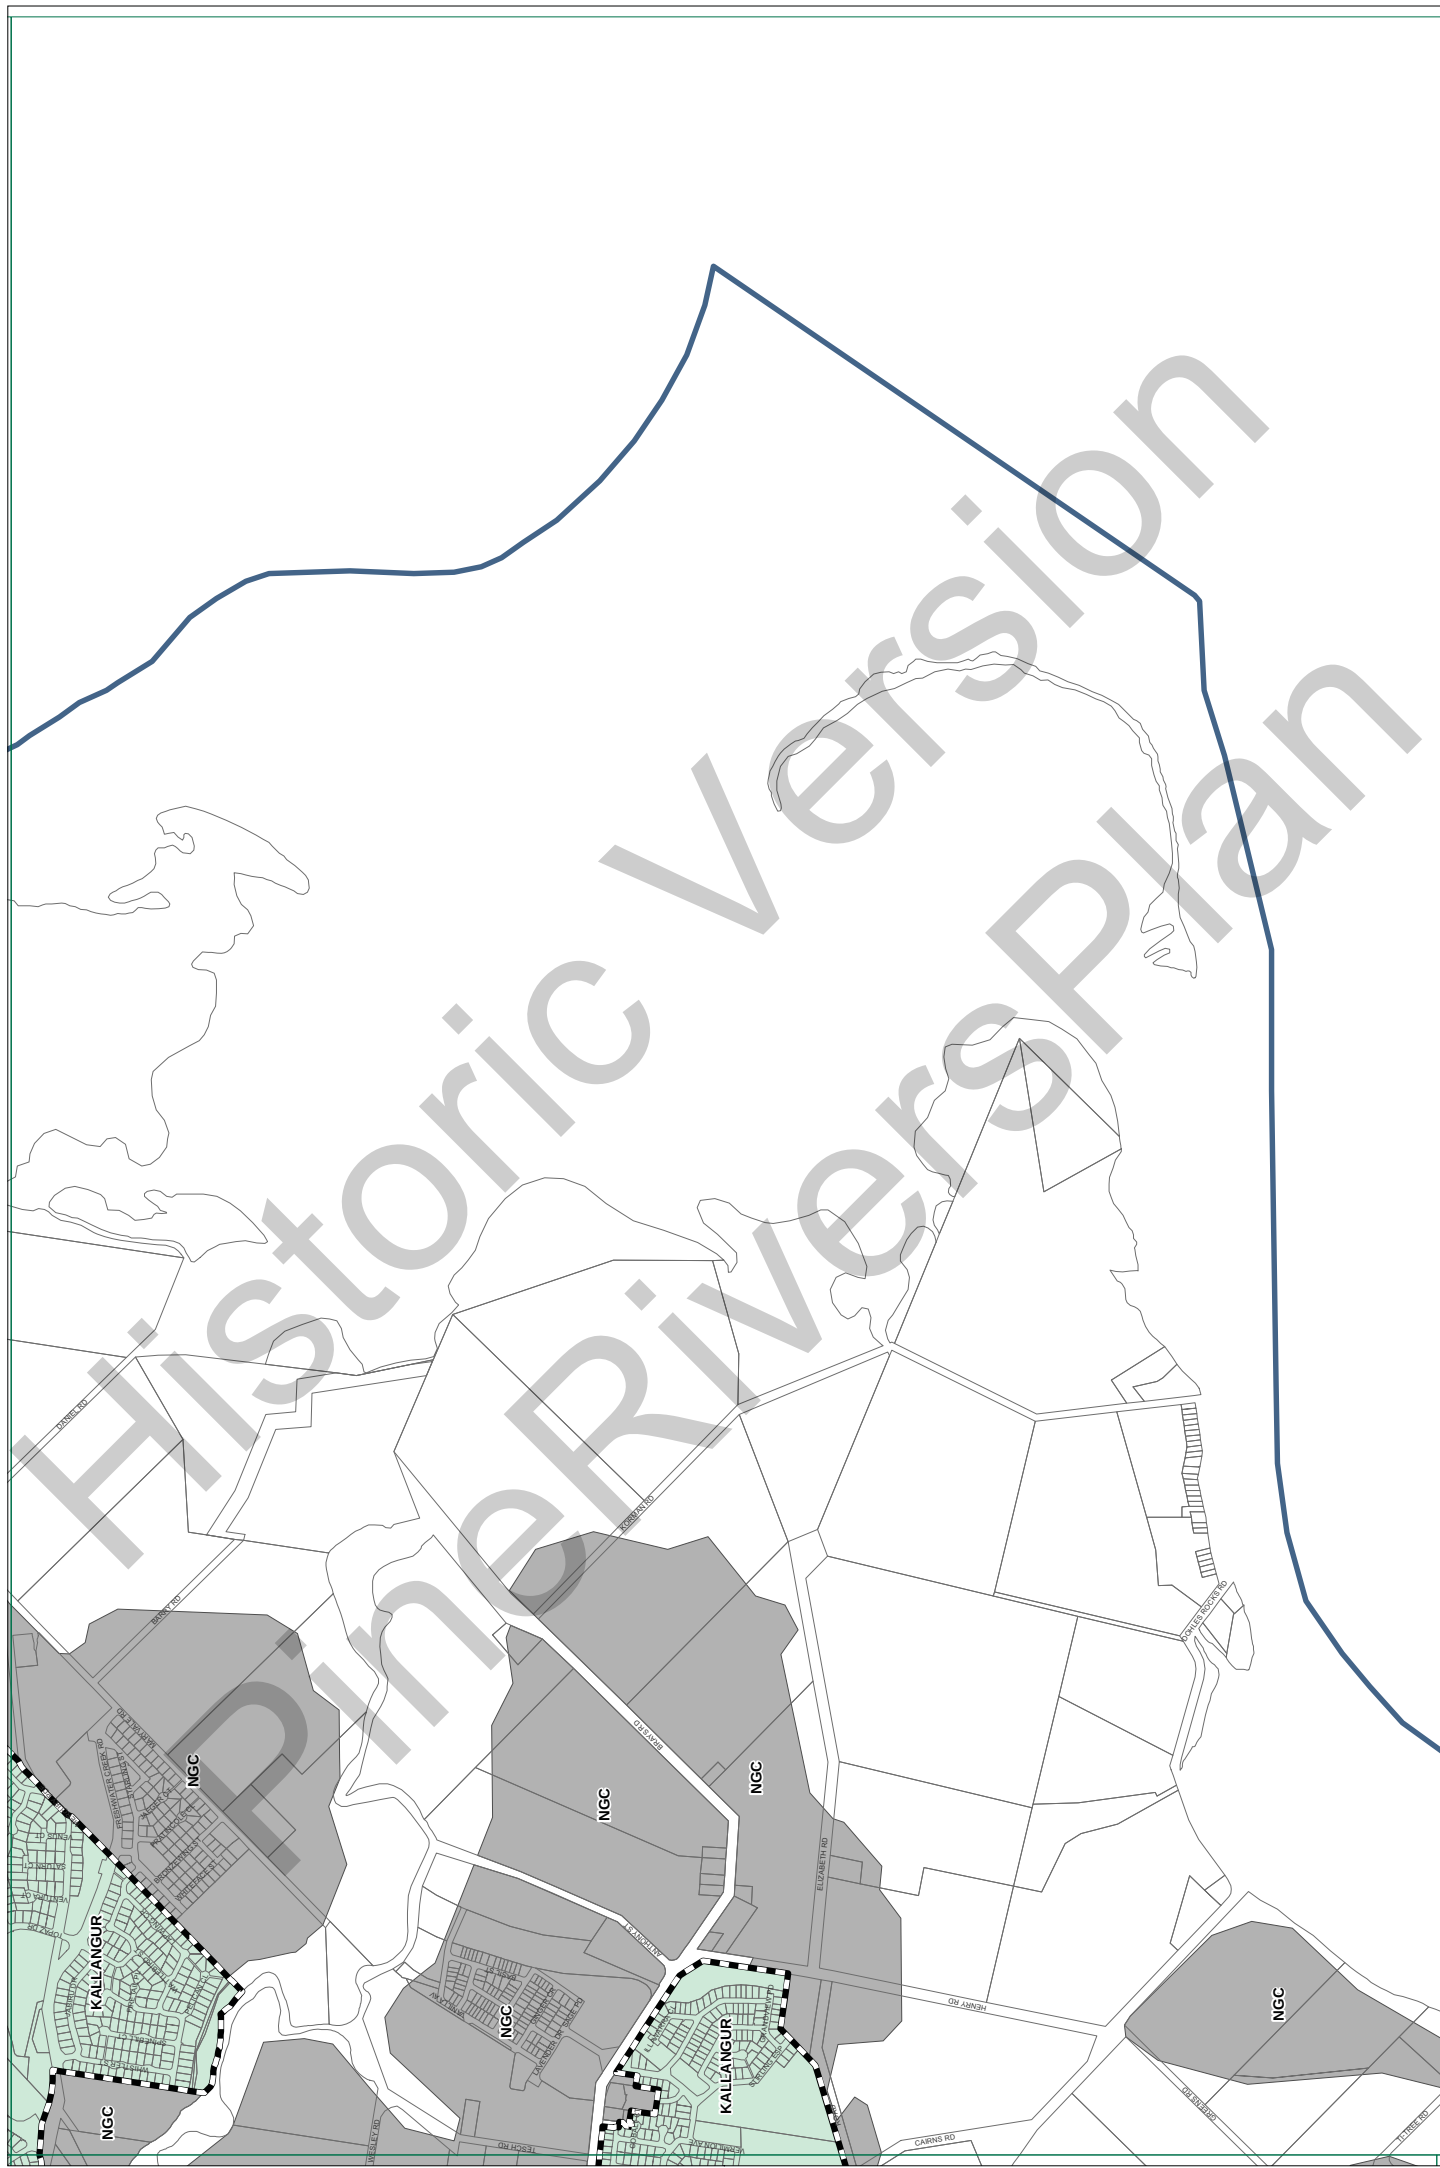

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details are
supplied from information contained in the Council's records which may have been furnished
to the Council by other persons. Moreton Bay Regional Council gives no warranty or guarantee of
any third expressed, implied, or statutory, to the completeness or accuracy of the map details or the
technical or legal implications with any Council standards in this matter. Persons making decisions with
financial or legal implications must not rely upon the map details shown on the plan for the purpose
of determining any part of their legal rights or obligations. Moreton Bay Regional
Council will not be held responsible for any loss or damage
suffered as a result of reliance upon this information.


Regional Water Catchment
DAYBORO
PINE CENTRAL

■ NORTH LAKES
■ PETRIE
■ SAMFORD
■ SAMFORD DOWNS
■ STRATHPINE / LAWNTON LLZ





11.11	11.13
13.11	13.13

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009


[illegible]

Regional Water Catchment
DAYBORO
PINE CENTRAL



PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS

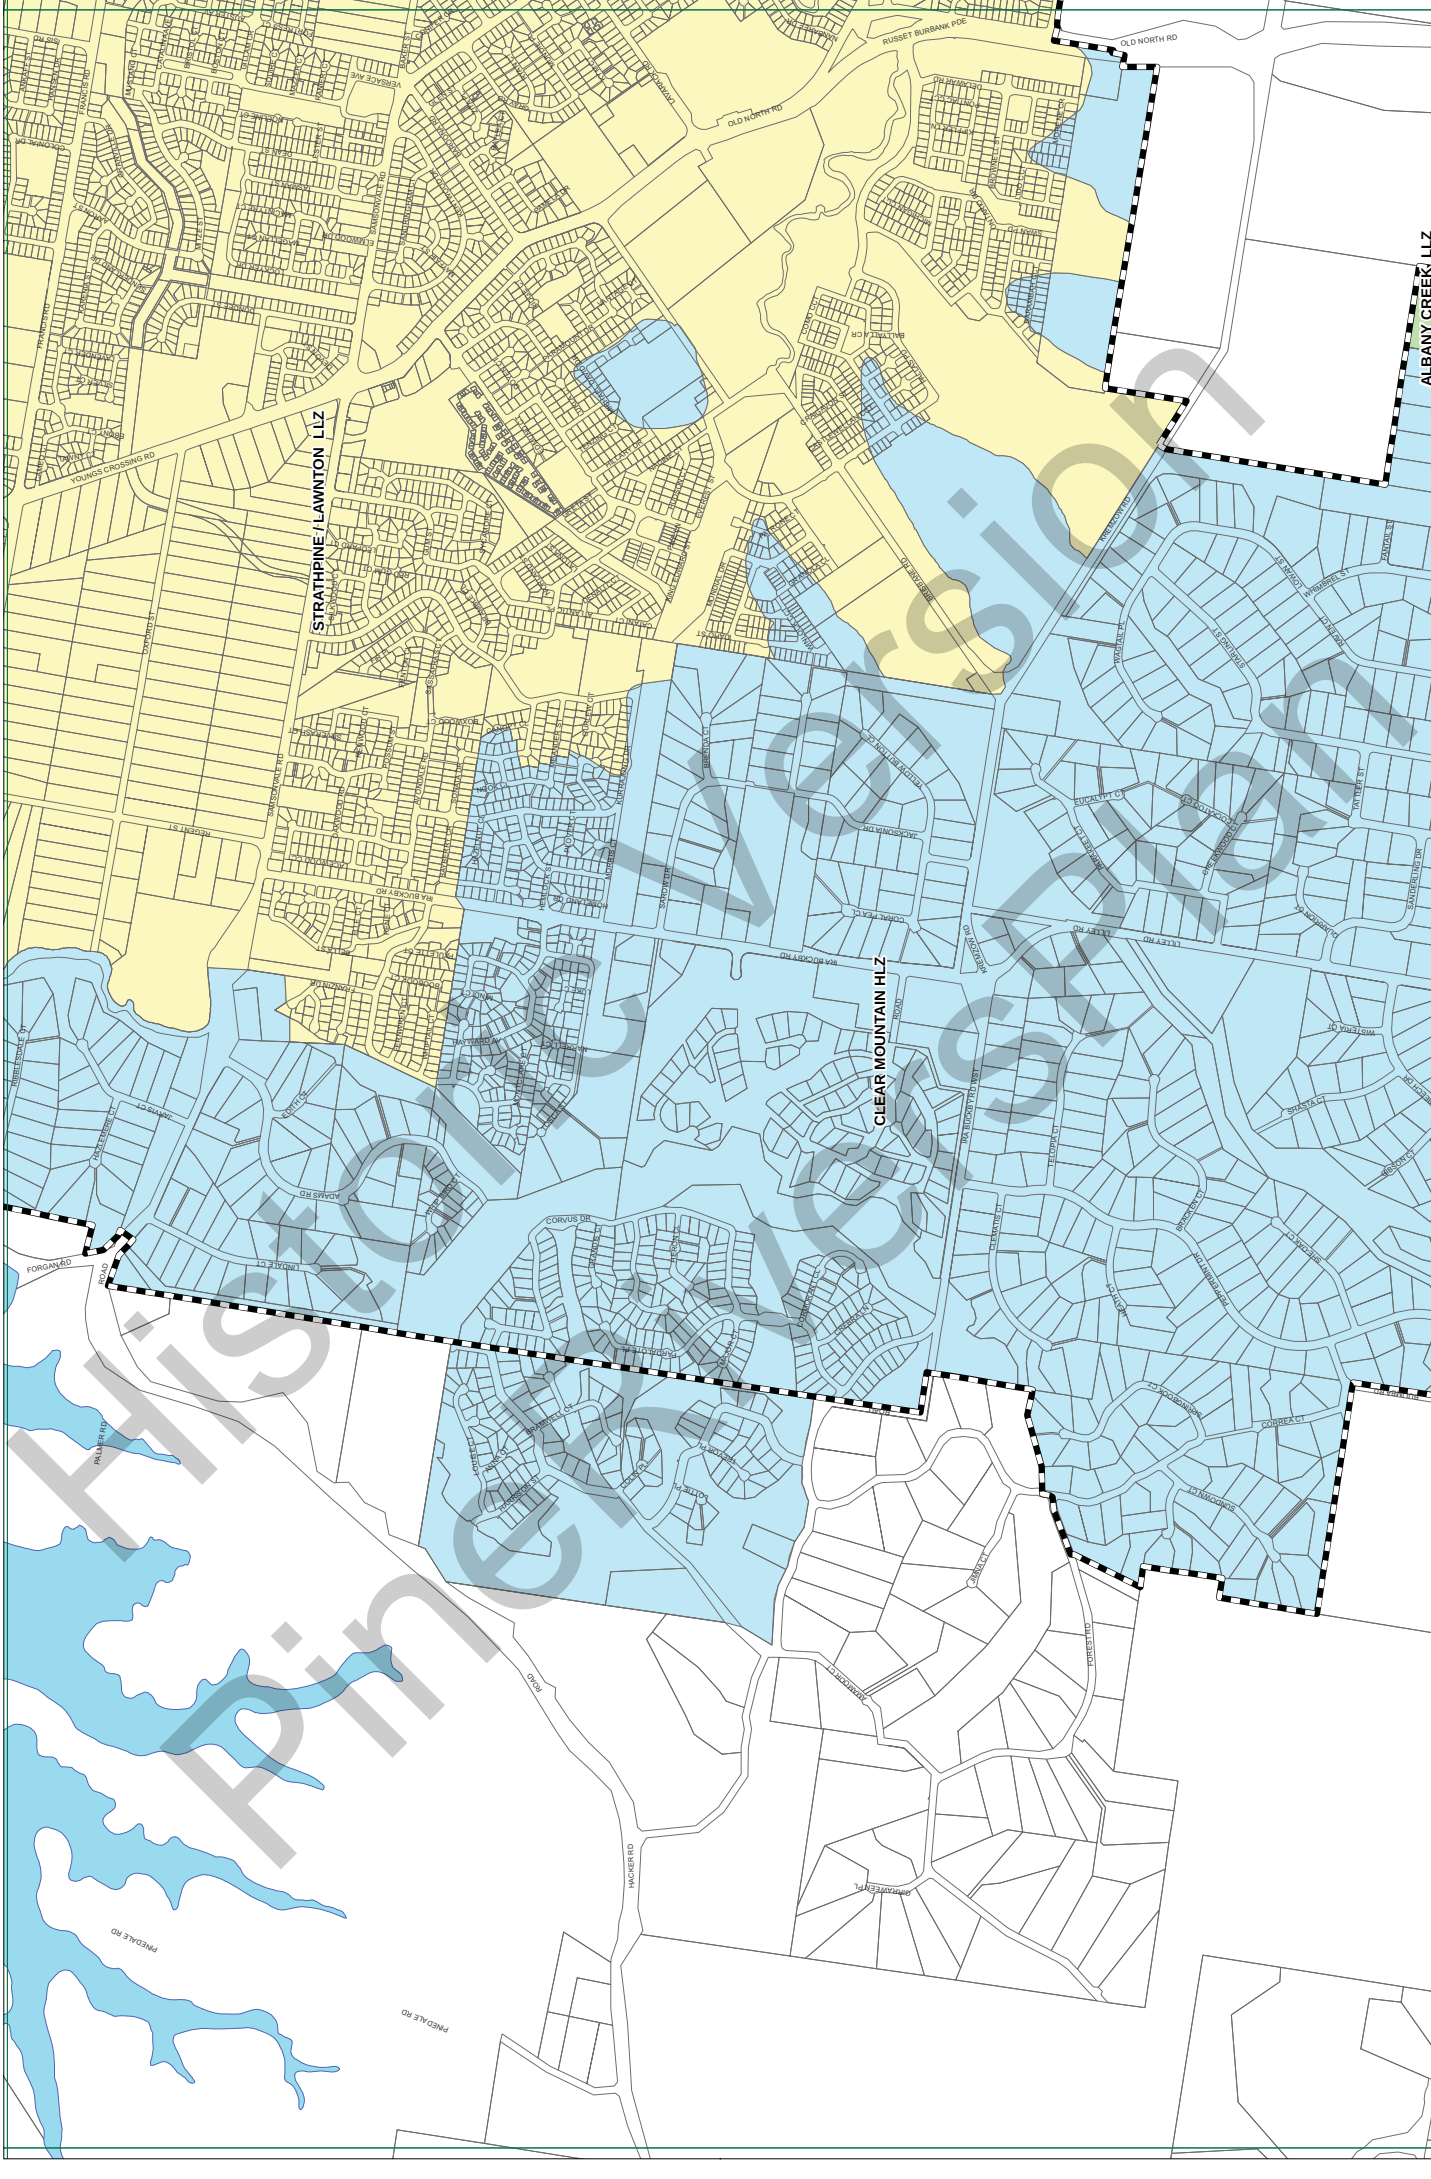


0 62.5 125 250 375 500
Metres

Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water.
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and do not constitute a warranty or guarantee of accuracy.
No liability is accepted by the Council for any errors or omissions. Mapping details are provided
to the Council by other persons. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness for any use other than for general information. Mapping details are
provided on the condition that they are not to be used for any purpose other than for general
information and that the user agrees to indemnify the Council (and its officers and agents) against all liability for any loss or damage
caused by the use of the map.

Regional Water Catchments
DAYBORO
PINE CENTRAL



- EATONS HILL HLZ
- ALBANY CREEK HLZ
- ALBANY CREEK HLZ
- CLEAR MOUNTAIN HLZ
- DAYBORO
- NORTH LAKES
- PETRIE
- SAMFORD
- HILLS HLZ
- HILLS HLZ
- KALLANGUR
- NGC



11.7	11.9	11.11
13.7	13.9	13.11
15.7	15.9	15.11

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009


MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS
Map Number 13.9

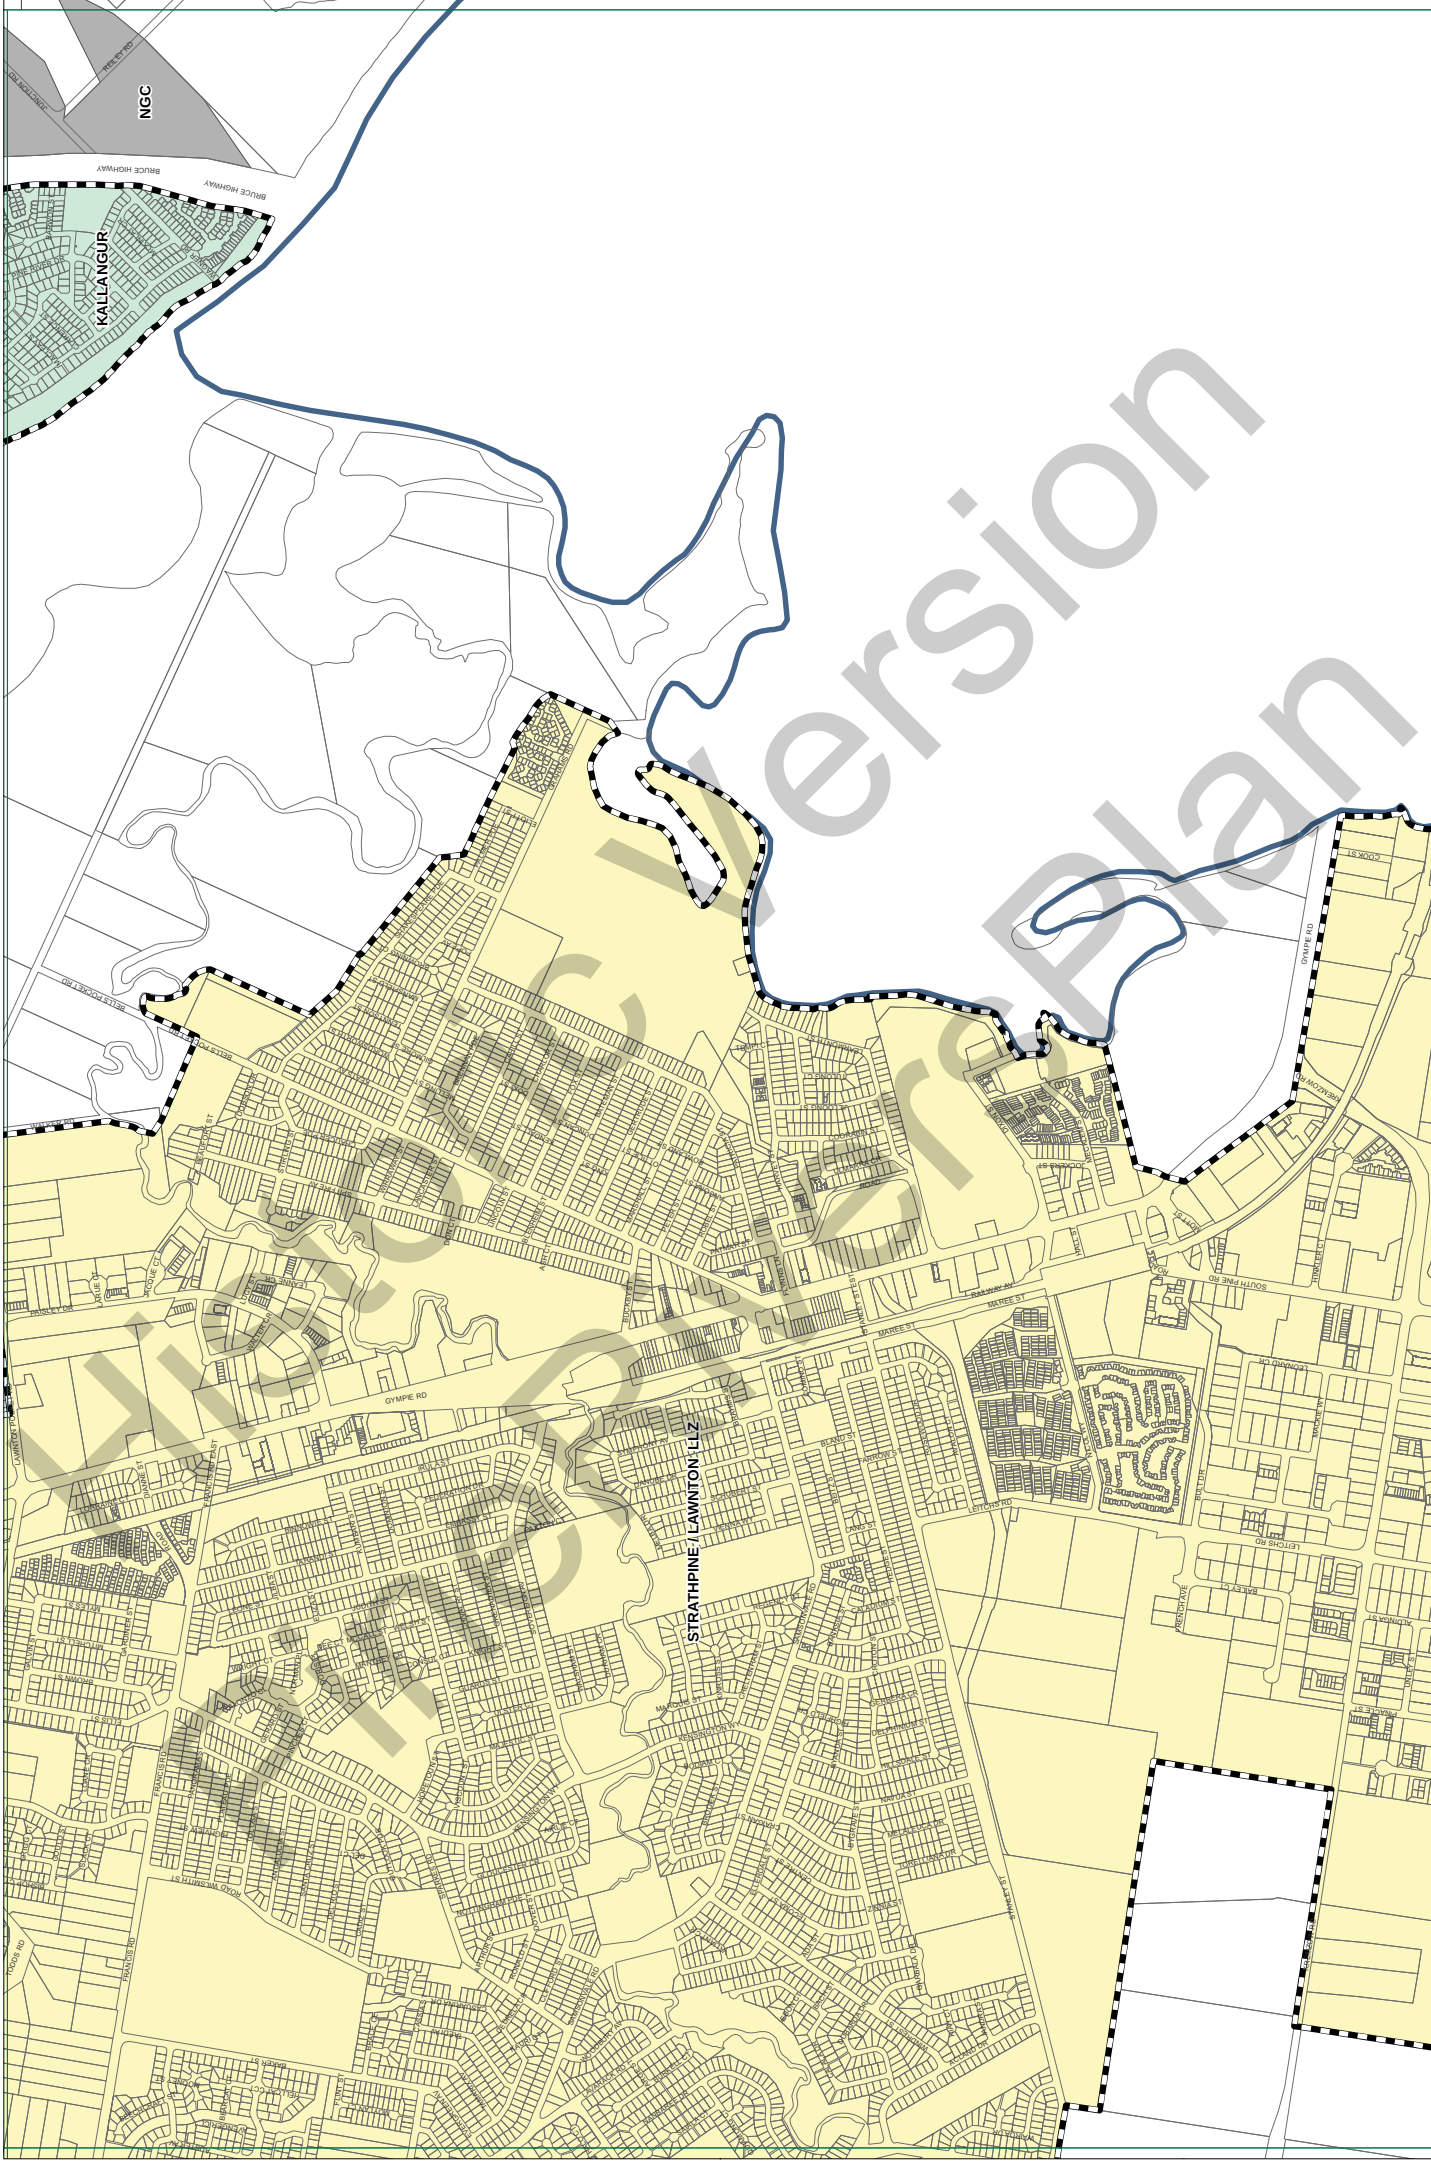

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water. Moreton Bay Regional Council supplies this map under the following conditions: Mapping details are for general information only and are not to be used for any purpose other than that for which they were prepared. Moreton Bay Regional Council gives no warranty or guarantee of accuracy or completeness. Users of this map should be aware that the map is not a legal document and should not be used as such. Moreton Bay Regional Council is not responsible for any loss or damage arising from the use of this map. Users should consult the relevant legislation and regulations for the correct interpretation of this map. Users should also be aware that the map is not a legal document and should not be used as such. Users should consult the relevant legislation and regulations for the correct interpretation of this map. Users should also be aware that the map is not a legal document and should not be used as such. Users should consult the relevant legislation and regulations for the correct interpretation of this map.



Regional Water Catchments Local Water Catchments
DAYBORO
PINE CENTRAL
EATONS HILL HLZ
ALBANY CREEK HLZ
ALBANY CREEK HLZ
CLEAR MOUNTAIN HLZ
DAYBORO

NORTH LAKES
PETRIE
SAMFORD
SAMFORD DOWNS
STRATHPINE / LAWNTON LLZ
KALLANGUR
NGC




11.9	11.11	11.13
13.9	13.11	13.13
15.9	15.11	

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

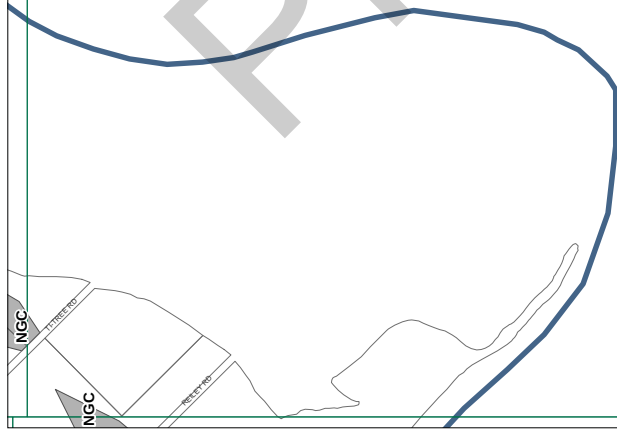


Copyright Morone Bay Regional Council and Department of Natural Resources and Water
Morone Bay Regional Council supplies this map under the following conditions: Mapping details are supplied from information contained in the Council's records which may have been furnished to the Council by other persons. Morone Bay Regional Council gives no warranty or guarantee of any kind, expressed or implied, or liability, to the correctness or accuracy of the map details or the degree of compliance with current map standards in this matter. Persons making decisions with financial or legal implications must not rely upon the map details shown on this plan for the purpose of determining whether any particular facts or circumstances exist and the Morone Bay Regional Council (and its officers and agents) expressly disclaims responsibility for any injury or damage.



11.11	11.13
13.11	13.13

PLANNING SCHEME POLICY PSP2222
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS

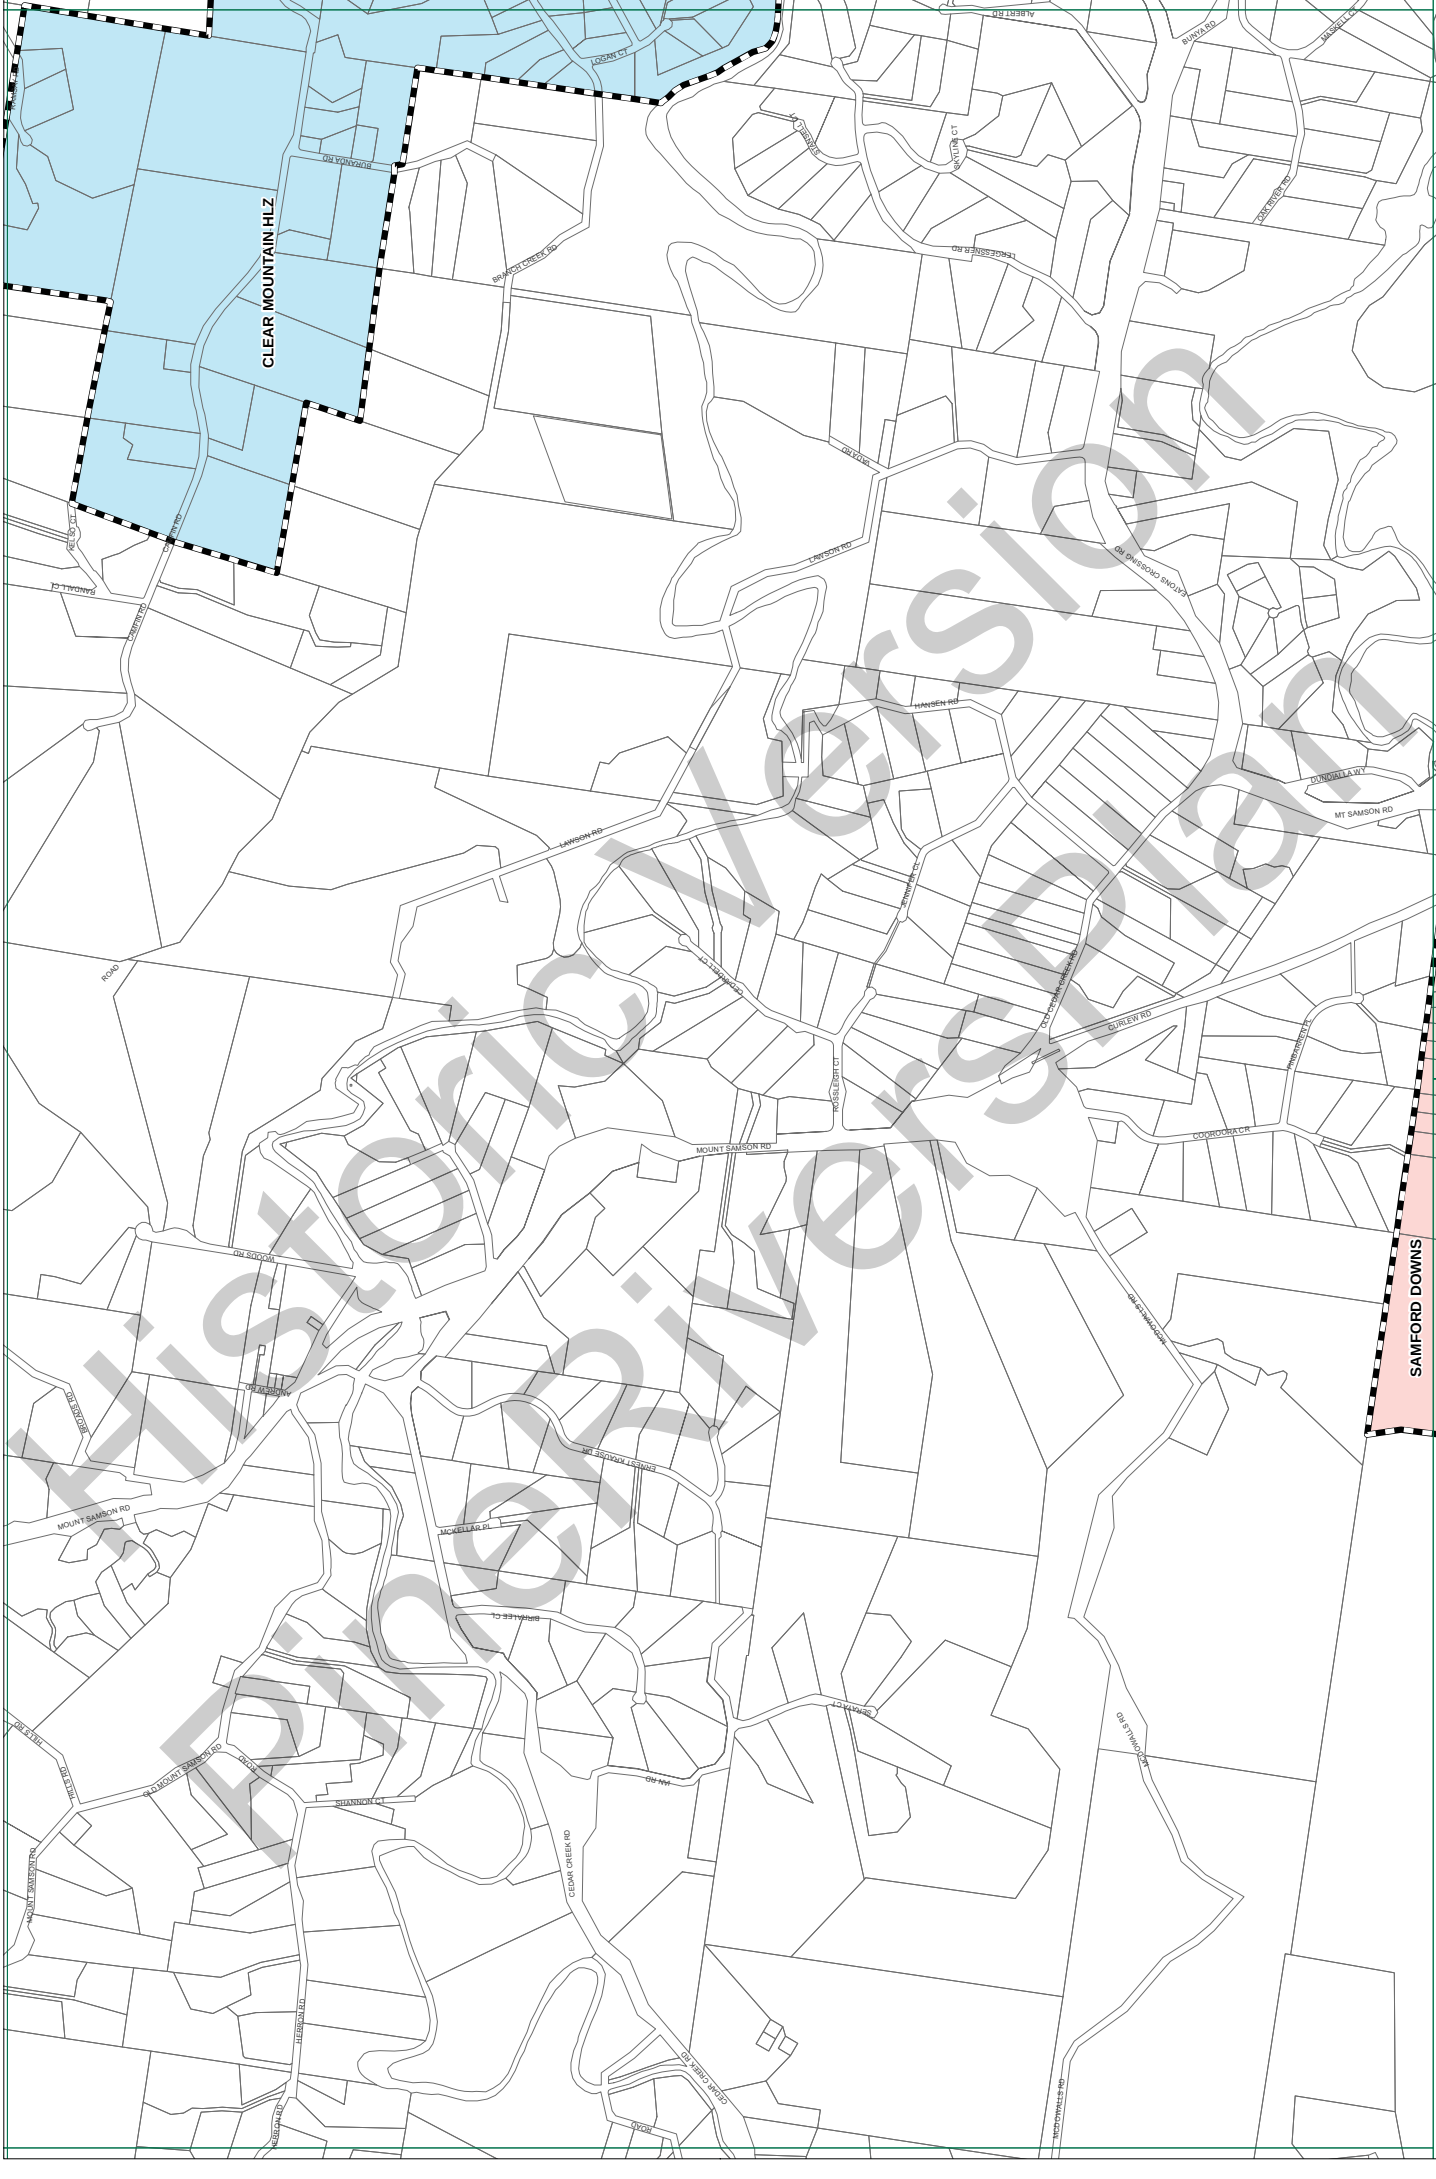

0 62.5 125 250 375 500
Metres

Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland 2006
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water.
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and do not constitute a warranty or guarantee of accuracy.
The Council is not responsible for any errors or omissions. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness. Moreton Bay Regional Council is not responsible for any errors or omissions.
Persons making decisions with
reference to map information must rely upon the map details shown on the plan for the purpose
intended. Council and its officers and agents expressly disclaim responsibility for any loss or damage
resulting from reliance on this map information.


Regional Water Catchments Local Water Catchments

DAYBORO

PINE CENTRAL

Local Water Catchments

- ALBANY CREEK HLZ
- CLEAR MOUNTAIN HLZ
- DAYBORO
- EATONS HILL HLZ
- HILLS HLZ
- HILLS CREEK HLZ
- KALLANGUR
- NGC
- NORTH LAKES
- PETRIE
- SAMFORD
- SAMFORD DOWNS
- STRATHPINE / LAWINTON / LLZ



13.5	13.7	13.9
15.5	15.7	15.9
17.4	17.6	17.8

PLANNING SCHEME POLICY PSP22

DEVELOPMENT CONTRIBUTIONS

FOR TRUNK INFRASTRUCTURE -

WATER


EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL

Pine Rivers Shire

WATER SUPPLY SERVICE CATCHMENTS

Map Number 15.7

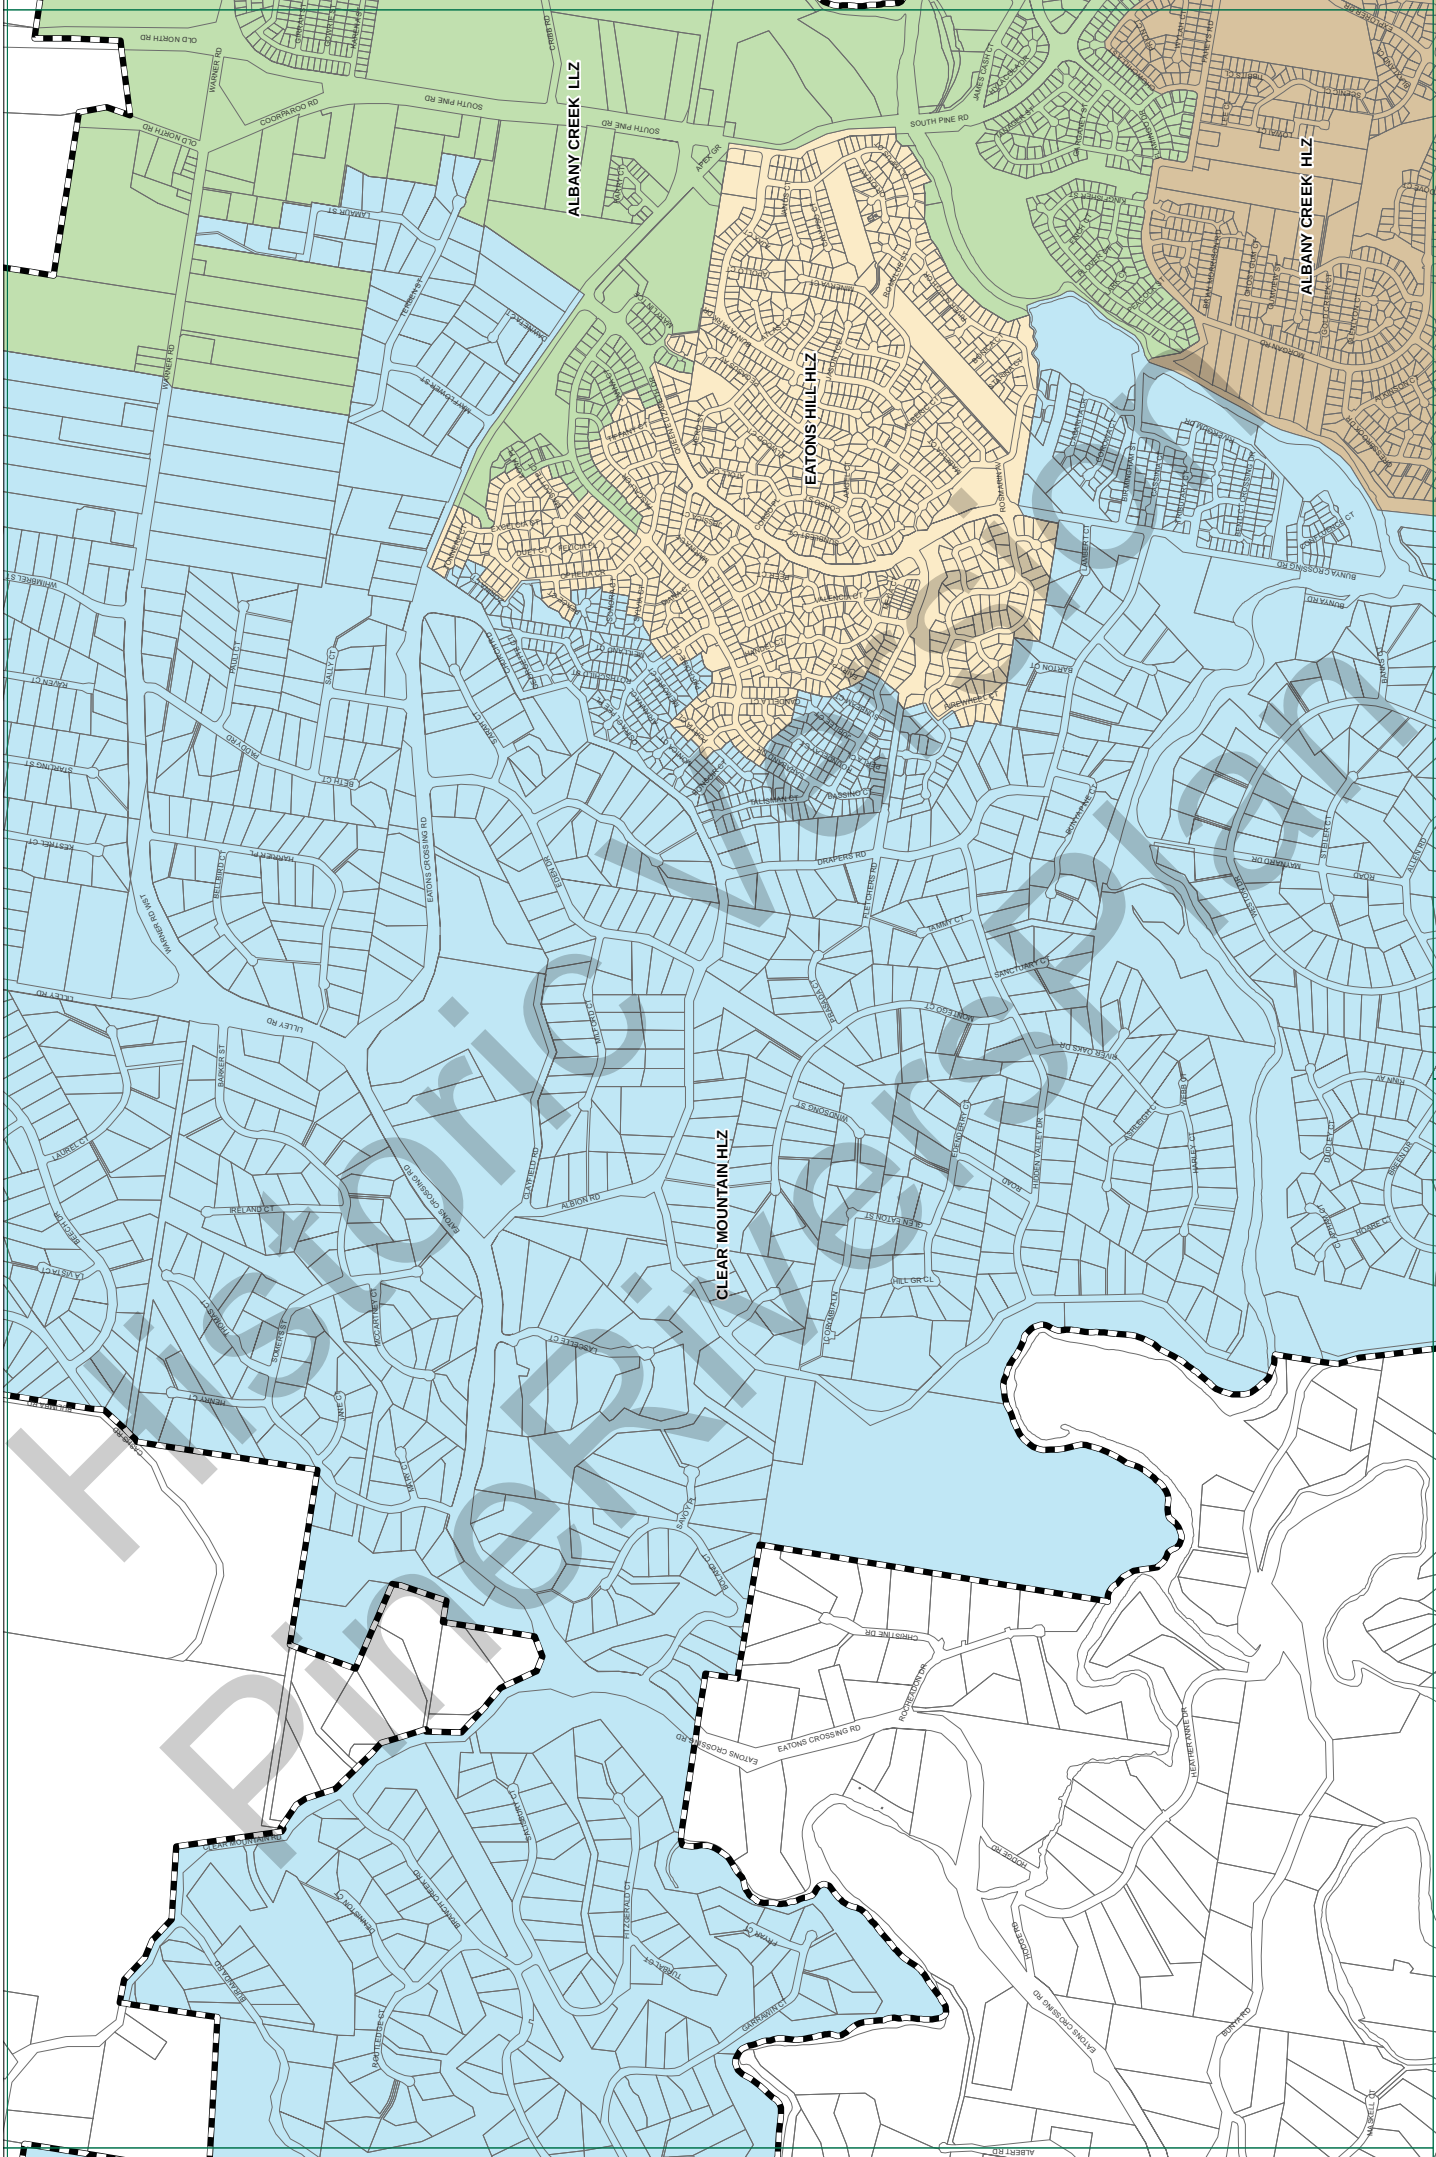

0 62.5 125 250 375 500
Metres

Base material sourced from the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006


Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only. Council does not warrant or guarantee the accuracy of the map
to the Council or other persons. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness to the map. Council is not responsible for any loss or damage arising from
any use of the map. Council is not responsible for any loss or damage arising from the use of the map.
Council (and its officers and agents) expressly disclaims responsibility for any loss or damage
arising from the use of the map.

Regional Water Catchments Local Water Catchments

DAYBORO



PINE CENTRAL

- EATONS HILL HLZ
- ALBANY CREEK HLZ
- HILLS HLZ
- ALBANY CREEK HLZ
- CLEAR MOUNTAIN HLZ
- DAYBORO
- NORTH LAKES
- PETRIE
- SAMFORD
- HILLS HLZ
- KALLANGUR
- NGC
- STRATHPINE / LAWINTON HLZ



13.7	13.9	13.11
15.7	15.9	15.11
17.6	17.8	17.10

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

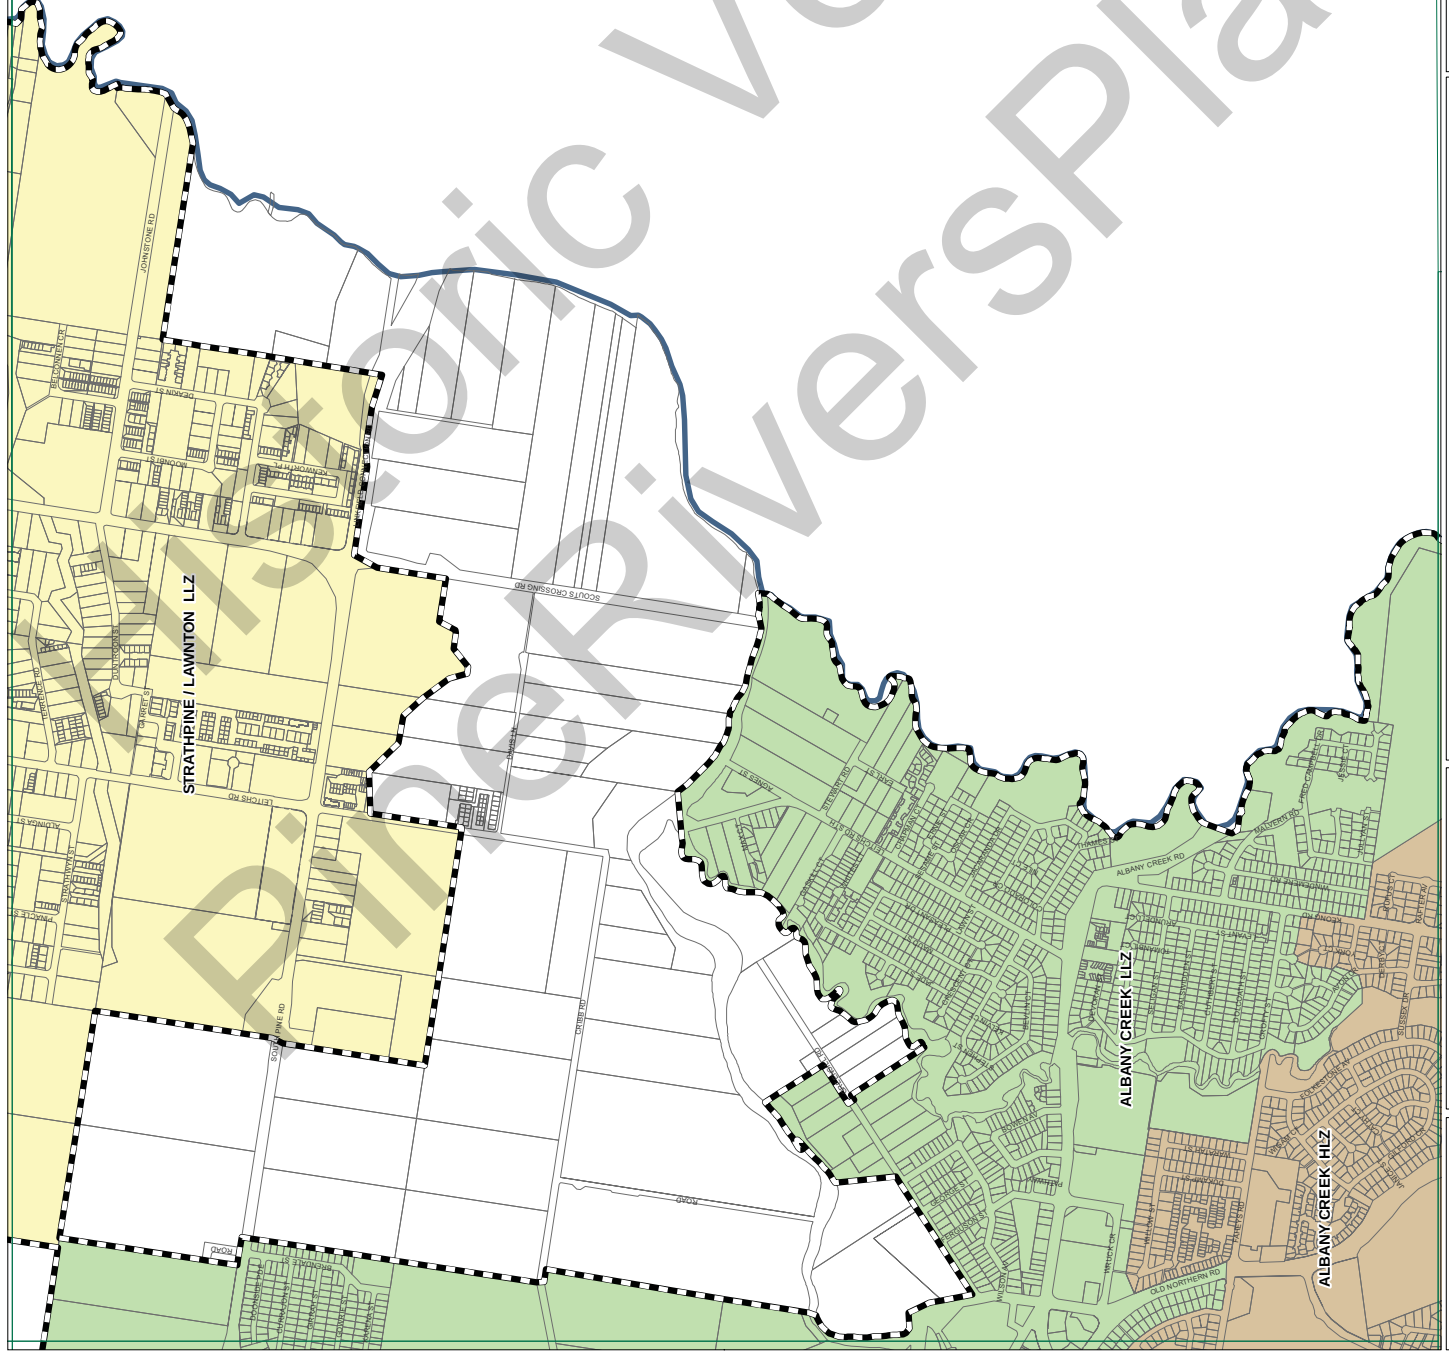


Copyright Moriton Bay Regional Council and Department of Natural Resources and Water
No part of this report may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of the Council. All rights reserved.
This report is the property of the Council. It is loaned to you for your personal use only. It is not to be distributed, copied, or otherwise used for any purpose other than that for which it was prepared. The Council assumes no responsibility for any loss or damage to the report or its contents, or for any delay in its delivery, or for any error or omission, or for any loss or damage to any property or person, or for any other liability, arising from the use of this report.

Regional Water Catchments Local Watersheds

DAYBORO **PINE CENTRAL**

EATONS HILL HILZ PETRIE
ALBANY CREEK HILZ HILLS HILZ
ALBANY CREEK HILZ HILLS HILZ
CLEAR MOUNTAIN HILZ KALLANGUR
DAYBORO NGC
SAMFORD DOWNS
STRATHPINE / LAWNTON LLZ




13.9	13.11	13.13
15.9	15.11	

PLANNING SCHEME POLICY PSP222
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS

Map Number 15.11

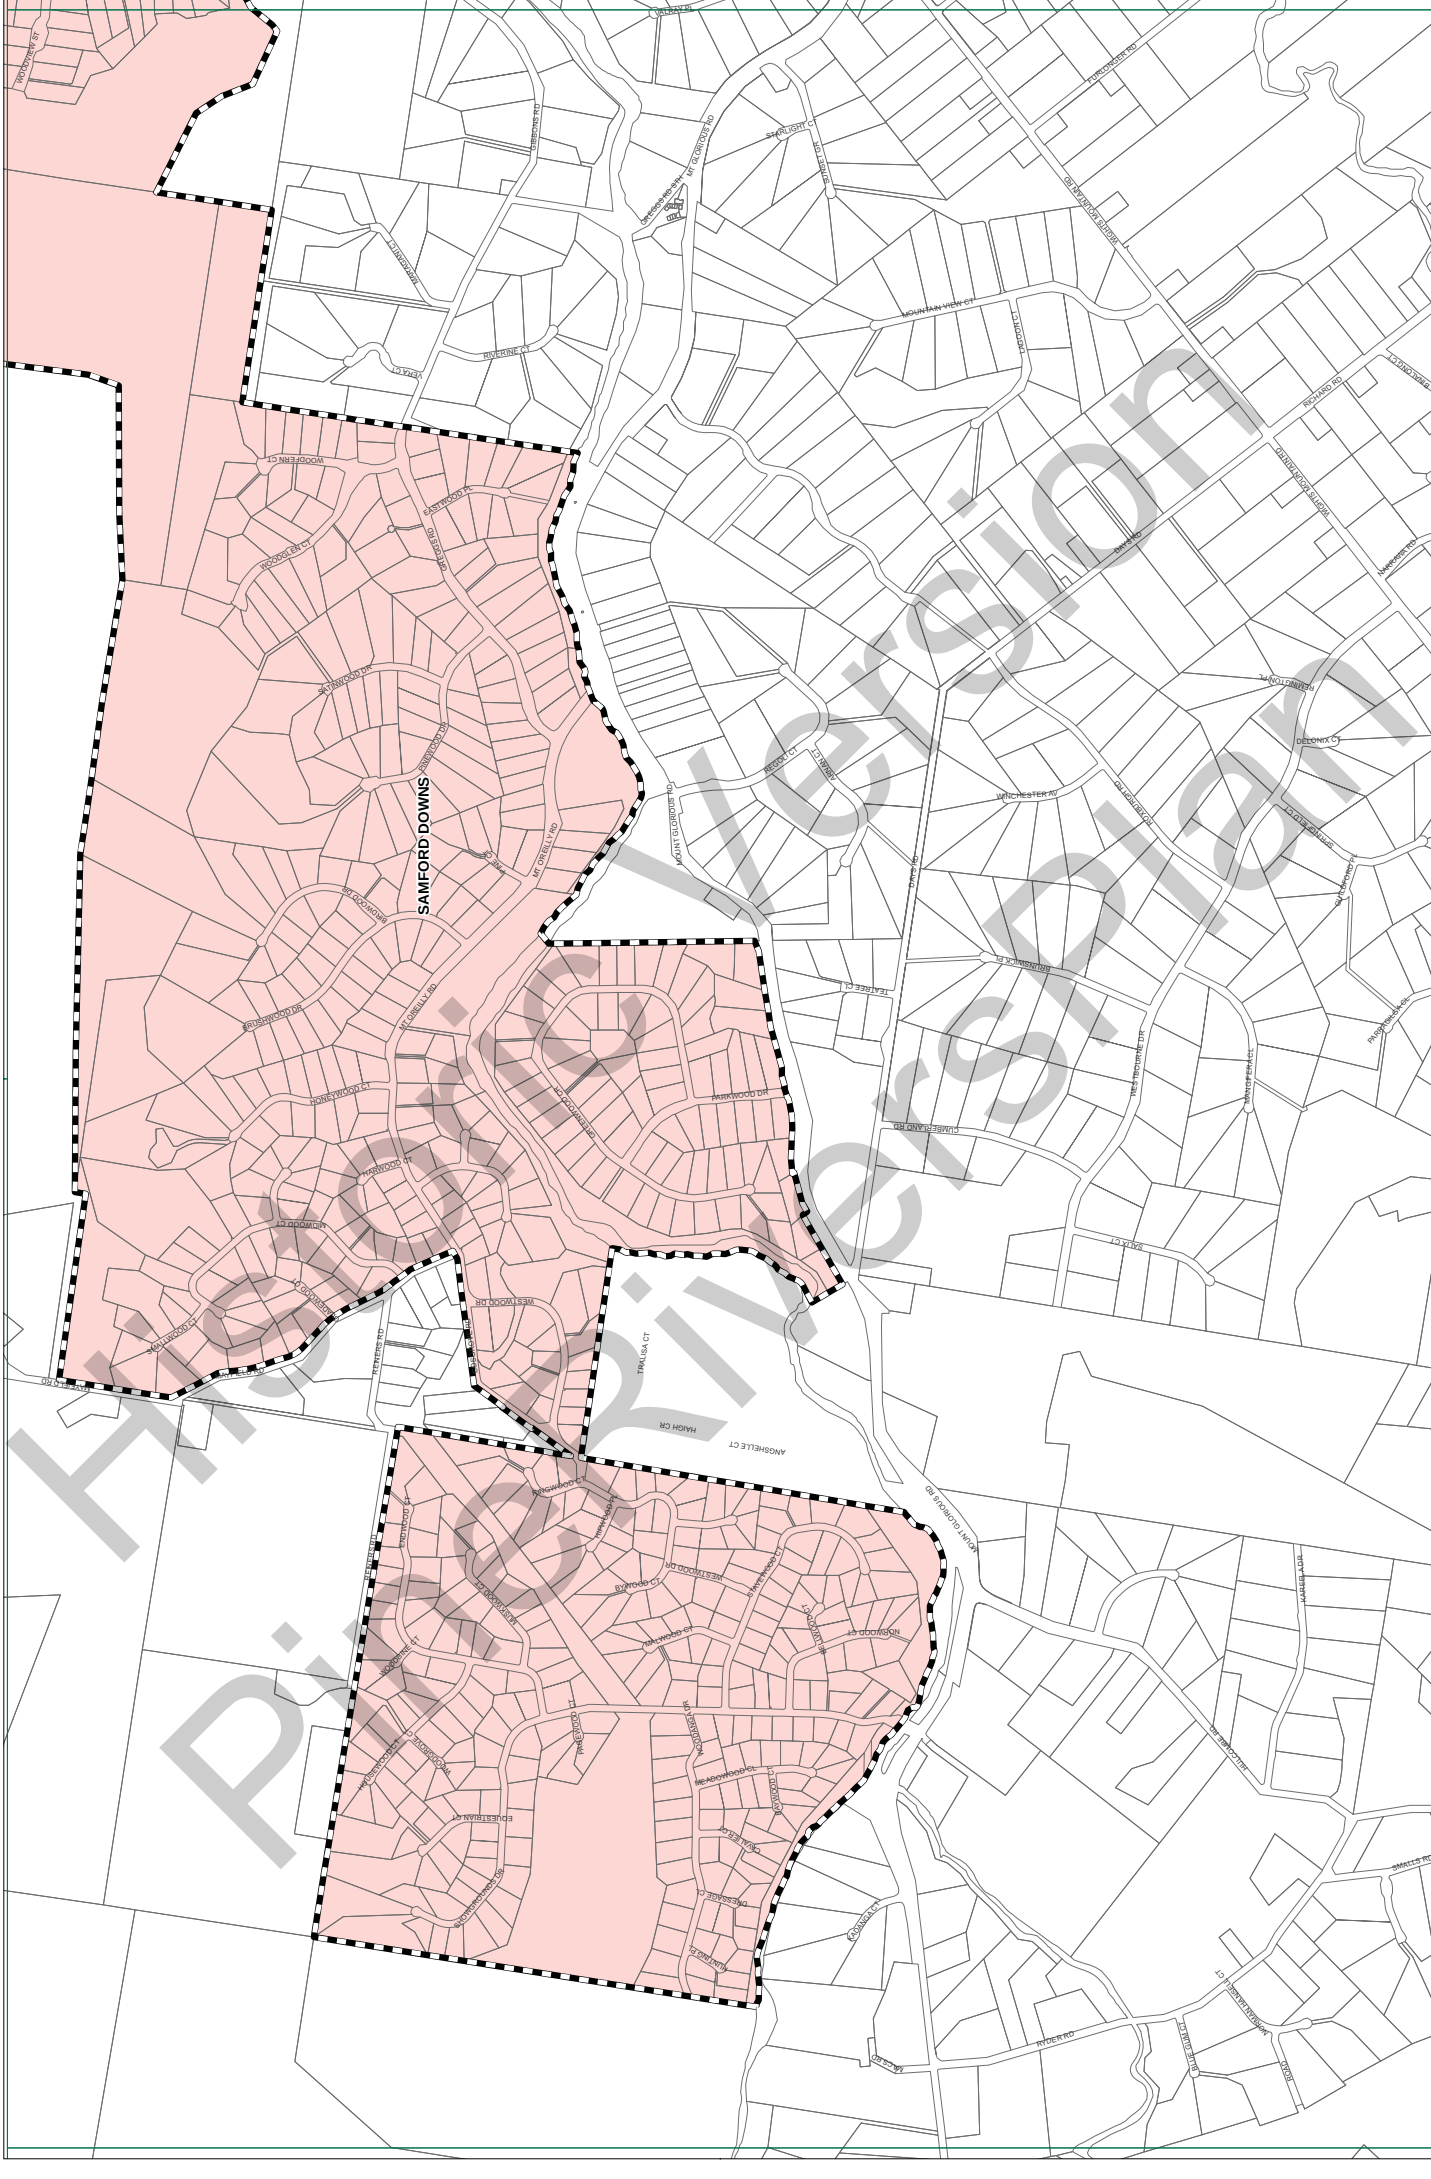

0 62.5 125 250 375 500
Metres


Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water.
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and do not constitute a warranty or guarantee of accuracy.
The Council is not responsible for any errors or omissions. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness. Moreton Bay Regional Council is not responsible for any errors or omissions.
Persons or organisations must not rely upon the map details shown on this map for the purpose
of making any decisions or taking any action. Moreton Bay Regional Council is not responsible for any errors or omissions.
Council (and its officers and agents) expressly disclaims responsibility for any loss or damage
caused by reliance upon the map details shown on this map.

Regional Water Catchments Local Water Catchments



DAYBORO **PINE CENTRAL**

- EATONS HILL HLZ
- PETRIE
- HILLS HLZ
- ALBANY CREEK HLZ
- ALBANY CREEK HLZ
- CLEAR MOUNTAIN HLZ
- DAYBORO
- NORTH LAKES
- SAMFORD
- SAMFORD DOWNS
- STRATHPINE / LAWINTON LLZ
- NGC
- KALLANGUR



15.3	15.5	15.7	15.9
17.4	17.6	17.8	18.0
19.4	19.6	19.8	20.0

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

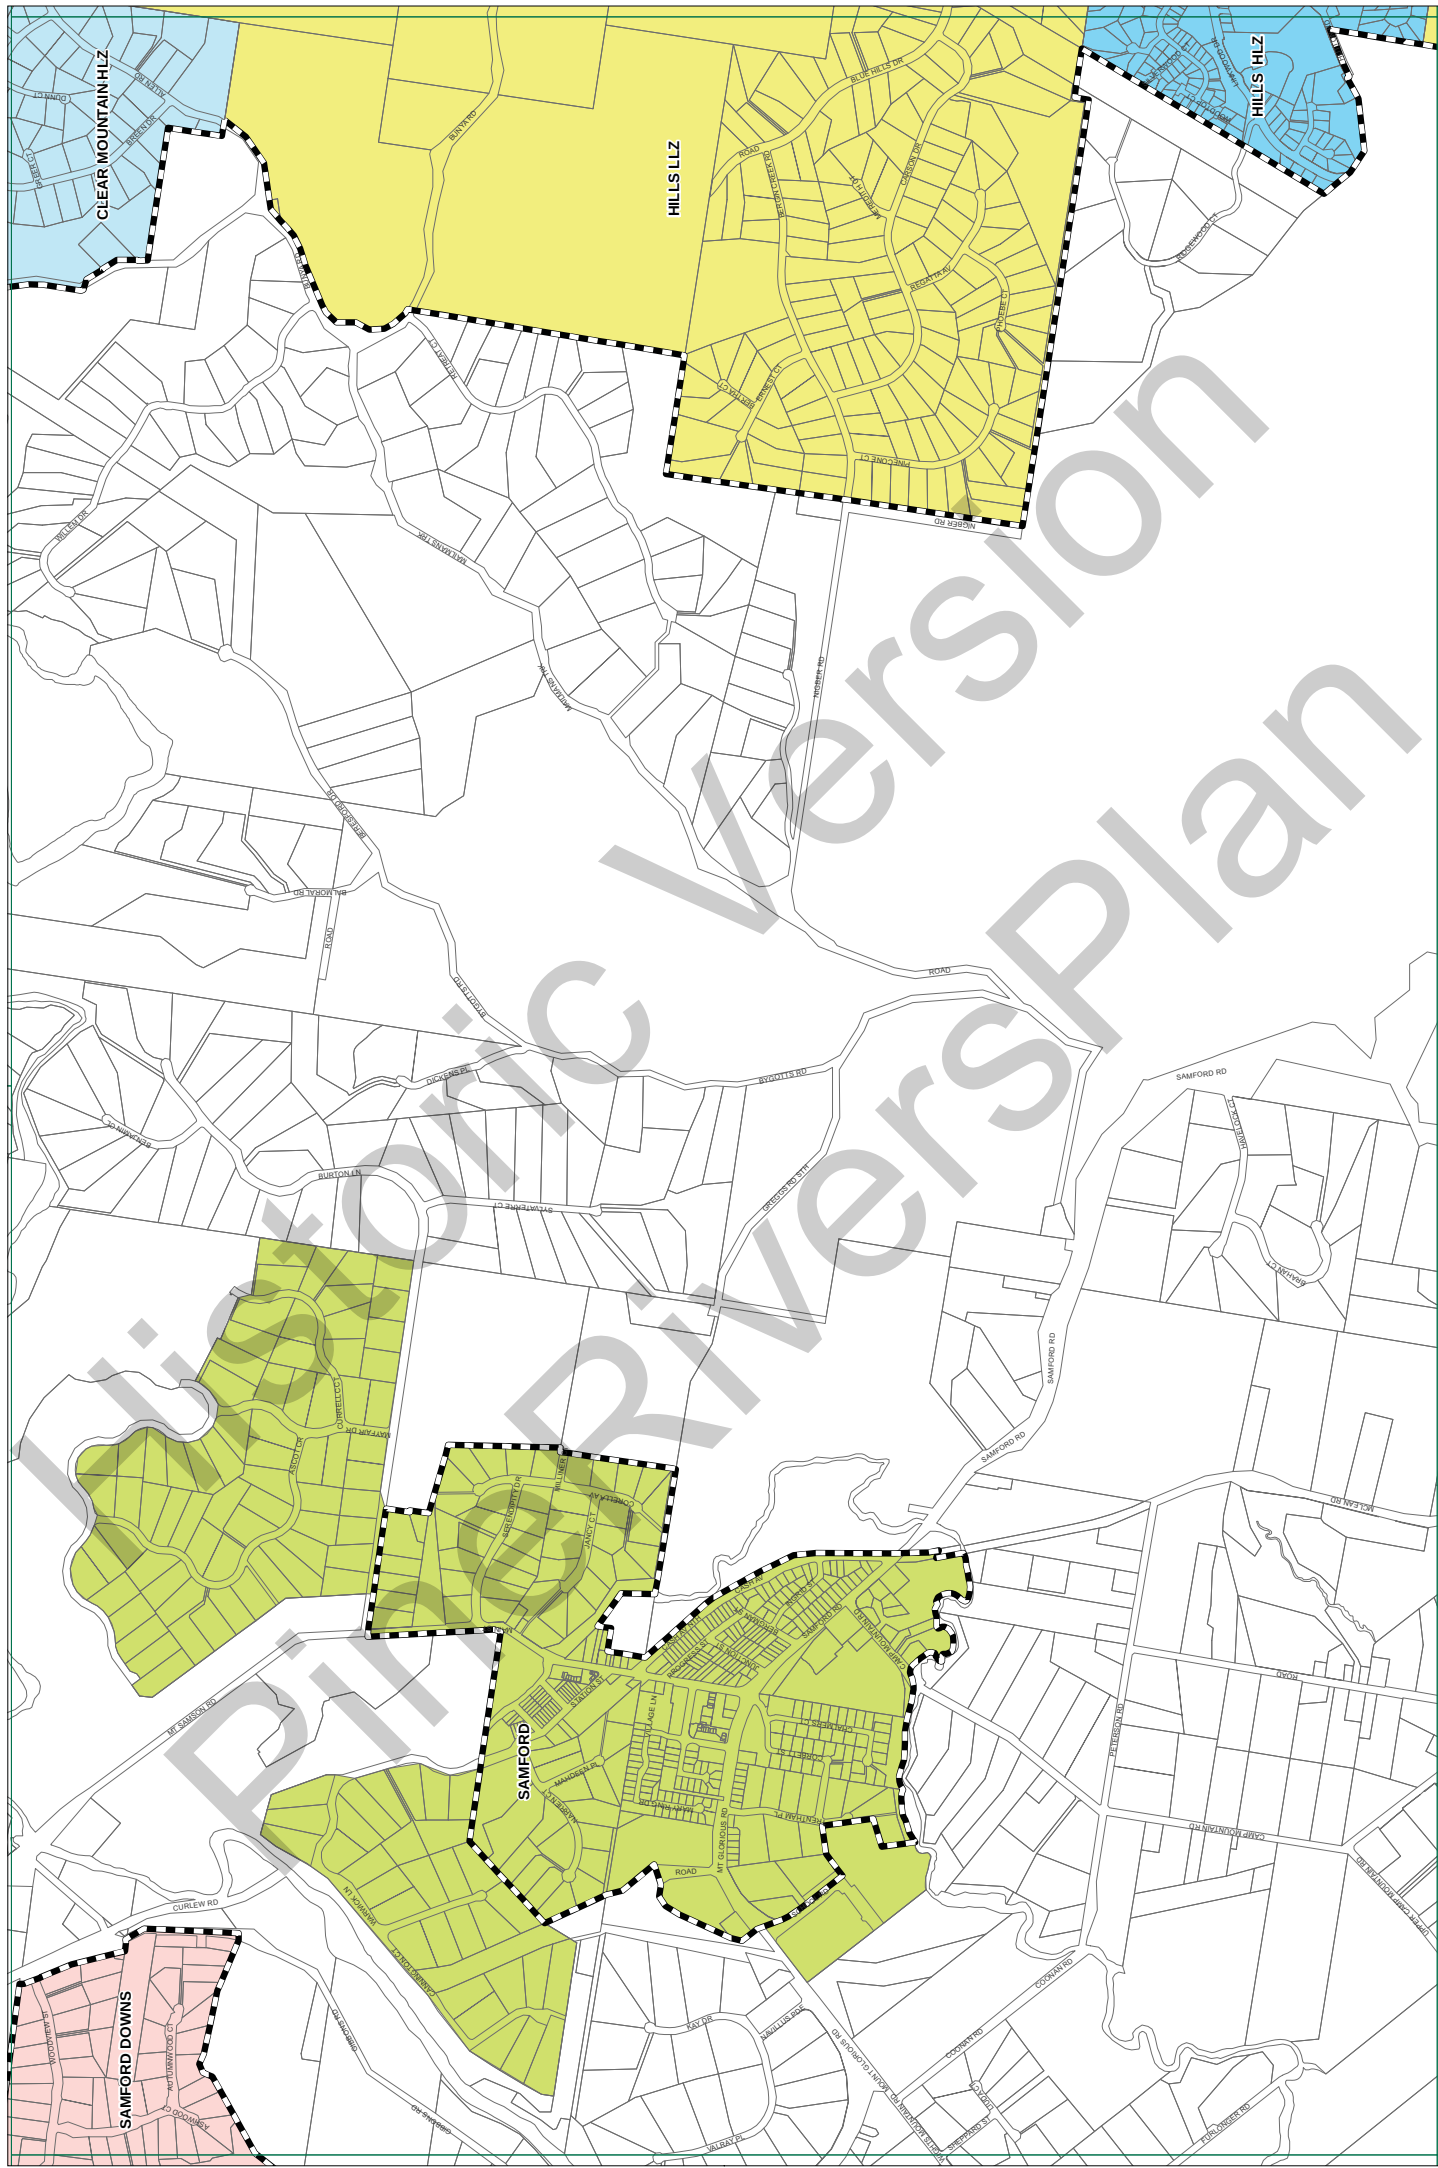


Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details are supplied from information contained in the Council's records which may have been furnished to the Council by other persons. Moreton Bay Regional Council gives no warranty or guarantee of any kind, expressed or implied, or liability, to the correctness or accuracy of the map details or the degree of compliance with any Council standards in this matter. Persons making decisions with financial or legal implications must not rely upon the map details shown on this plan for the purpose of determining whether any particular facts or circumstances arose and the Moreton Bay Regional Council (and its officers and agents) expressly disclaims responsibility for any injury or damage.

Regional Water Catchment
DAYBORO
PINE CENTRAL

Comments Local Water Catchments


	EATONS HILL HLZ		NORTH LAKES
	ALBANY CREEK HLZ		PETRIE
	HILLS HLZ		SAMFORD
	ALBANY CREEK LLZ		SAMFORD DOWNS
	HILLS LLZ		STRATHPINE / LAWINTON LLZ
	CLEAR MOUNTAIN HLZ		NGC
	DAYBORO		
	KALLANGUR		



15.5	15.7	15.9	
17.6	17.8	17.10	
19.6	19.8	19.10	

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS

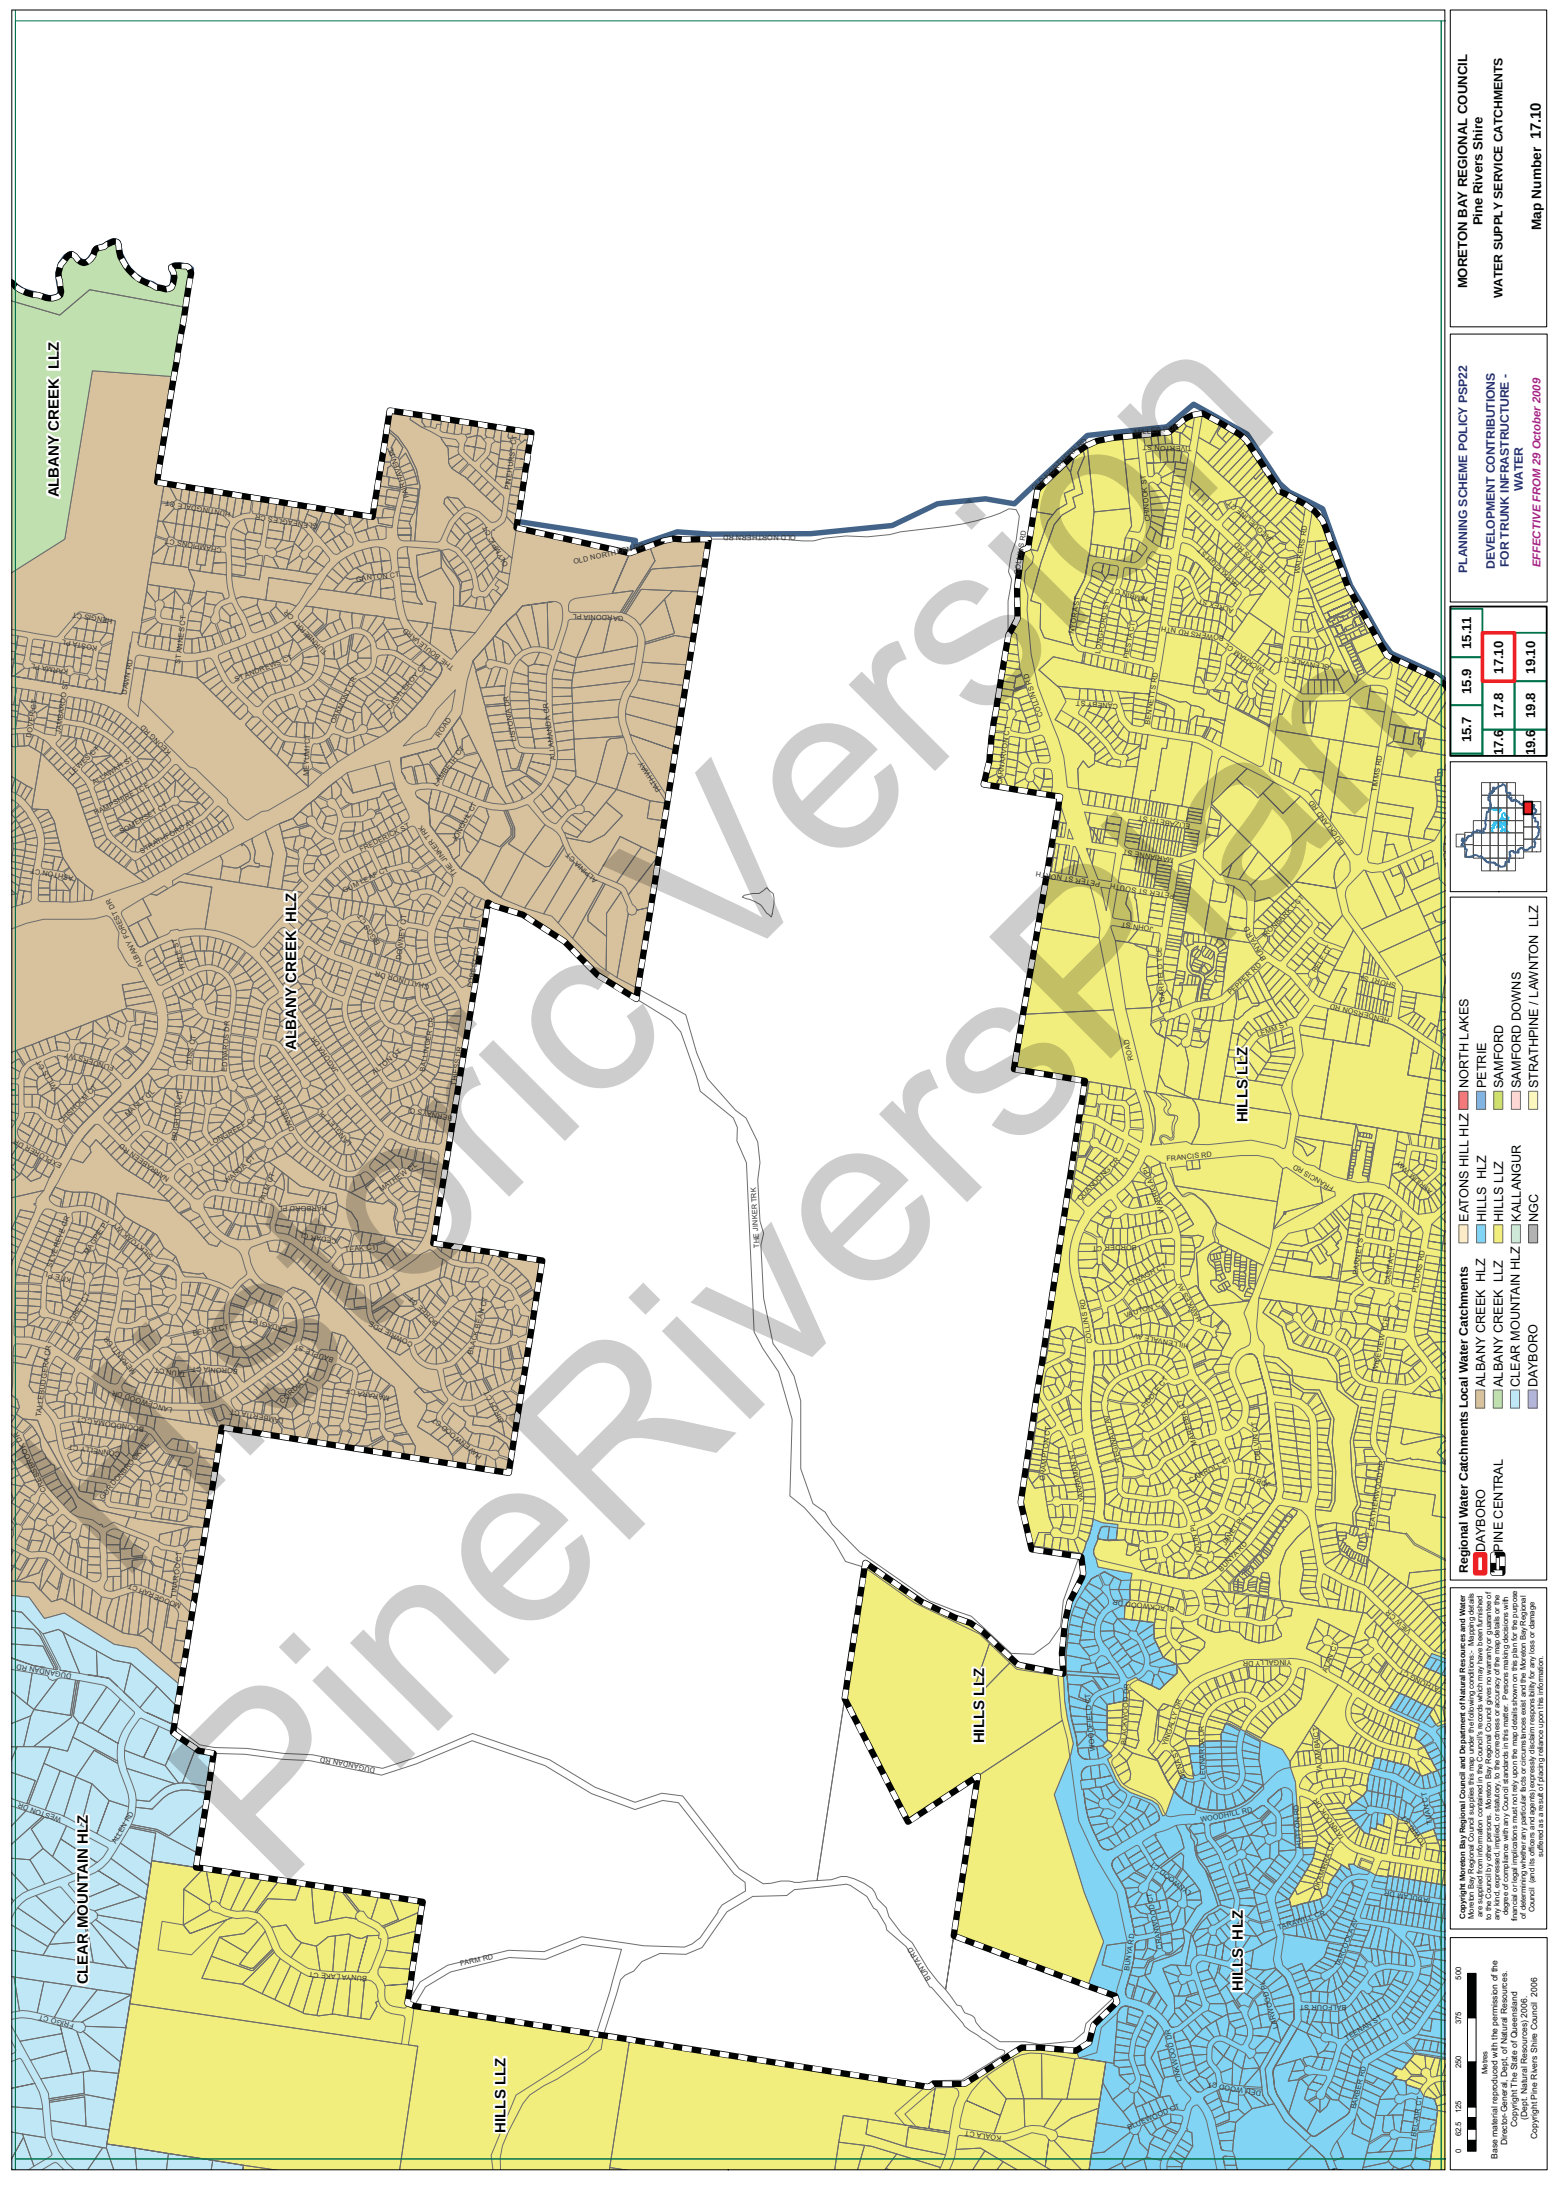

0 62.5 125 250 375 500
Metres

Base material supplied to the Council for the purpose of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and are not to be used for any purpose other than that for which they
were prepared. The Council is not responsible for any errors or omissions in the map or for any
consequences arising from its use. The Council is not responsible for any loss or damage
resulting from its use. The Council is not responsible for any loss or damage
resulting from its use.

Regional Water Catchments Local Water Catchments

- DAYBORO
- PINE CENTRAL
- EATONS HILL HLZ
- ALBANY CREEK HLZ
- ALBANY CREEK LLZ
- CLEAR MOUNTAIN HLZ
- DAYBORO
- NORTH LAKES
- PETRIE
- SAMFORD
- SAMFORD DOWNS
- STRATHPINE / LAWINTON
- NGC

Planning Scheme Policy PSP22

DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER

EFFECTIVE FROM 29 October 2009

15.7	15.9	15.11
17.6	17.8	17.10
19.6	19.8	19.10

17.10


19.10

17.10

19.10

17.10

19.10

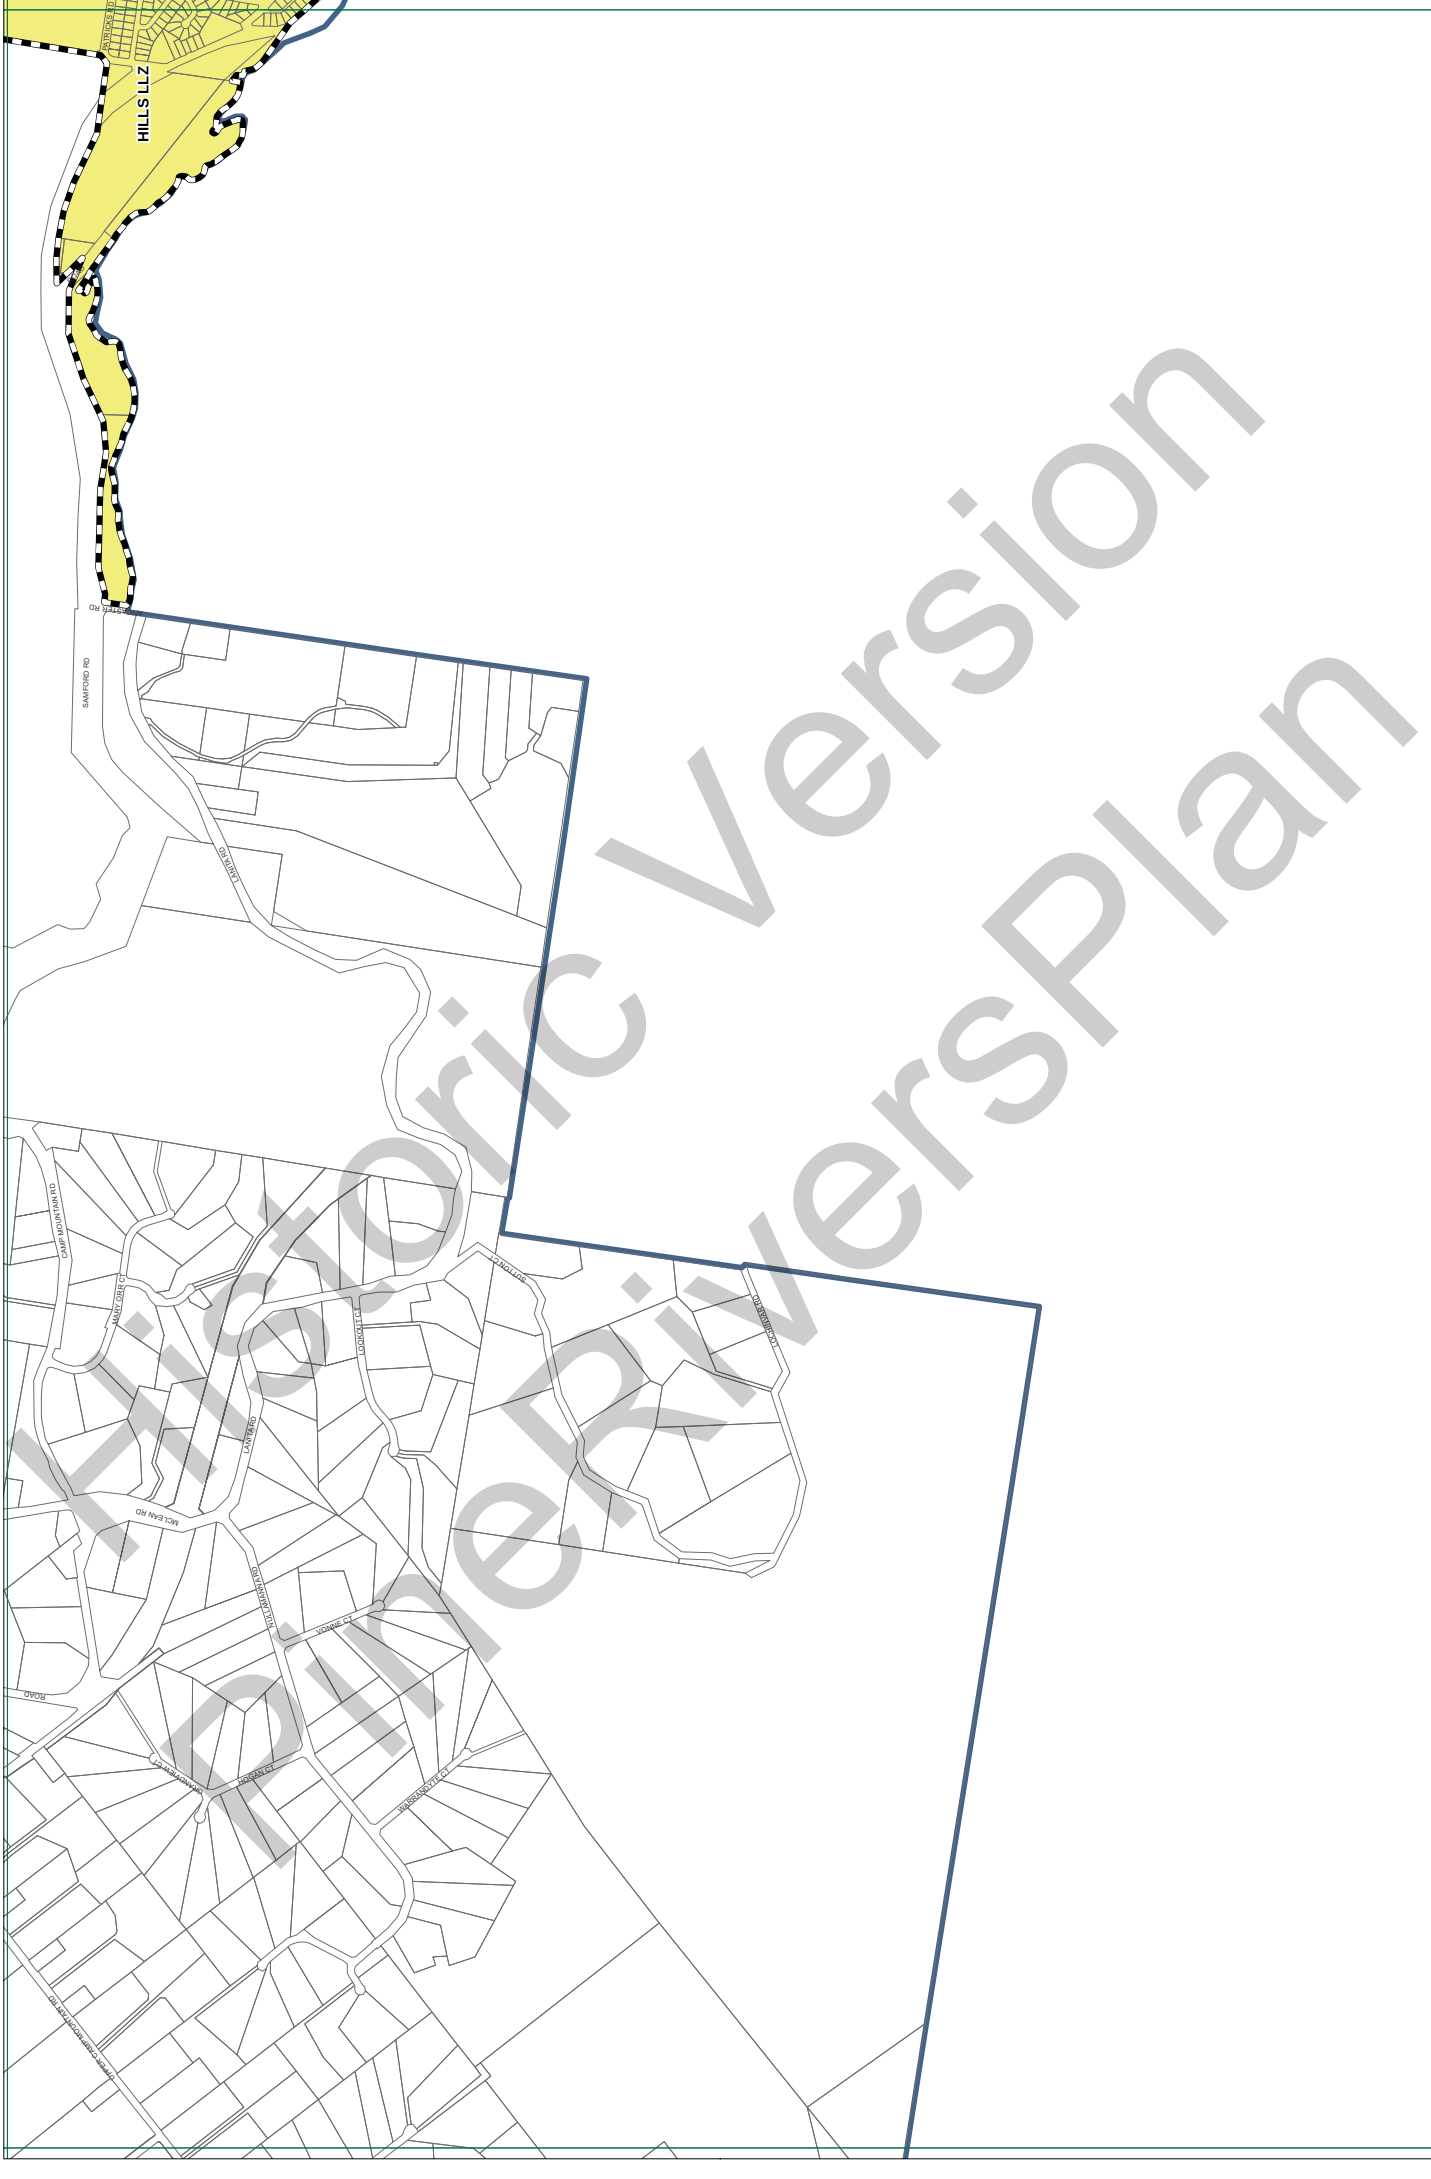

0 62.5 125 250 375 500
Metres

Base material sourced with the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
2006
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and are not to be used for any purpose other than that for which they
were prepared. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness and is not responsible for any errors or omissions. The user assumes
all responsibility for the use of the map and for any consequences arising from its use. The user
agrees to indemnify and hold the Council harmless from and against all claims, damages, costs
and expenses (including legal costs) in connection with the use of the map.

Regional Water Catchments Local Water Catchments

DAYBORO **PINE CENTRAL**



- EATONS HILL HLZ
- ALBANY CREEK HLZ
- ALBANY CREEK HLZ
- CLEAR MOUNTAIN HLZ
- DAYBORO
- HILLS HLZ
- HILLS LLZ
- KALLANGUR
- STRATHPINE / LAWINTON LLZ
- PETRIE
- SAMFORD
- SAMFORD DOWNS
- NGC
- NORTH LAKES

Map Number 19.8

15.7 15.9 17.6 17.8 17.10 19.6 19.8 19.10

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS
FOR TRUNK INFRASTRUCTURE -
WATER
EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY SERVICE CATCHMENTS

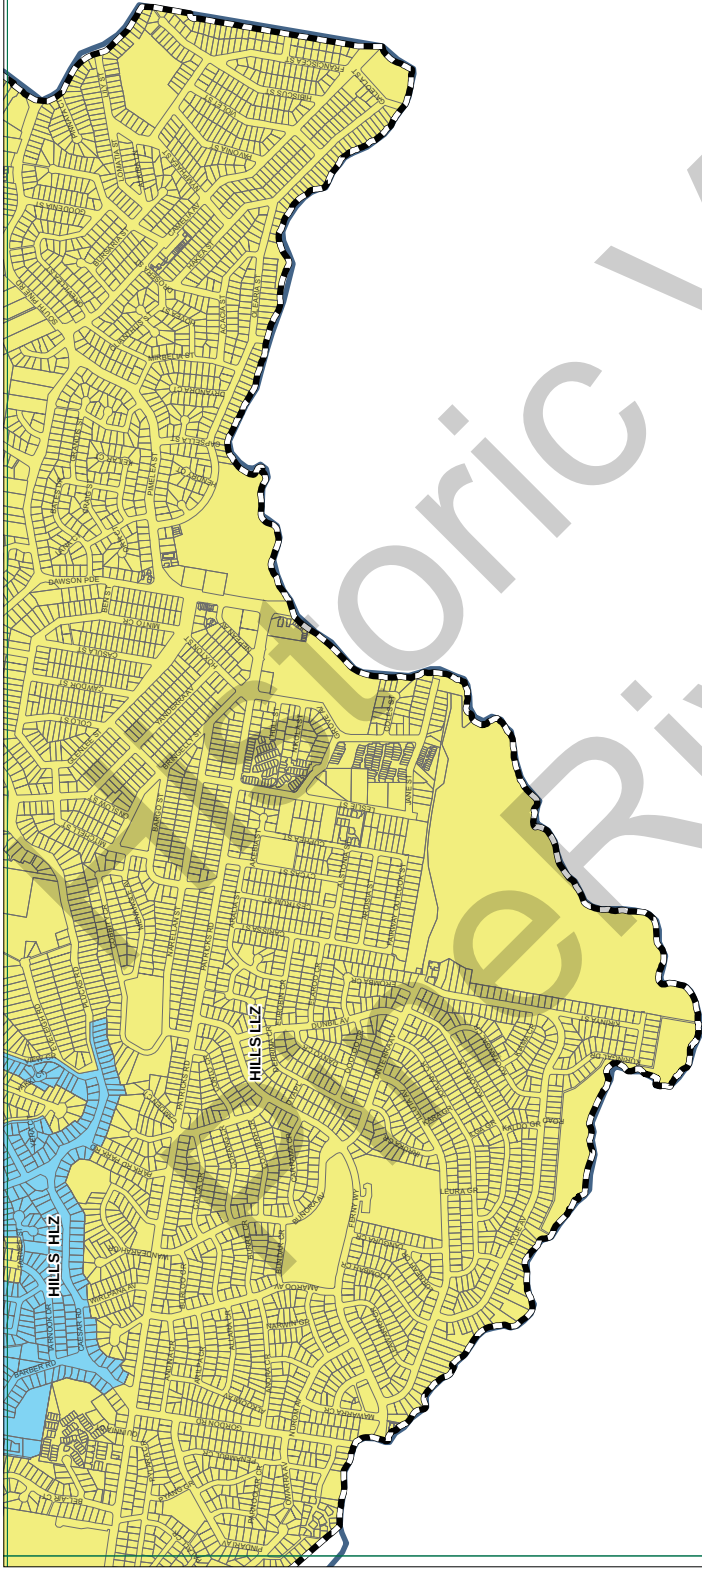



Schedule D: Network Assets

Historic Version
PineRiversPlan

MAP SHEET INDEX

Pine Rivers Shire

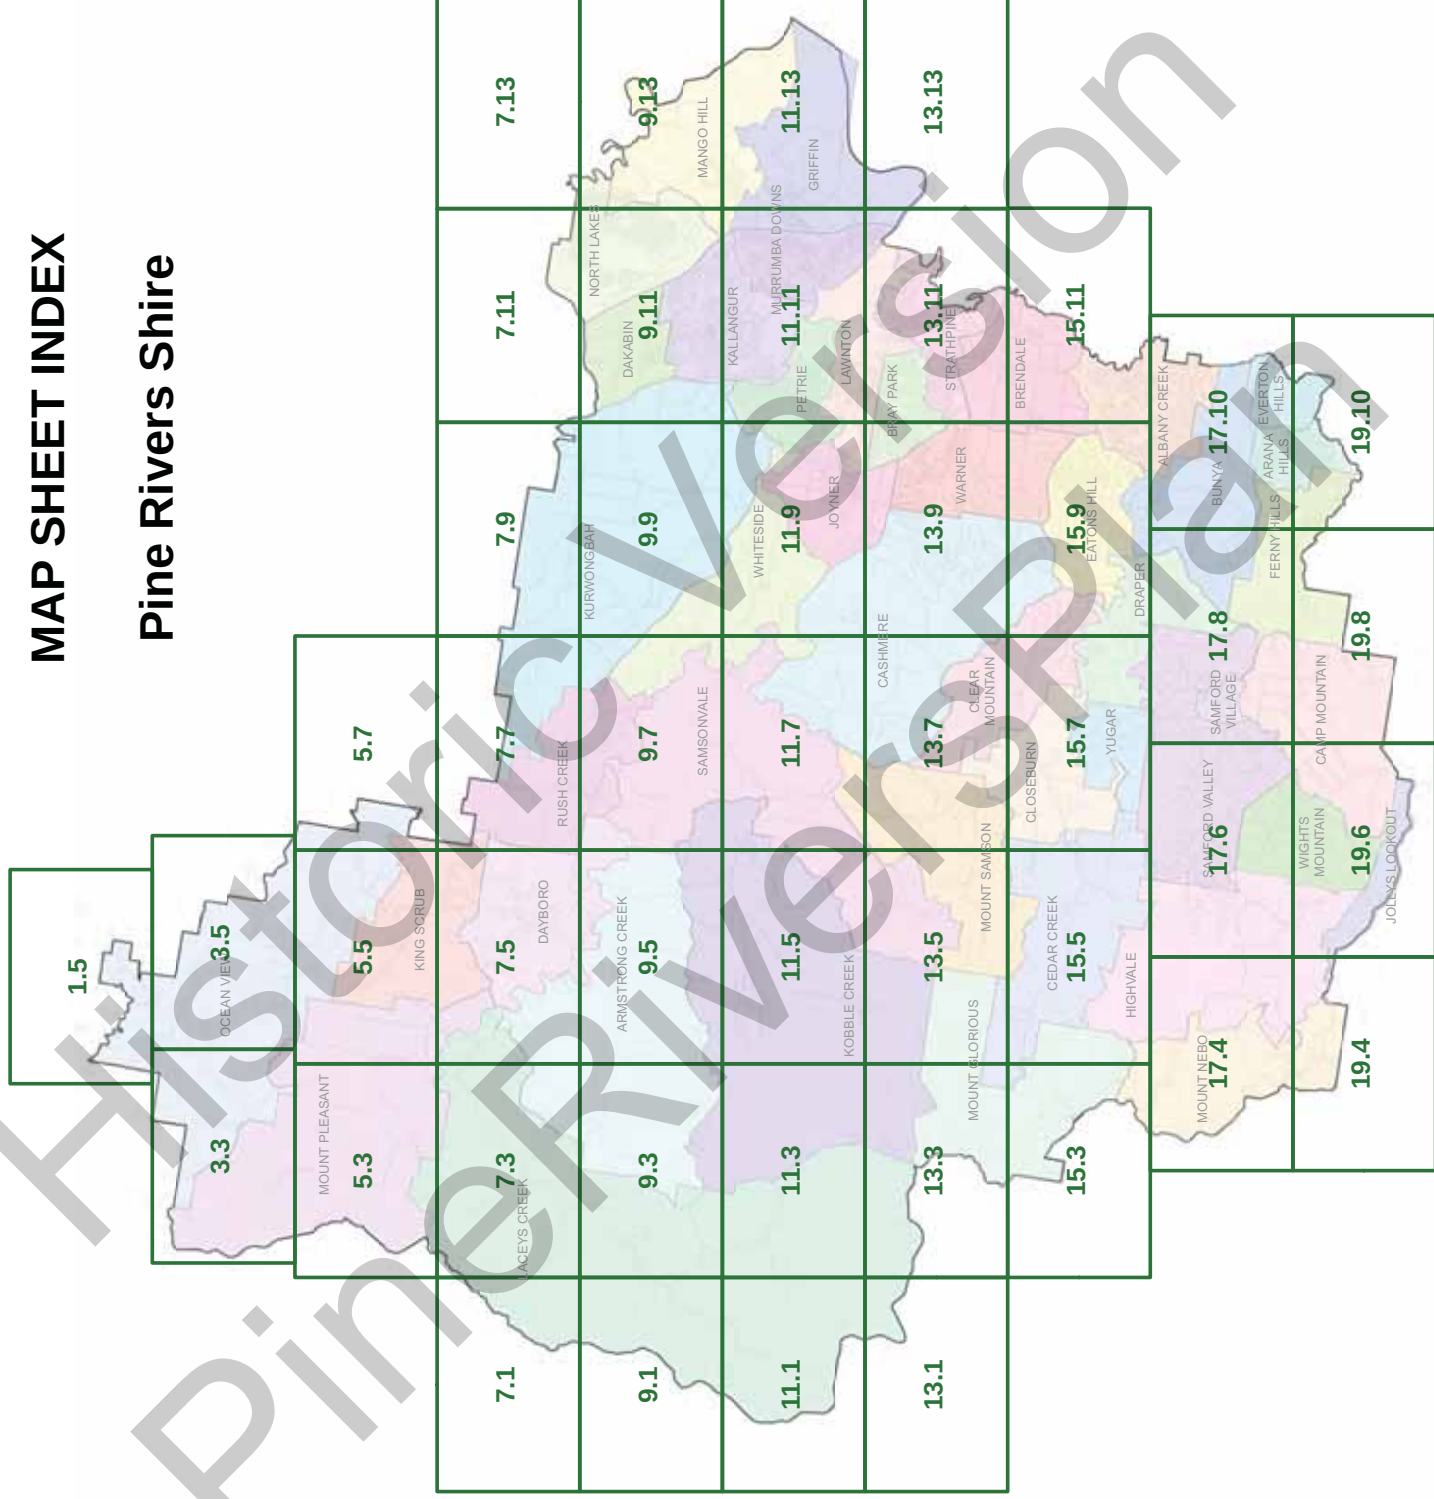

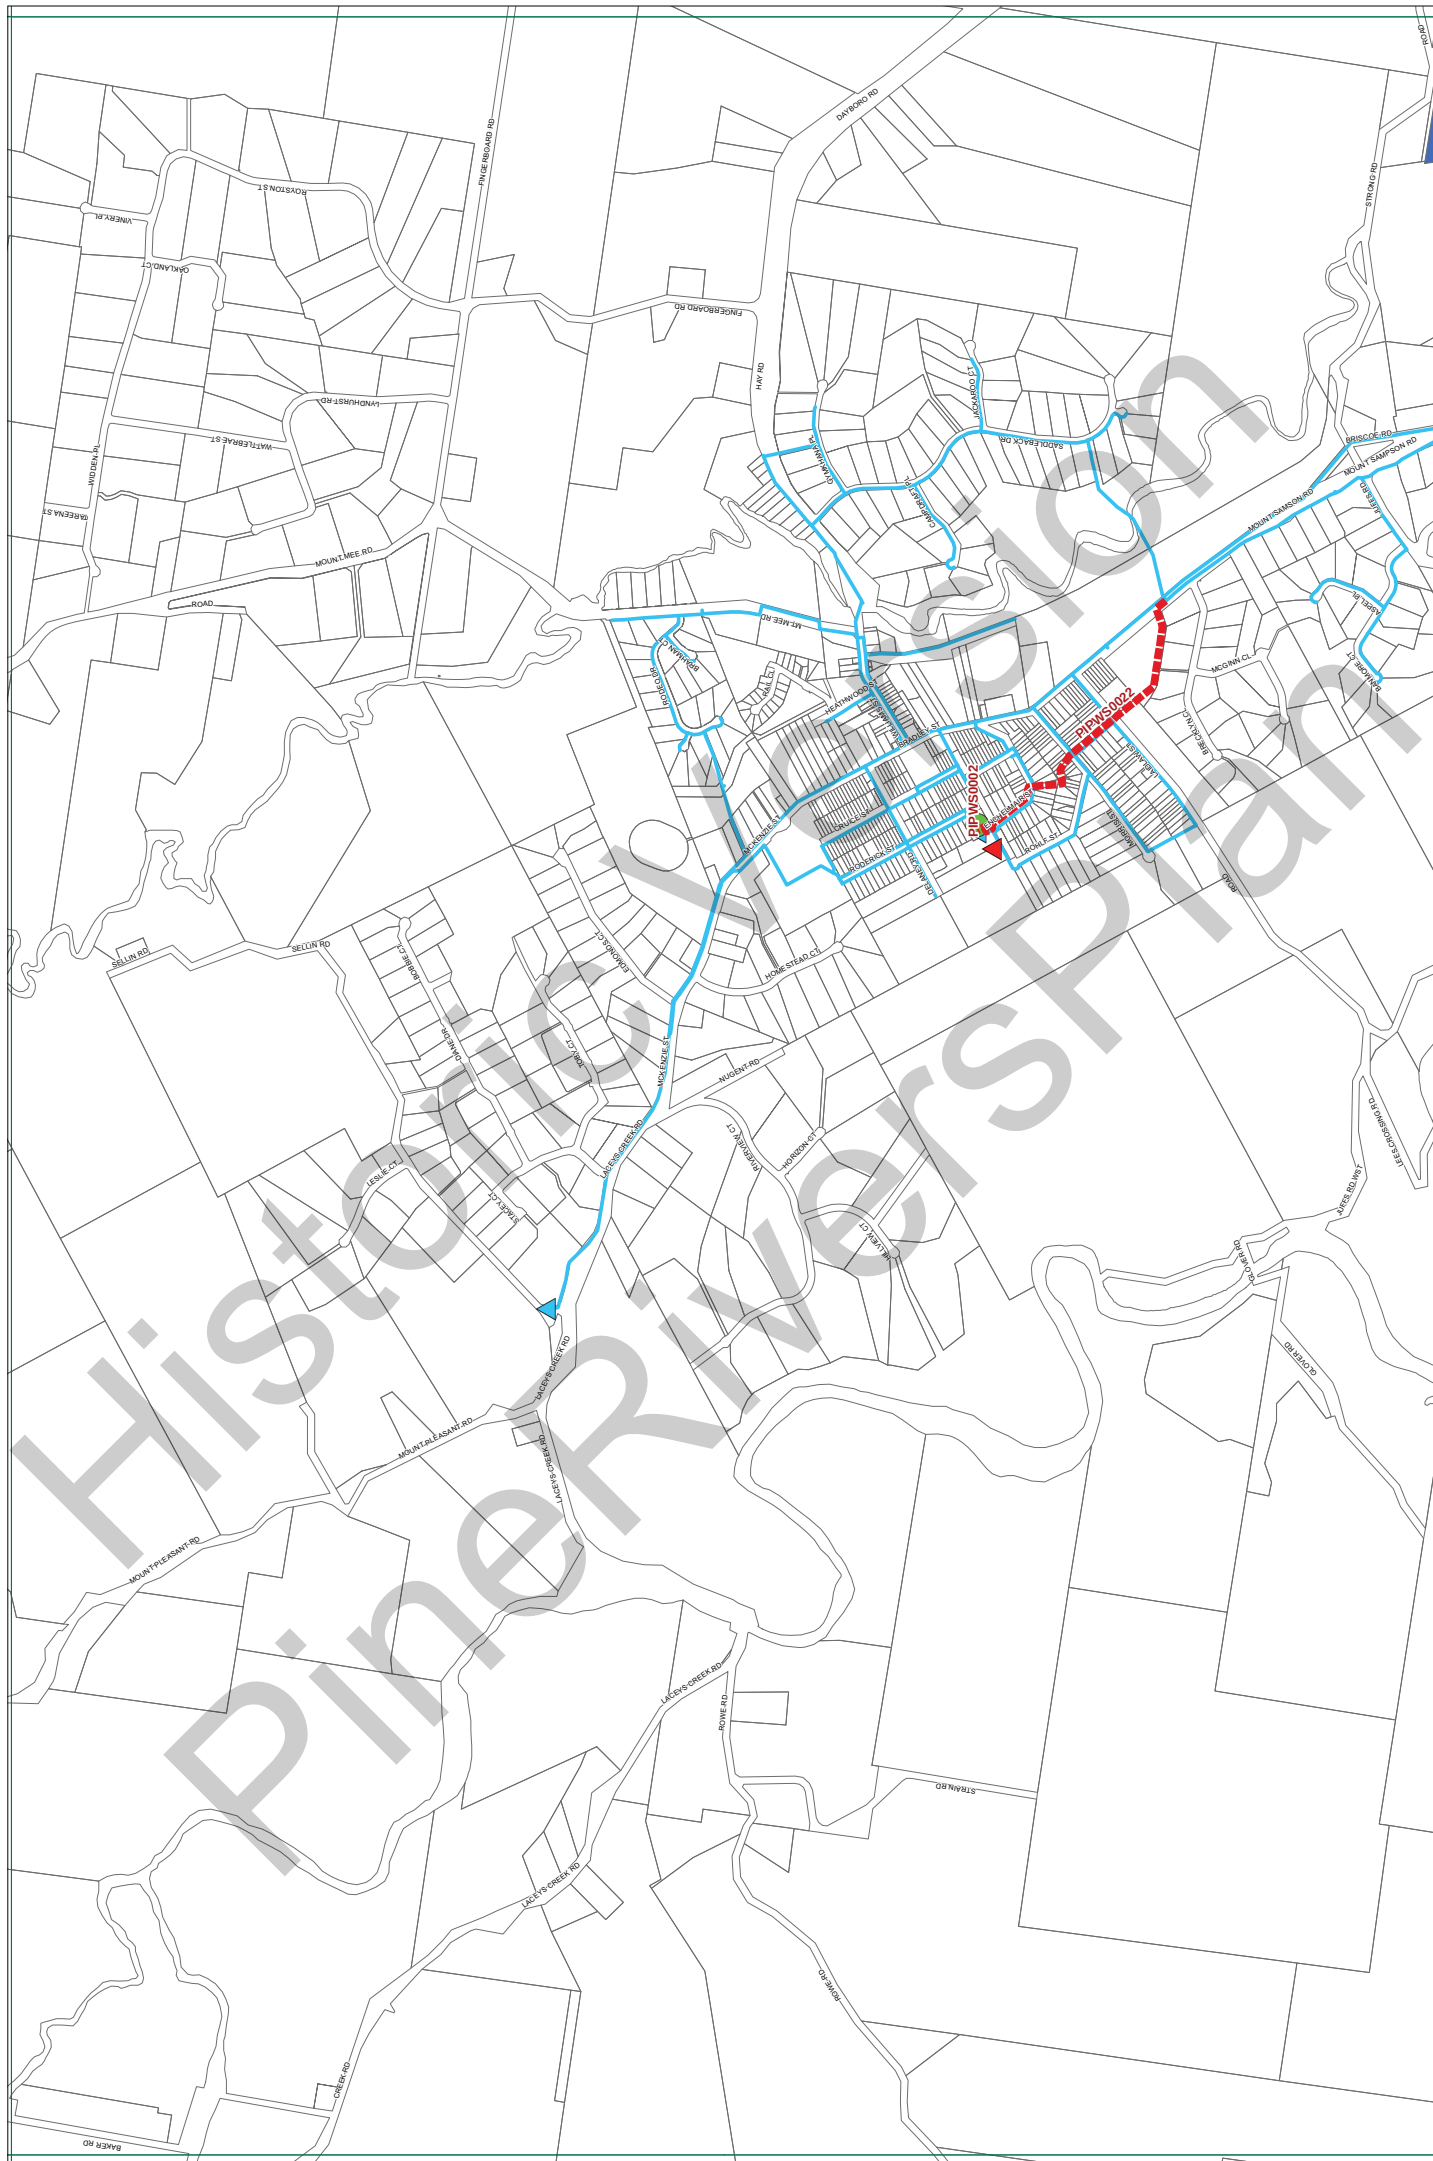


Copyright Meronek Bay Regional Council and Department of Natural Resources and Water. Meronek Bay Regional Council supplies this map under the following conditions: Mapping staff are supplied from information contained in the Council's records which may have been furnished to the Council by other persons. Meronek Bay Regional Council gives no warranty or guarantee of any kind expressed, implied, or statutory, to the correctness or accuracy of the map details or the degree of completion with any Council standards in this matter. Persons making decisions with financial or legal implications must not rely upon the map details shown on this plan for the purpose of determining whether any particular facts or circumstances exist and the Meronek Bay Regional Council (and its officers and agents) expressly disclaimers responsibility for any injury or damage.

-  WATER ROUTE
 PINE WM PIPES
 Water Treatment Plants
 Existing Bulk Meters
 Existing Water Pumps
 Future Water Mains
 Future Water Pumps
 Existing Reservoirs
 Future Water Reservoirs



5.3	5.5	5.7
7.3	7.5	7.7
9.3	9.5	9.7

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009

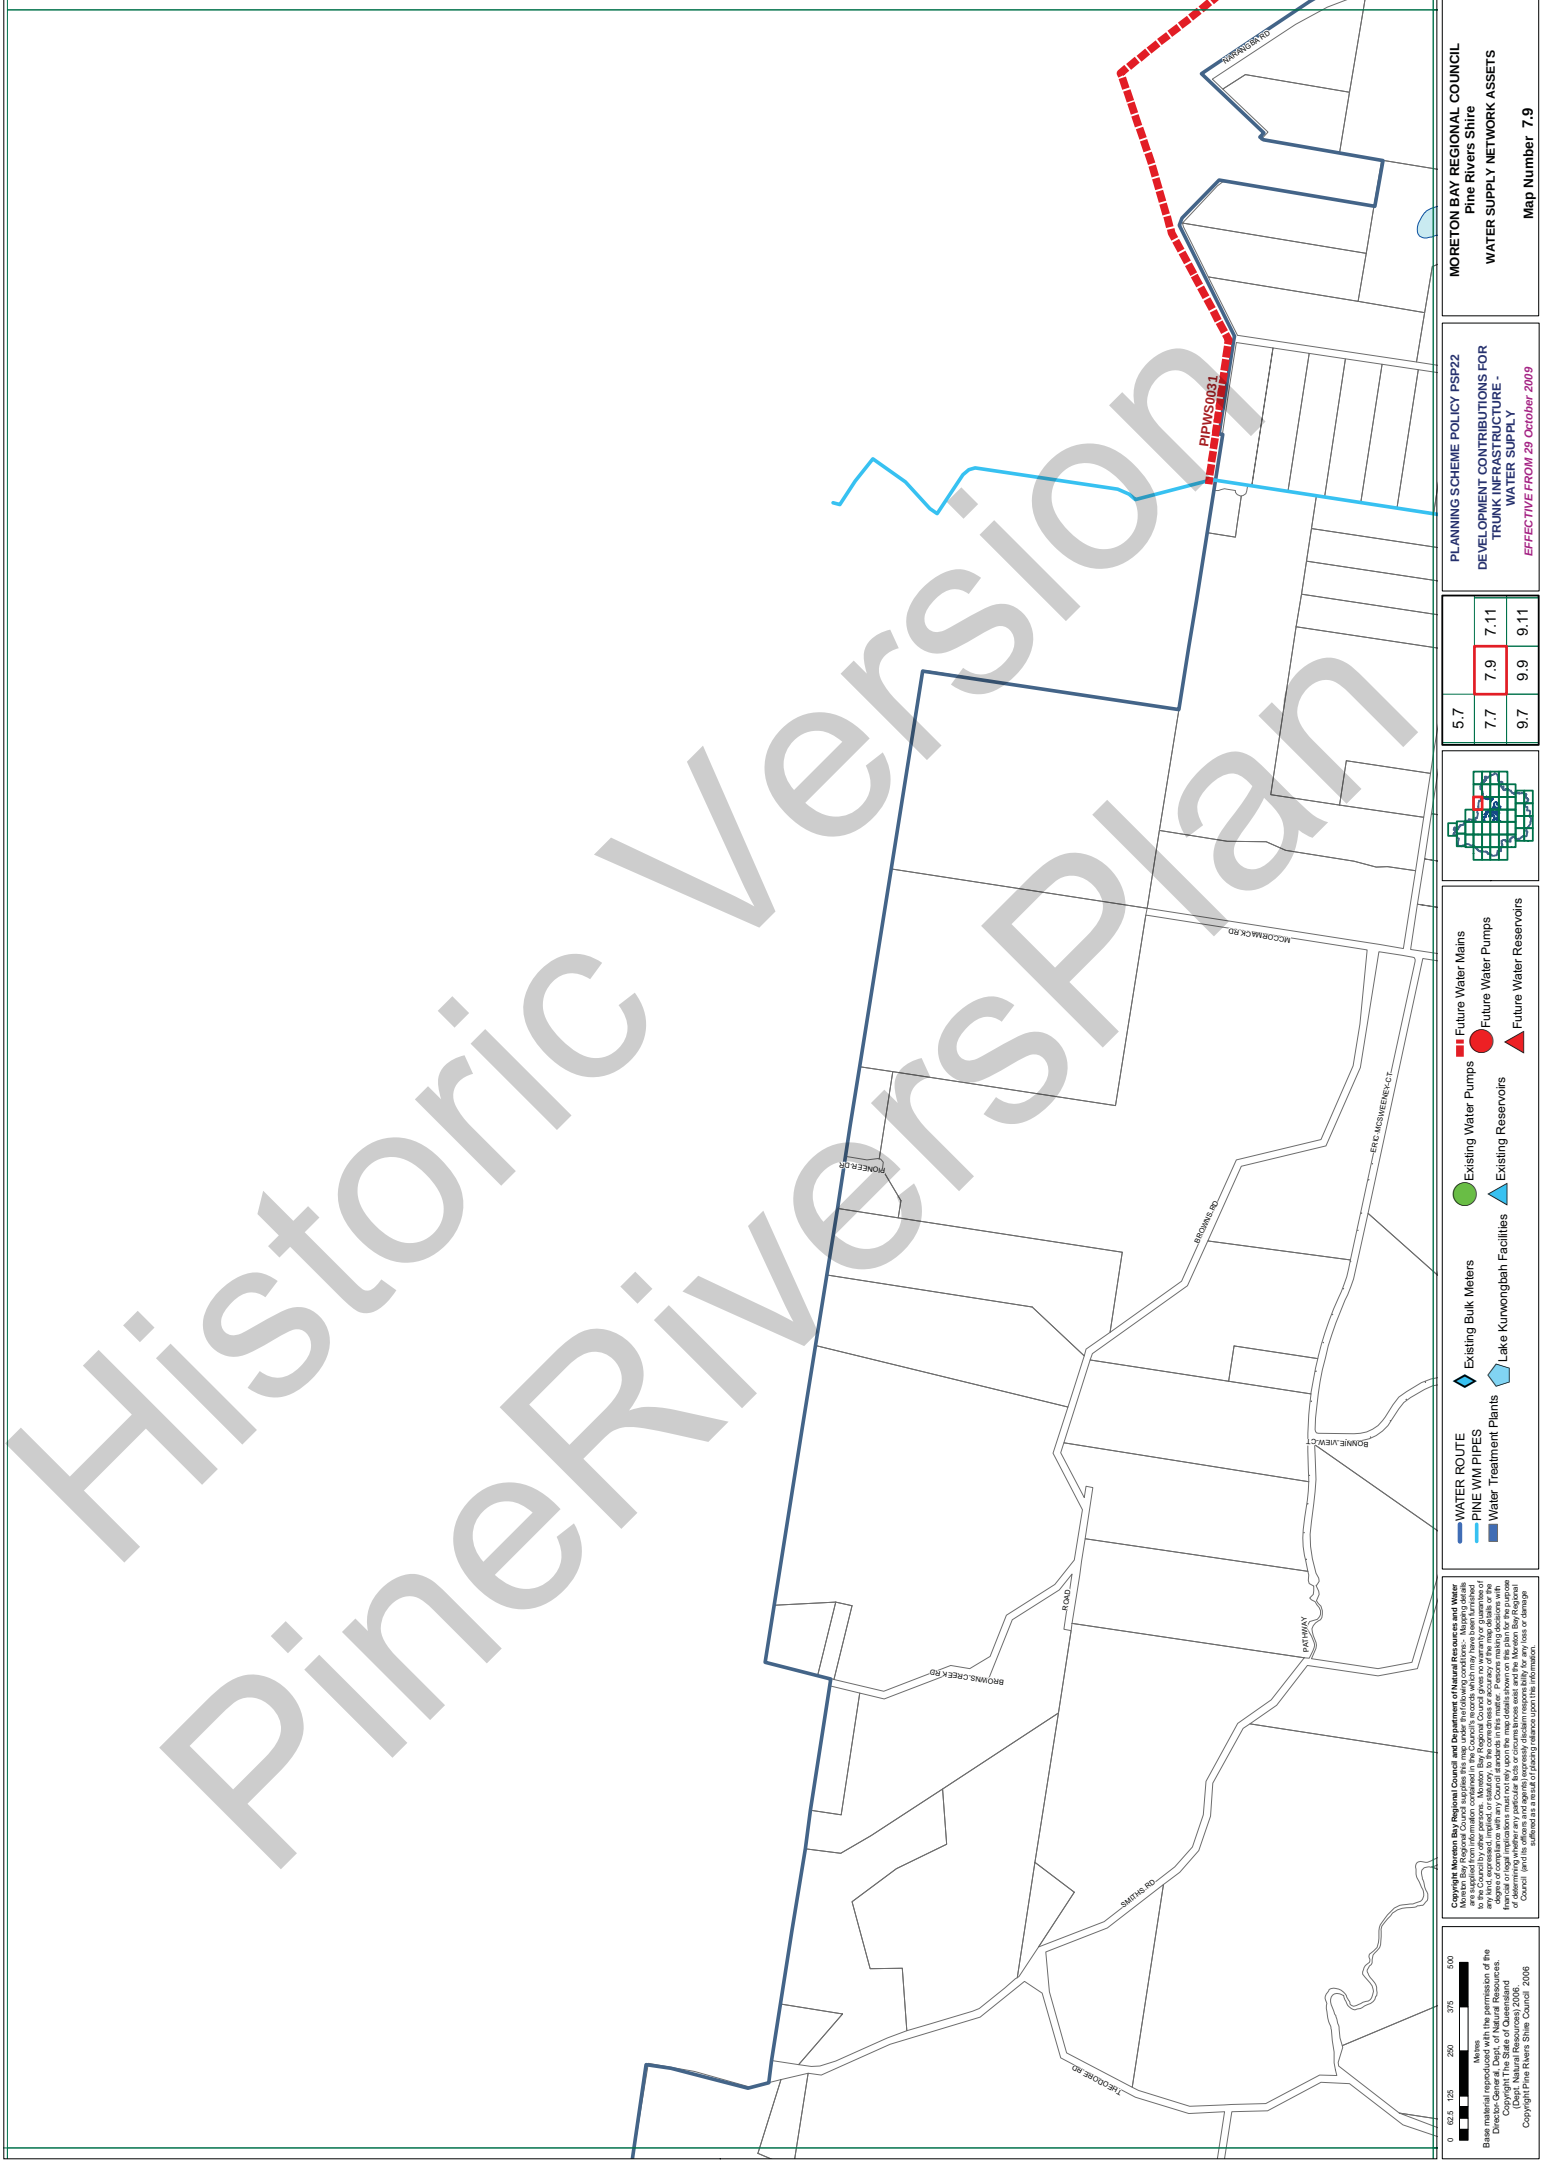


Scale 1:5000
0 62.5 125 250 375 500
Metres

Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and are not to be used for any purpose other than that for which
they were prepared. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness and any Council of standards in this matter. Persons making decisions with
reference to map information must not rely upon the map details shown on the plan for the purpose
of any legal proceedings and the Council and its officers and agents respectively disclaim responsibility for any loss or damage
caused by reliance on the map.


- Water Route
- Pine WM Pipes
- Water Treatment Plants
- Existing Bulk Meters
- Existing Water Pumps
- Future Water Pumps
- Existing Reservoirs
- Future Reservoirs
- Lake Kurungbahi Facilities
- Future Water Reservoirs



5.7	7.7	7.9	7.11
9.7	9.9	9.9	9.11


PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009


7.9	7.11	7.13
9.9	9.11	9.13



-  WATER ROUTE
 PINE WM PIPES
 Water Treatment Plants
 Existing Bulk Meters
 Existing Water Pumps
 Future Water Mains
 Future Water Pumps
 Existing Reservoirs
 Future Water Reservoirs

Copyright Morotei Bay Regional Council and Department of Natural Resources and Water
Morotei Bay Regional Council supplied this map under the following conditions: Mapping details
have been supplied from information contained in the Council's records which may have been furnished
to the Council by other persons. Morotei Bay Regional Council gives no warranty or guarantee of the
accuracy, reliability, or completeness of the map data, or of any data, expressed, implied, or statutory, to the correctness or accuracy of the map details or the
degree of compliance with any Council standards in this matter. Persons making decisions with
legal or legal implications must not rely upon the map details shown on the plan for the purpose
of determining whether any particular facts or circumstances arise and the Morotei Bay Regional
Council (and its officers and agents) expressly disclaim responsibility for any loss or damage



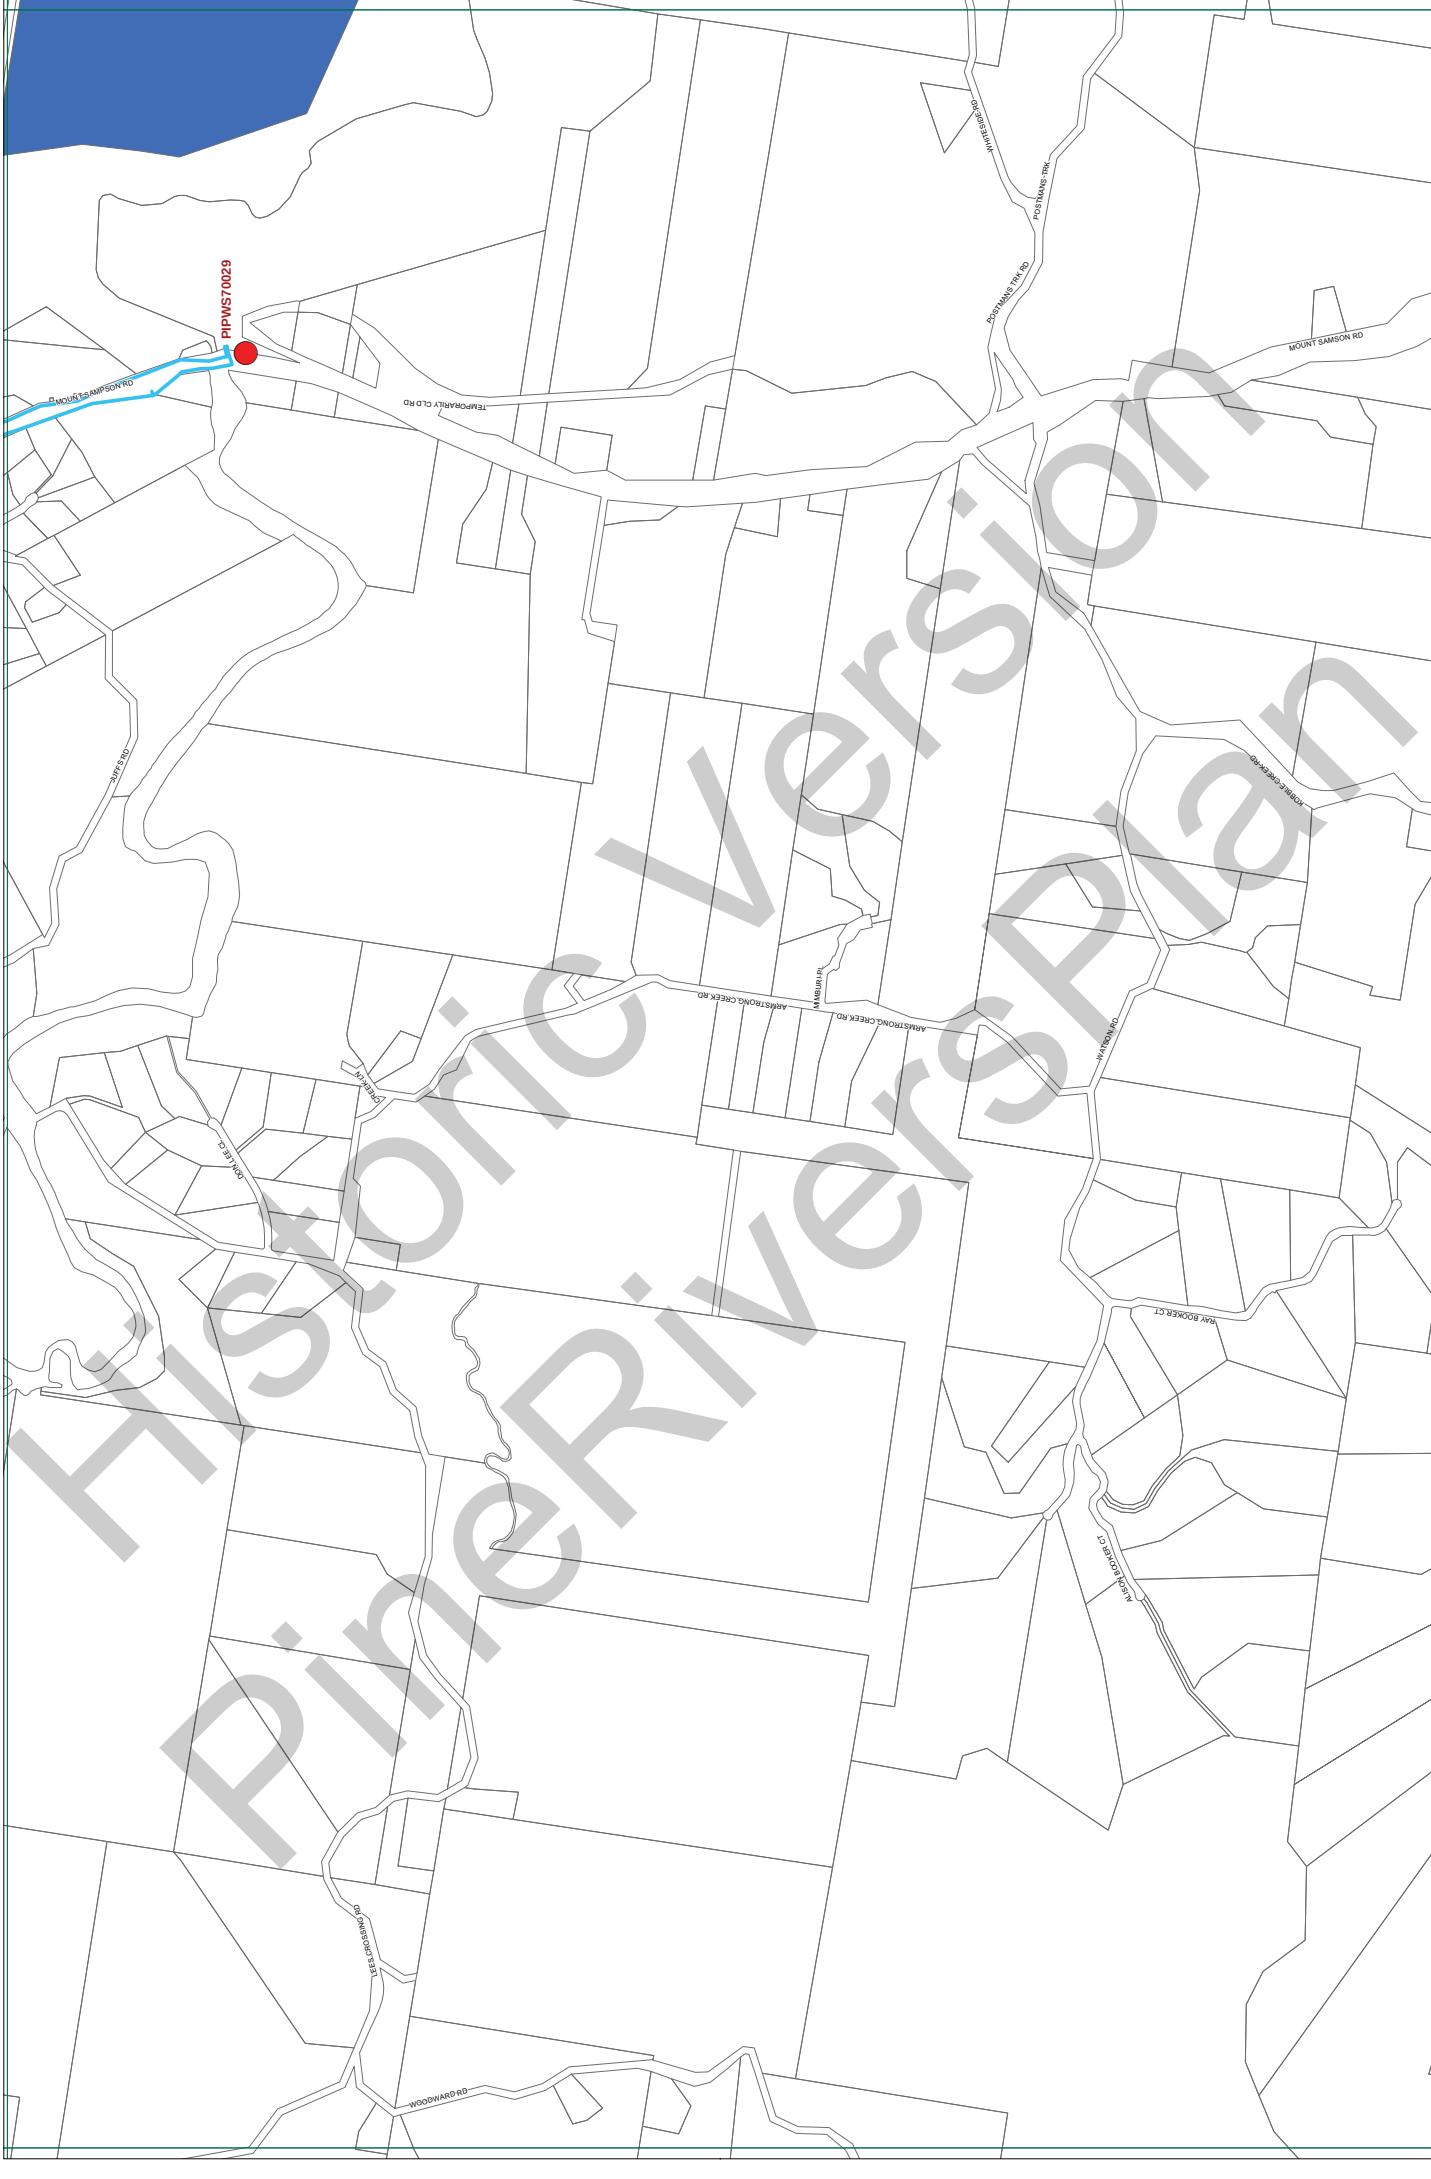


0 62.5 125 250 375 500
Metres

Base material sourced with the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland 2006
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and are not to be used for any purpose other than that for which
they were prepared. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness and is not responsible for any errors or omissions. The user
agrees to indemnify and hold the Council harmless from all claims, damages, costs and
expenses of legal proceedings that may arise from the use of this map. The user agrees to
indemnify and hold the Council harmless from all claims, damages, costs and expenses of
legal proceedings that may arise from the use of this map. The user agrees to indemnify and
hold the Council harmless from all claims, damages, costs and expenses of legal proceedings
that may arise from the use of this map.

- WATER ROUTE
- PINE WM PIPES
- Water Treatment Plants
- Existing Bulk Meters
- Future Water Mains
- Existing Water Pumps
- Future Water Pumps
- Existing Reservoirs
- Future Reservoirs
- Lake Kurungbush Facilities
- Future Water Reservoirs



7.3	7.5	7.7
9.3	9.5	9.7
11.3	11.5	11.7


PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009



Base material reproduced with the permission of the Director-General, Dept. of Natural Resources, Copyright The State of Queensland (Dept. Natural Resources) 2006.
Copyright Pine Rivers Shire Council 2006

Copyright, Montclair Bay Regional Council and Department of Natural Resources and Water. Montclair Bay Regional Council supplies this map under the following conditions: Mapping details are supplied from information contained in the Council's records which may not be furnished to the Council by other persons. Montclair Bay Regional Council gives no warranty or guarantee of any kind, expressed, implied, or statutory, to the correctness or accuracy of the map details or the degree of compliance with any Council standards in this matter. Persons making decisions with financial or legal implications must not rely upon the map details shown on the plan for the purpose of determining any individual's rights or those shown on the plan for the purpose of determining any individual's obligations. The Council disclaims any liability for any loss or damage caused by the use of the map details shown on the plan. The Council (and its officers and employees) shall not be liable for any loss or damage caused by the use of the map details shown on the plan. This information

-  WATER ROUTE
 PINE WM PIPES
 Water Treatment Plants
 Existing Bulk Meters
 Existing Water Pumps
 Future Water Pumps
 Existing Reservoirs
 Future Water Reservoirs




7.5	7.7	7.9
9.5	9.7	9.9
11.5	11.7	11.9

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY NETWORK ASSETS

Map Number 9.7

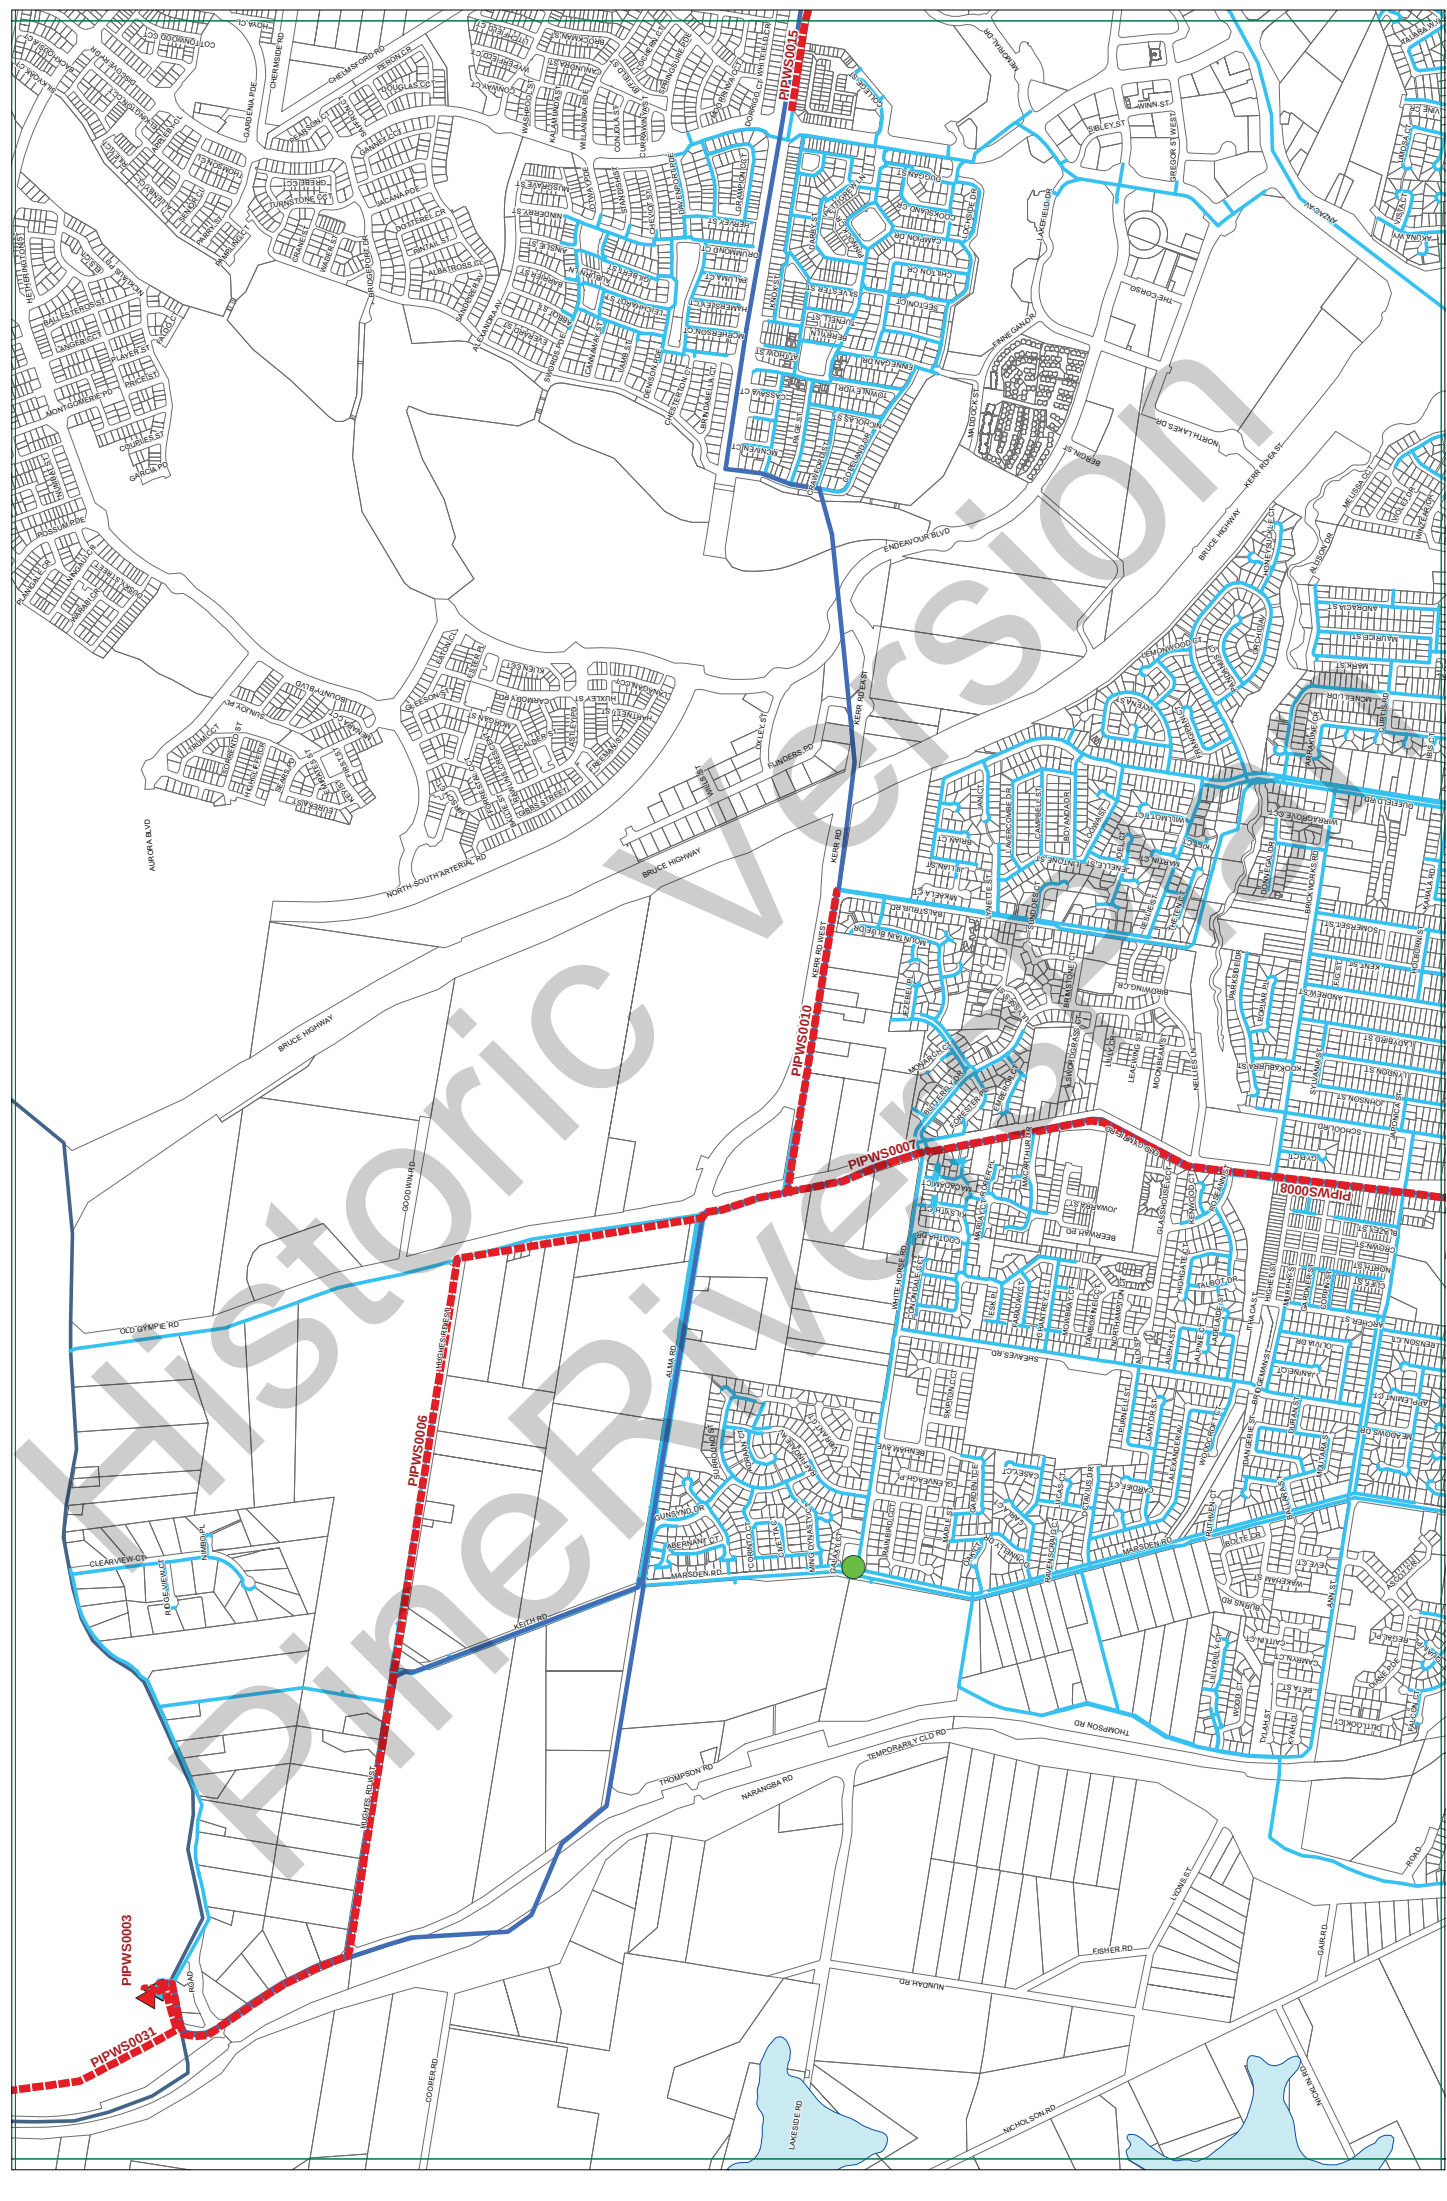

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details are for general information only and should not be used for legal purposes. Mapping details are the property of the Council and are not to be reproduced without the written permission of the Council.
Approval of map impressions must not rely upon the map data shown on the plan for the purpose of any legal proceedings or for any other purpose. The Council and its officers and agents accept no responsibility for any loss or damage caused by reliance on this map.

0 62.5 125 250 375 500
Metres

Base material supplied to the Council by the permission of the Director-General, Dept. of Natural Resources.
Copyright The State of Queensland 2006
Copyright Pine Rivers Shire Council 2006

WATER ROUTE
— WATER ROUTE
— PINE W/M PIPES
— WATER TREATMENT PLANTS

EXISTING BULK METERS
◆ EXISTING BULK METERS

EXISTING WATER PUMPS
■ EXISTING WATER PUMPS

WATER TREATMENT PLANTS
● WATER TREATMENT PLANTS

EXISTING WATER PUMPS
■ EXISTING WATER PUMPS

EXISTING RESERVOIRS
▲ EXISTING RESERVOIRS

LAKE KUNWONGBARR FACILITIES
● LAKE KUNWONGBARR FACILITIES

FUTURE WATER MAINS
— FUTURE WATER MAINS

FUTURE WATER PUMPS
● FUTURE WATER PUMPS

FUTURE WATER RESERVOIRS
▲ FUTURE WATER RESERVOIRS

0 62.5 125 250 375 500
Metres


Base material supplied to the Council by the permission of the Director-General, Dept. of Natural Resources.
Copyright The State of Queensland 2006
Copyright Pine Rivers Shire Council 2006

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY NETWORK ASSETS

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009

7.9	7.11	7.13
9.9	9.11	9.13
11.9	11.11	11.13

Map Number 9.11

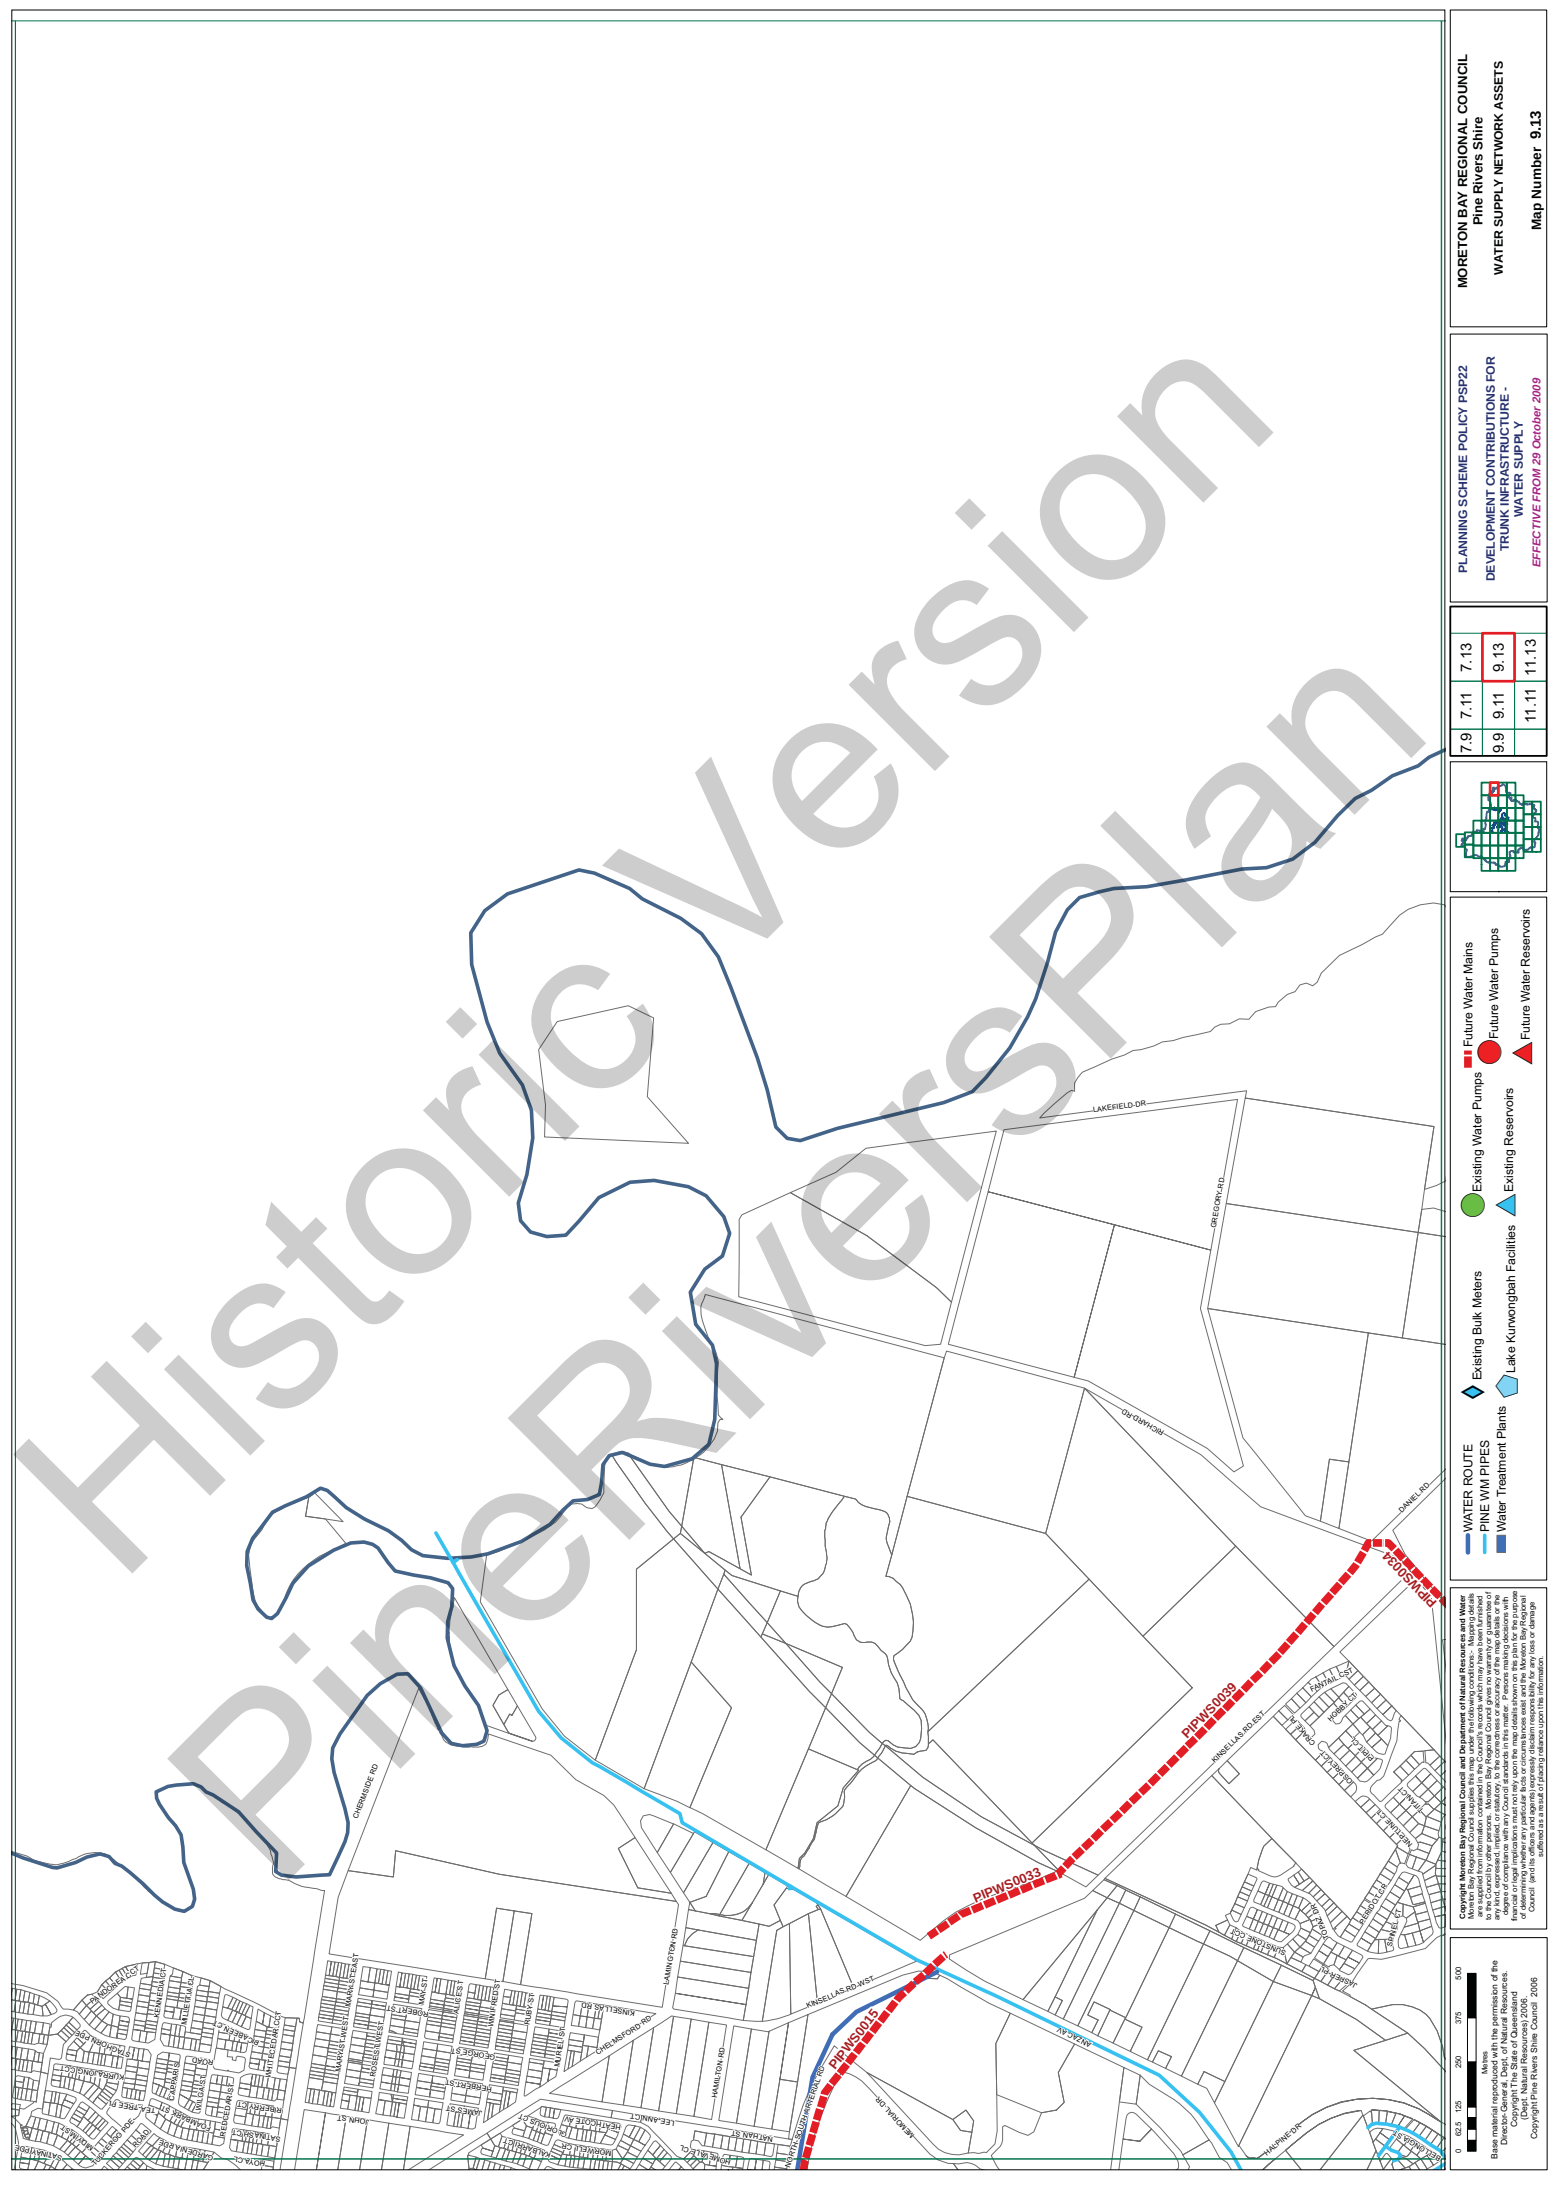

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY NETWORK ASSETS

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009


7.9	7.11	7.13
9.9	9.11	9.13
11.11	11.13	11.13

WATER ROUTE
PINE WM PIPES
Water Treatment Plants
Existing Bulk Meters
Existing Water Pumps
Future Water Pumps
Existing Reservoirs
Future Reservoirs

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and do not constitute a guarantee of accuracy or completeness
of the information. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness of the information. Moreton Bay Regional Council is not responsible for
any loss or damage arising from the use of this map. The map is provided for the customer's
information only and does not constitute a contract. The map is provided for the customer's
information only and does not constitute a contract. The map is provided for the customer's
information only and does not constitute a contract.

0 62.5 125 250 375 500
Metres

Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright © The State of Queensland
2006
Copyright Pine Rivers Shire Council 2006

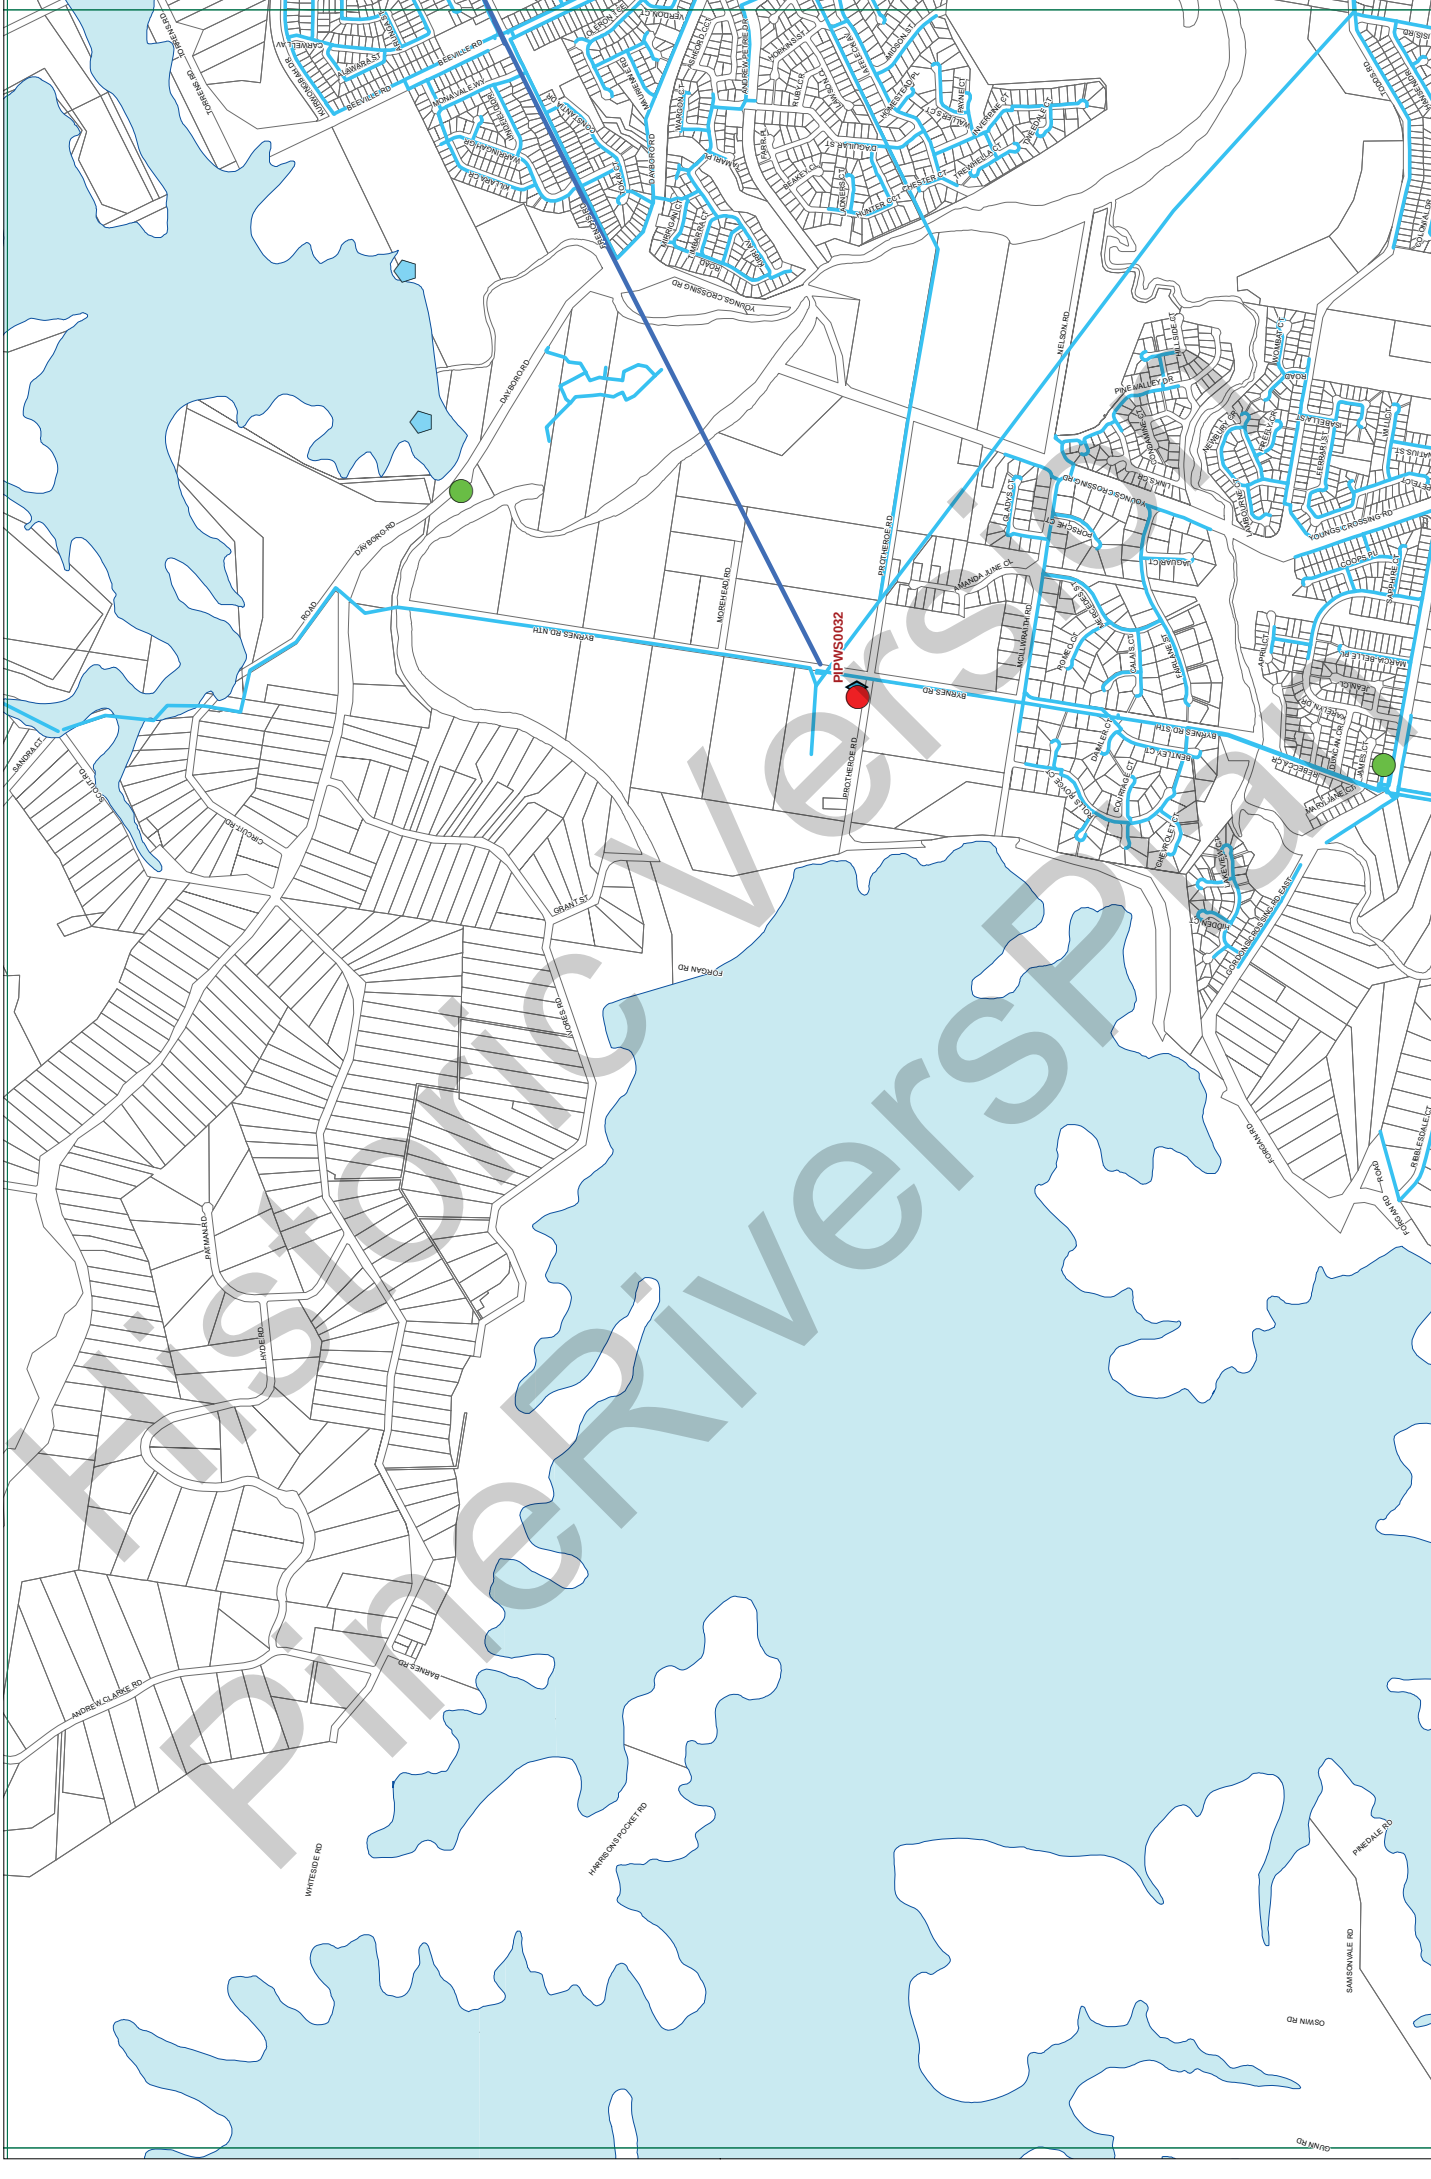


0 62.5 125 250 375 500
Metres

Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006


Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and are not to be used for any purpose other than that for which they
were prepared. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness and is not responsible for any loss or damage arising from the use of
this map. Moreton Bay Regional Council is not responsible for any loss or damage arising from the use of
this map. Moreton Bay Regional Council is not responsible for any loss or damage arising from the use of
this map.

- Water Route
- Pine W/M Pipes
- Water Treatment Plants
- Existing Bulk Meters
- Existing Water Pumps
- Future Water Pumps
- Existing Reservoirs
- Future Reservoirs
- Lake Kurwongbah Facilities
- Future Water Reservoirs



9.7	9.9	9.11
11.7	11.9	11.11
13.7	13.9	13.11

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009

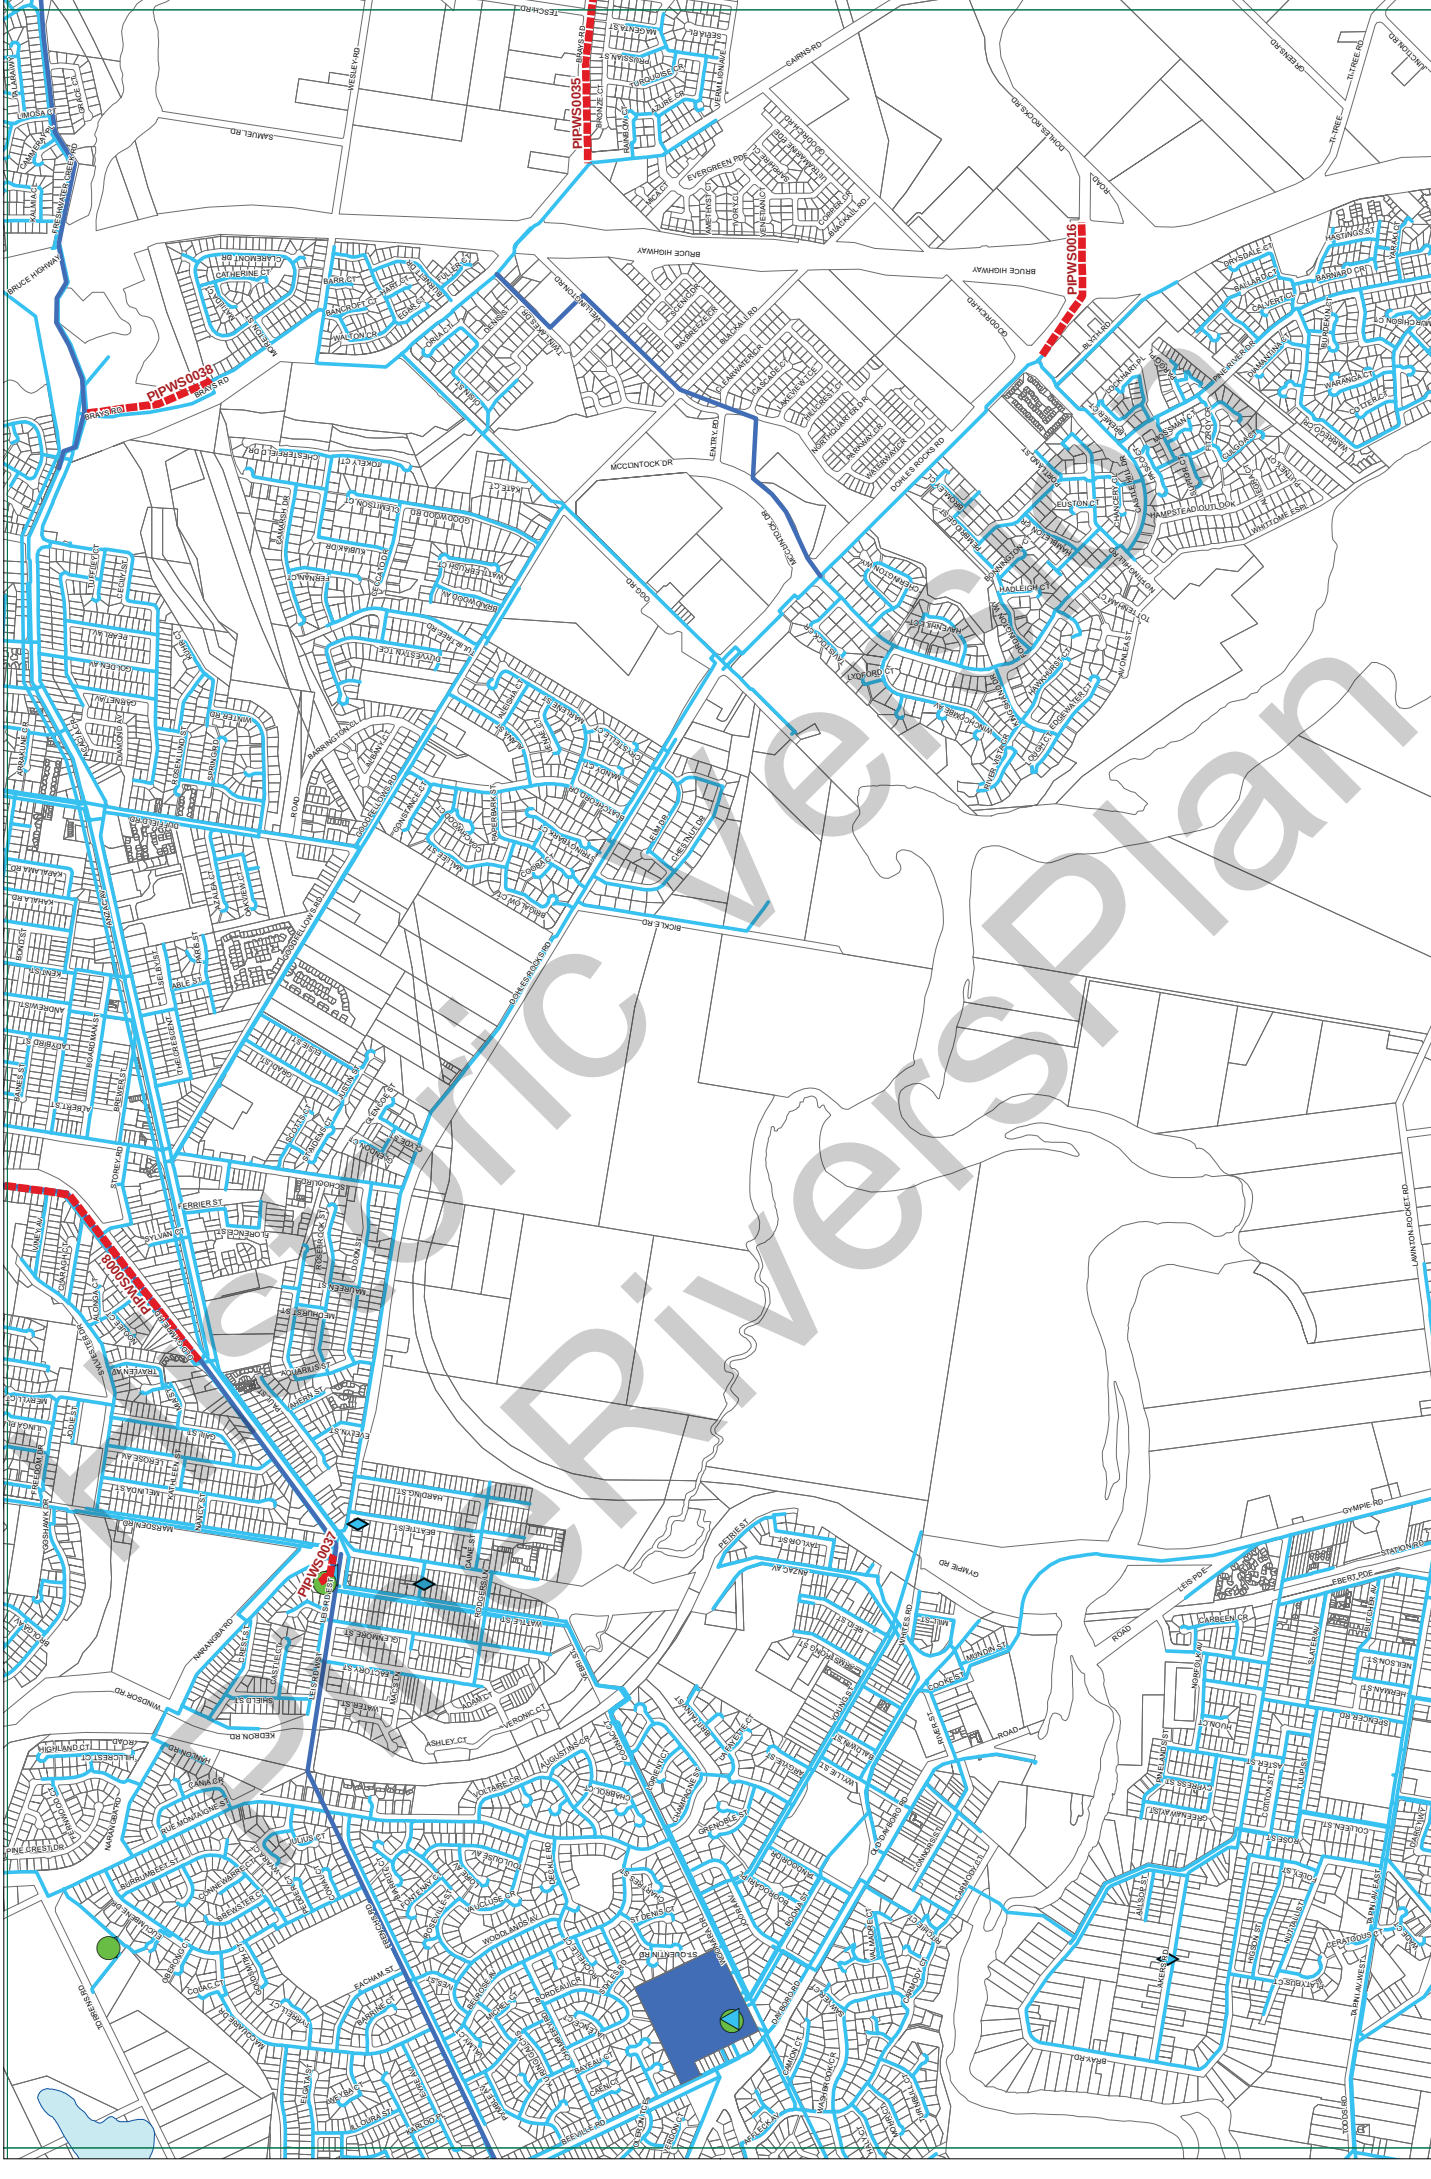

WATER ROUTE

- WATER ROUTE
- PINE WM PIPES
- WATER TREATMENT PLANTS

EXISTING INFRASTRUCTURE

- Existing Bulk Meters
- Existing Water Pumps
- Existing Reservoirs
- Existing Water Reservoirs
- Existing Water Pumps
- Existing Reservoirs
- Existing Water Reservoirs

PLANNING SCHEME POLICY PSP22

DEVELOPMENT CONTRIBUTIONS FOR TRUNK INFRASTRUCTURE - WATER SUPPLY

EFFECTIVE FROM 29 October 2019

MORETON BAY REGIONAL COUNCIL

Pine Rivers Shire



WATER SUPPLY NETWORK ASSETS

Map Number 11.11

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water. Moreton Bay Regional Council supplies this map under the following conditions: Mapping details are for general information only and are not to be used for any purpose other than that for which they were prepared. Moreton Bay Regional Council gives no warranty or guarantee of accuracy or completeness. Users of this map do so at their own risk. The Council is not responsible for any loss or damage arising from the use of this map. The Council is not responsible for any loss or damage arising from the use of this map.


0 62.5 125 250 375 500

Meters

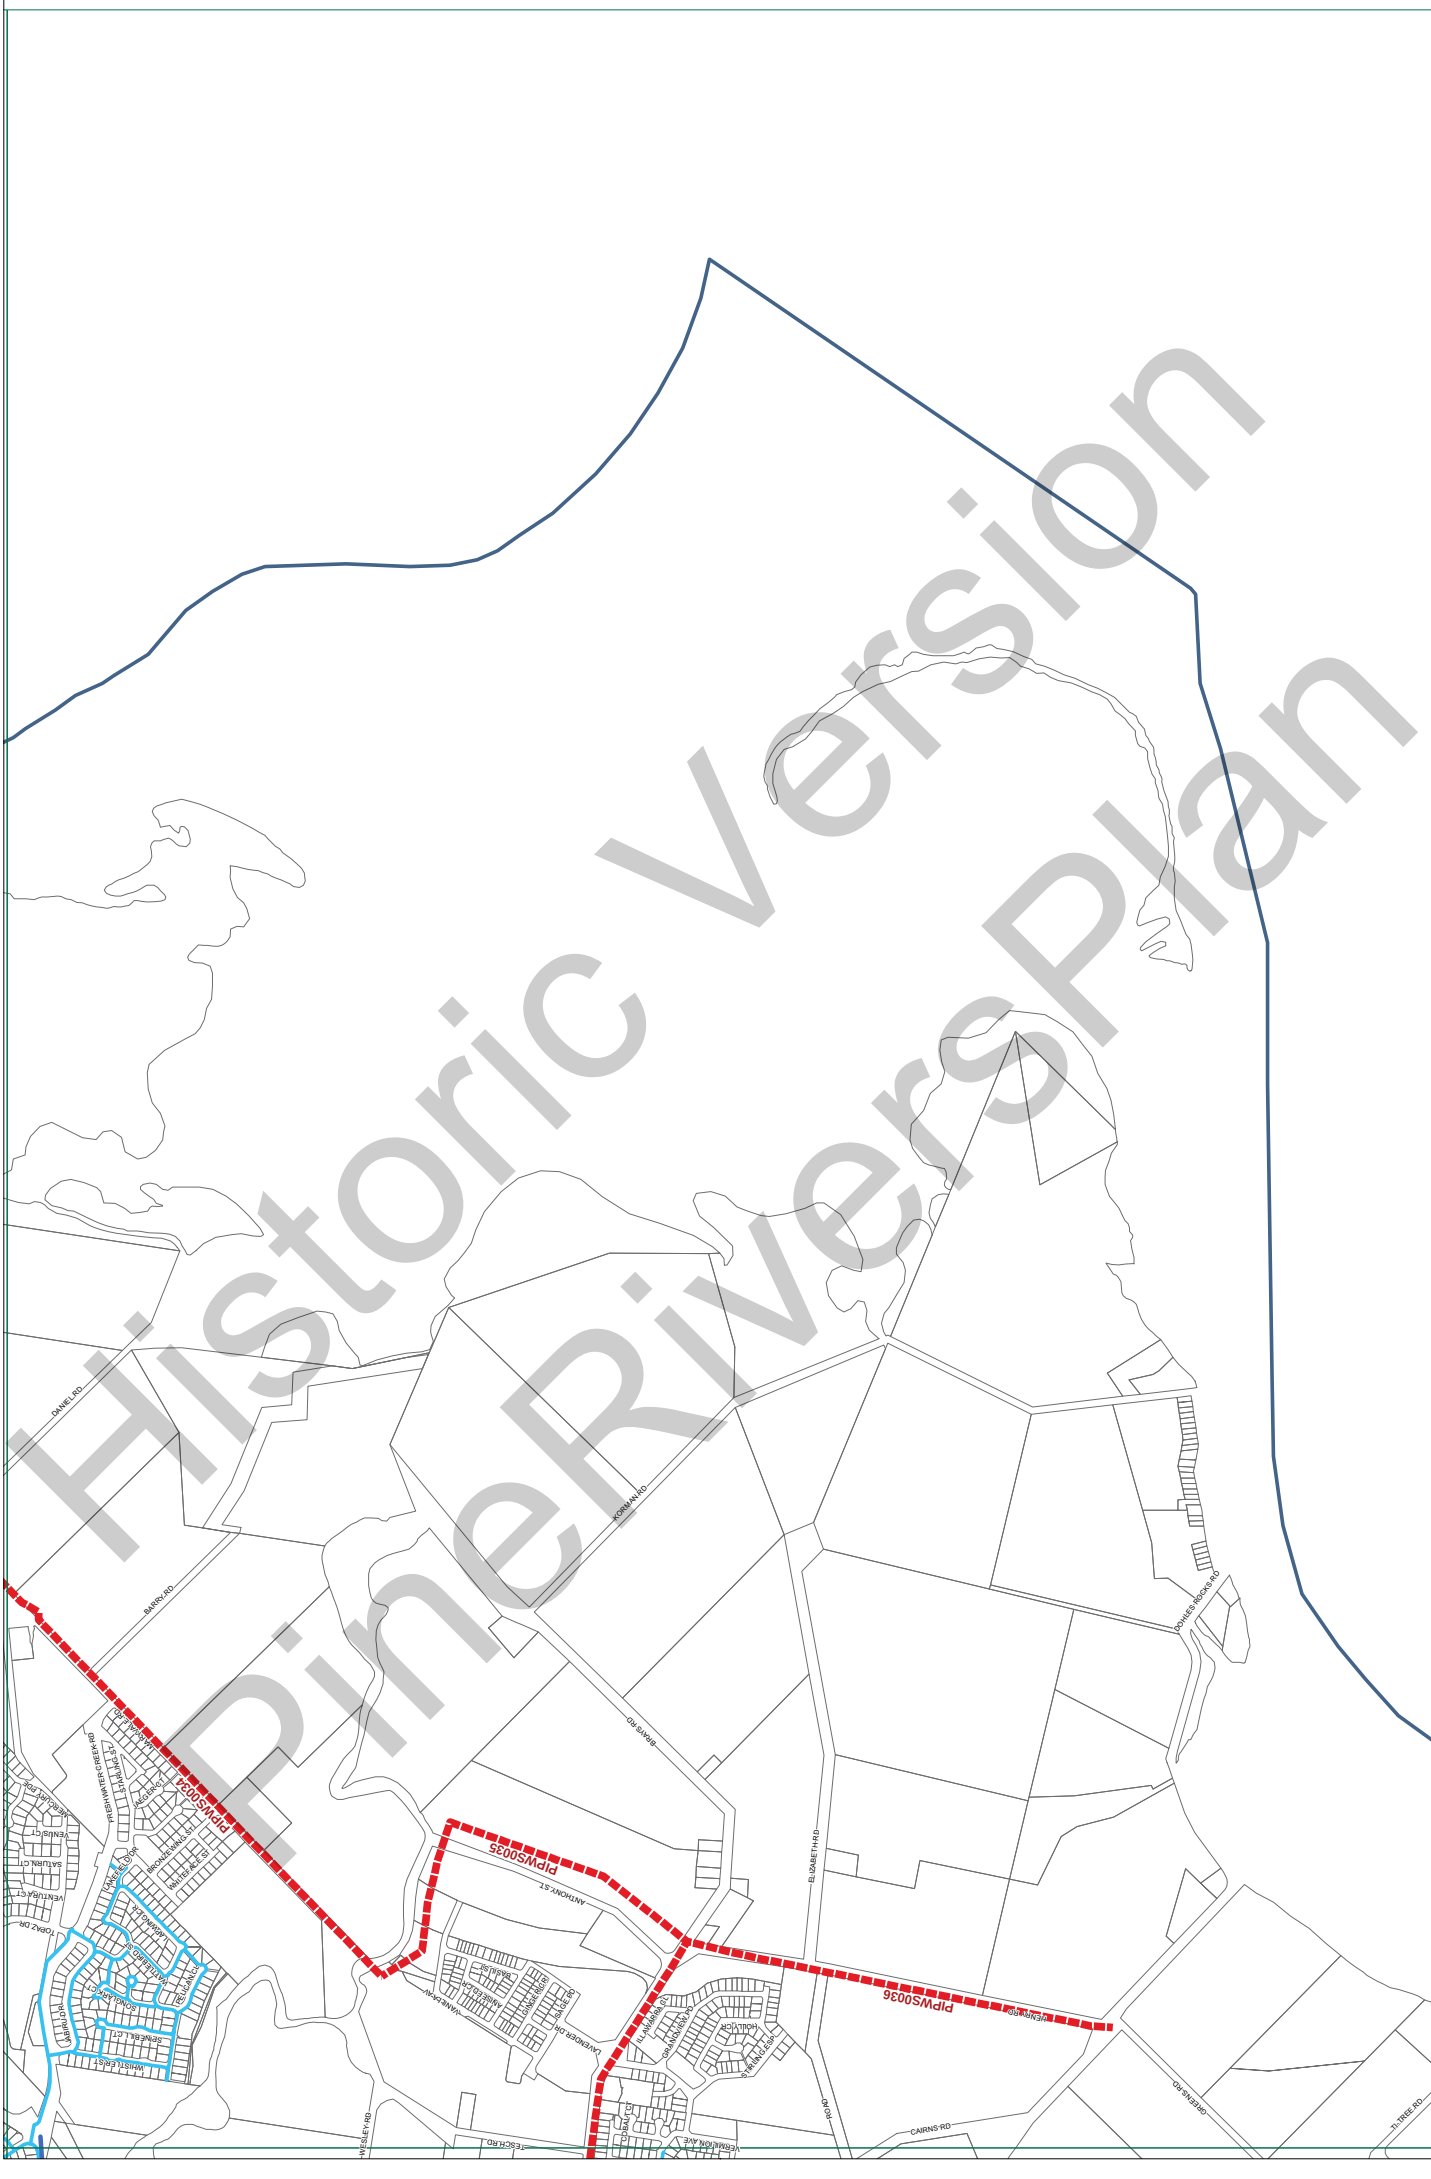

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details are for general information only and are not to be used for any purpose other than that for which they were prepared. The Council is not responsible for any errors or omissions in the map or for any loss or damage arising from its use. The Council is not responsible for any loss or damage arising from its use. The Council is not responsible for any loss or damage arising from its use.

- Water Route
- Pine WM Pipes
- Water Treatment Plants
- Existing Bulk Meters
- Existing Water Pumps
- Future Water Pumps
- Existing Reservoirs
- Future Reservoirs
- Lake Kurungbush Facilities
- Future Water Reservoirs




11.11	11.13
13.11	13.13

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009




11.7	11.9	11.11
13.7	13.9	13.11
15.7	15.9	15.11



-  WATER ROUTE
 PINE WM PIPES
 Water Treatment Plants
 Existing Bulk Meters
 Existing Water Pumps
 Future Water Mains
 Future Water Pumps
 Existing Reservoirs
 Future Water Reservoirs

Copyright: Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details are supplied from information contained in the Council's records which may have been furnished to the Council by other persons. Moreton Bay Regional Council gives no warranty or guarantee of any kind, expressed, implied, or statutory, to the correctness or accuracy of the map details of the Council's records. Mapping details must not rely upon the map details shown on the plan for the purpose of determining whether any particular plot or circumscribed area, and the Moreton Bay Regional Council or legal institutions must not rely upon the map details shown on the plan for the purpose of determining whether any particular plot or circumscribed area, and the Moreton Bay Regional Council (and its officers and agents) expressly disclaim responsibility for any loss or damage suffered as a result of placing reliance upon this information.






0 62.5 125 250 375 500
Metres

Base material supplied to the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006


Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and should not be used for any purpose other than that for which
it was prepared. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness. Moreton Bay Regional Council is not responsible for any errors or
omissions or for any consequences arising from the use of this map. Moreton Bay Regional Council
accepts no liability for any loss or damage, whether direct or indirect, arising from the use of this map.

- WATER ROUTE
- PINE WM PIPES
- Water Treatment Plants
- Existing Bulk Meters
- Existing Water Pumps
- Future Water Pumps
- Future Water Mains
- Future Water Reservoirs
- Future Water Reservoirs



11.9	11.11	11.13
13.9	13.11	13.13
15.9	15.11	

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009

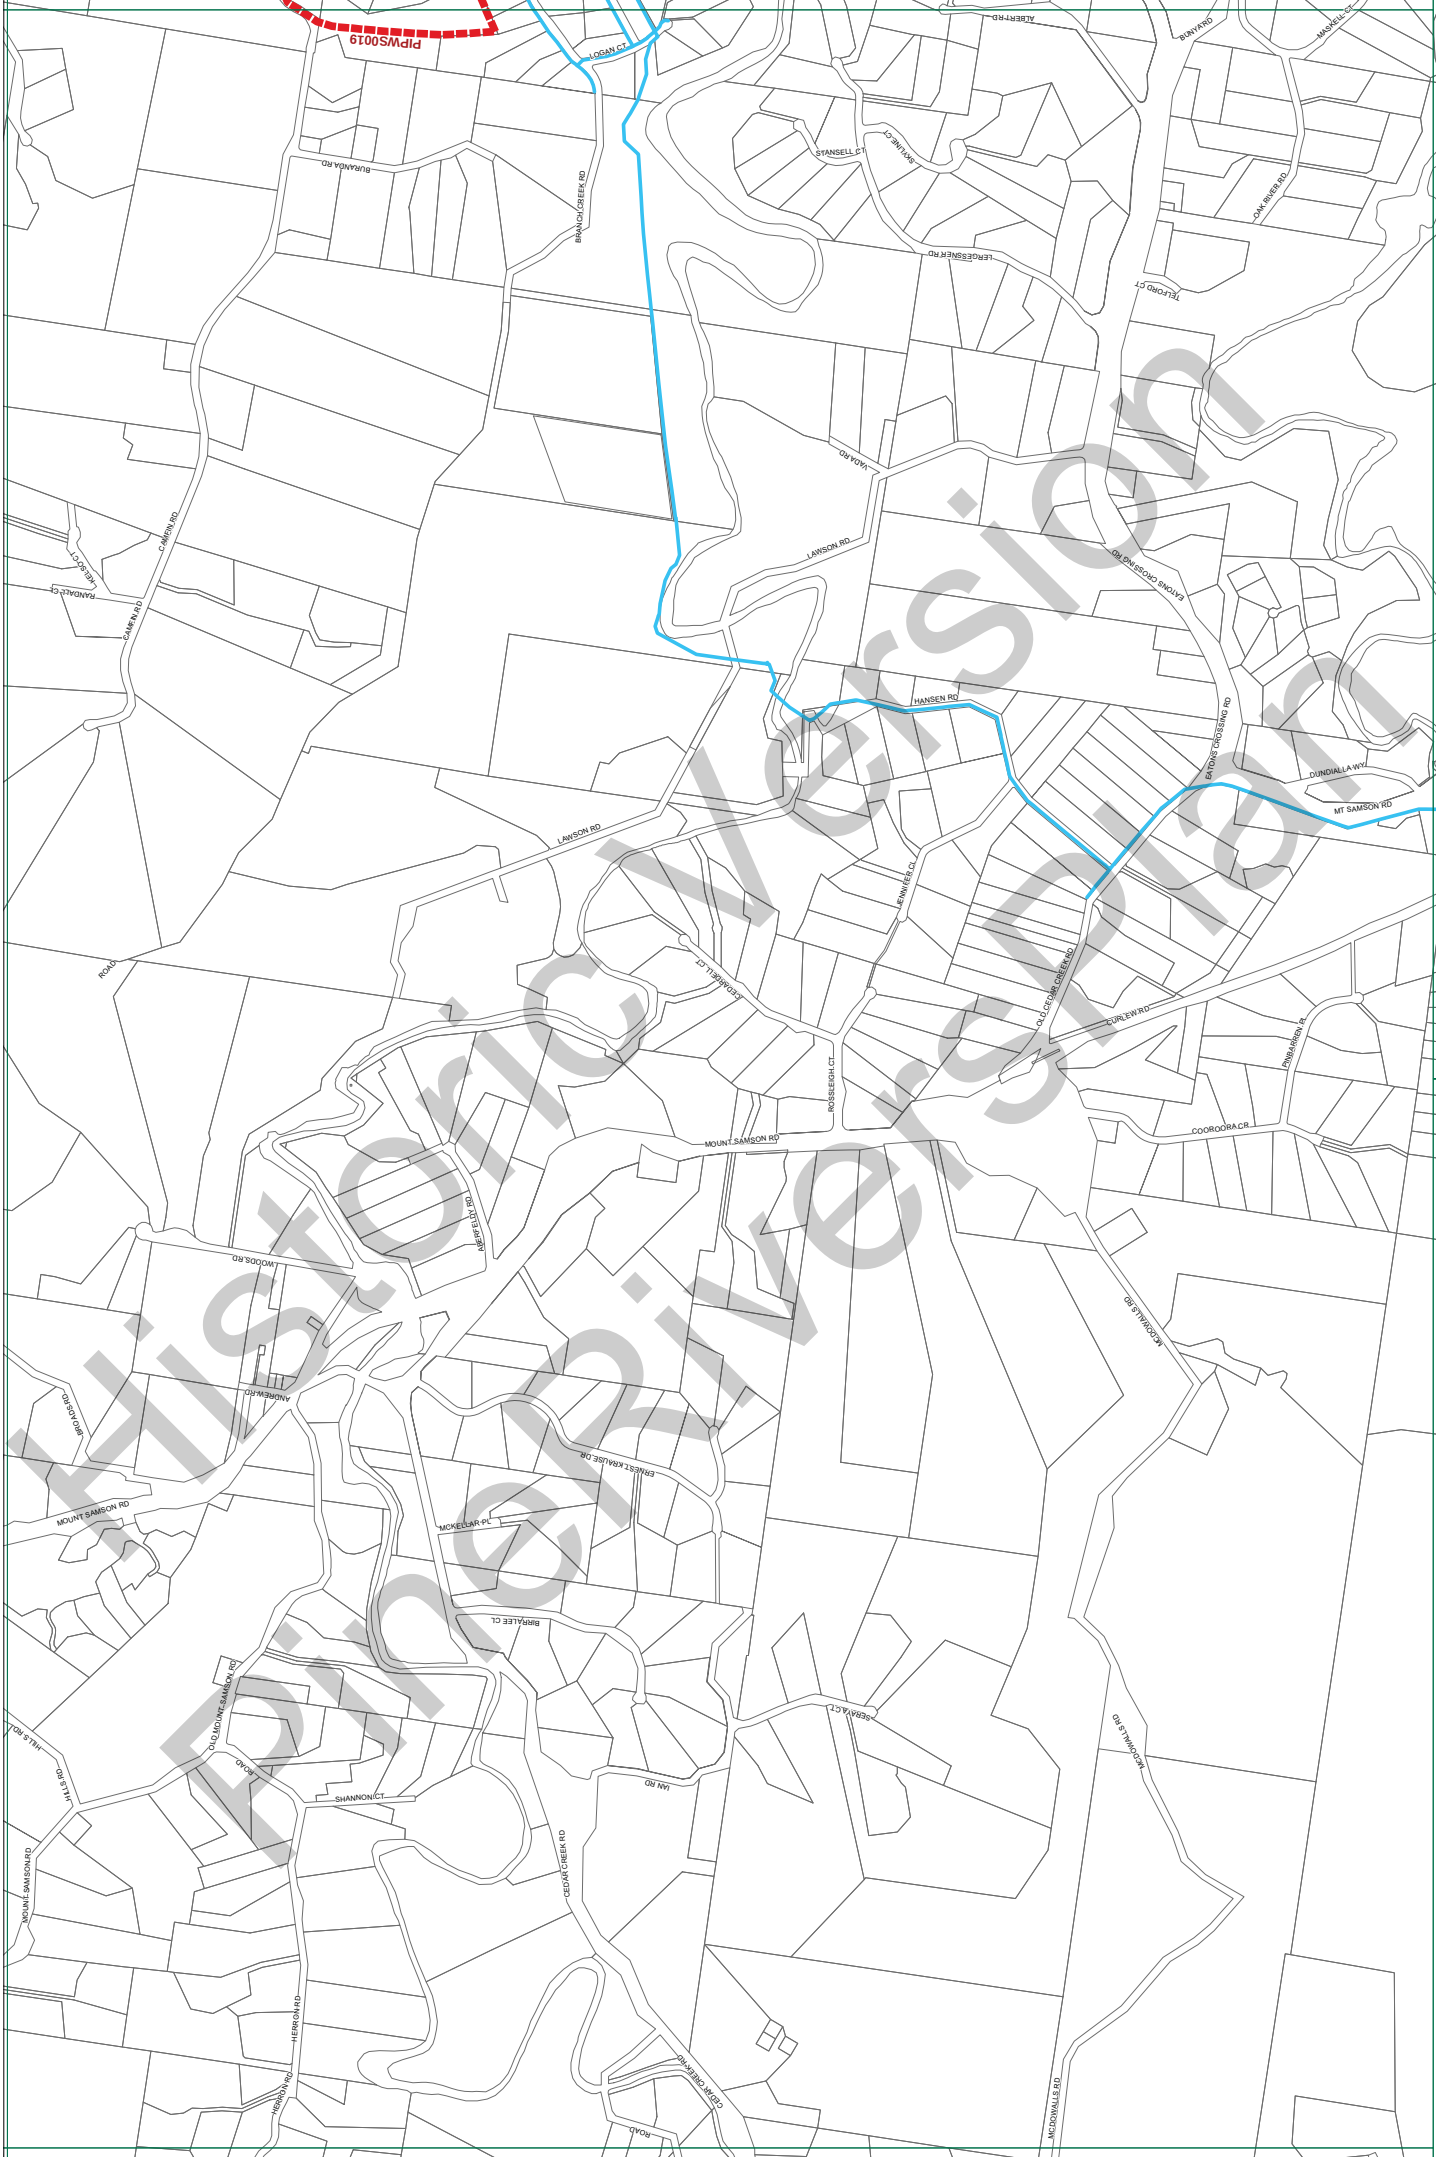


0 62.5 125 250 375 500
Metres

Base material supplied by the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006


Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and should not be used for any purpose other than that for which
it was prepared. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness. Moreton Bay Regional Council is not responsible for any loss or damage
arising from or in connection with the use of this map. Moreton Bay Regional Council is not
responsible for any loss or damage arising from or in connection with the use of this map.
Council (and its officers and agents) expressly disclaims responsibility for any loss or damage
arising from or in connection with the use of this map.

- Water Route
- Water Treatment Plants
- Water Wm Pipes
- Existing Bulk Meters
- Existing Water Pumps
- Future Water Pumps
- Existing Reservoirs
- Future Reservoirs
- Lake Kurungbarr Facilities
- Future Water Reservoirs



13.5	13.7	13.9
15.5	15.7	15.9
17.6	17.8	

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009

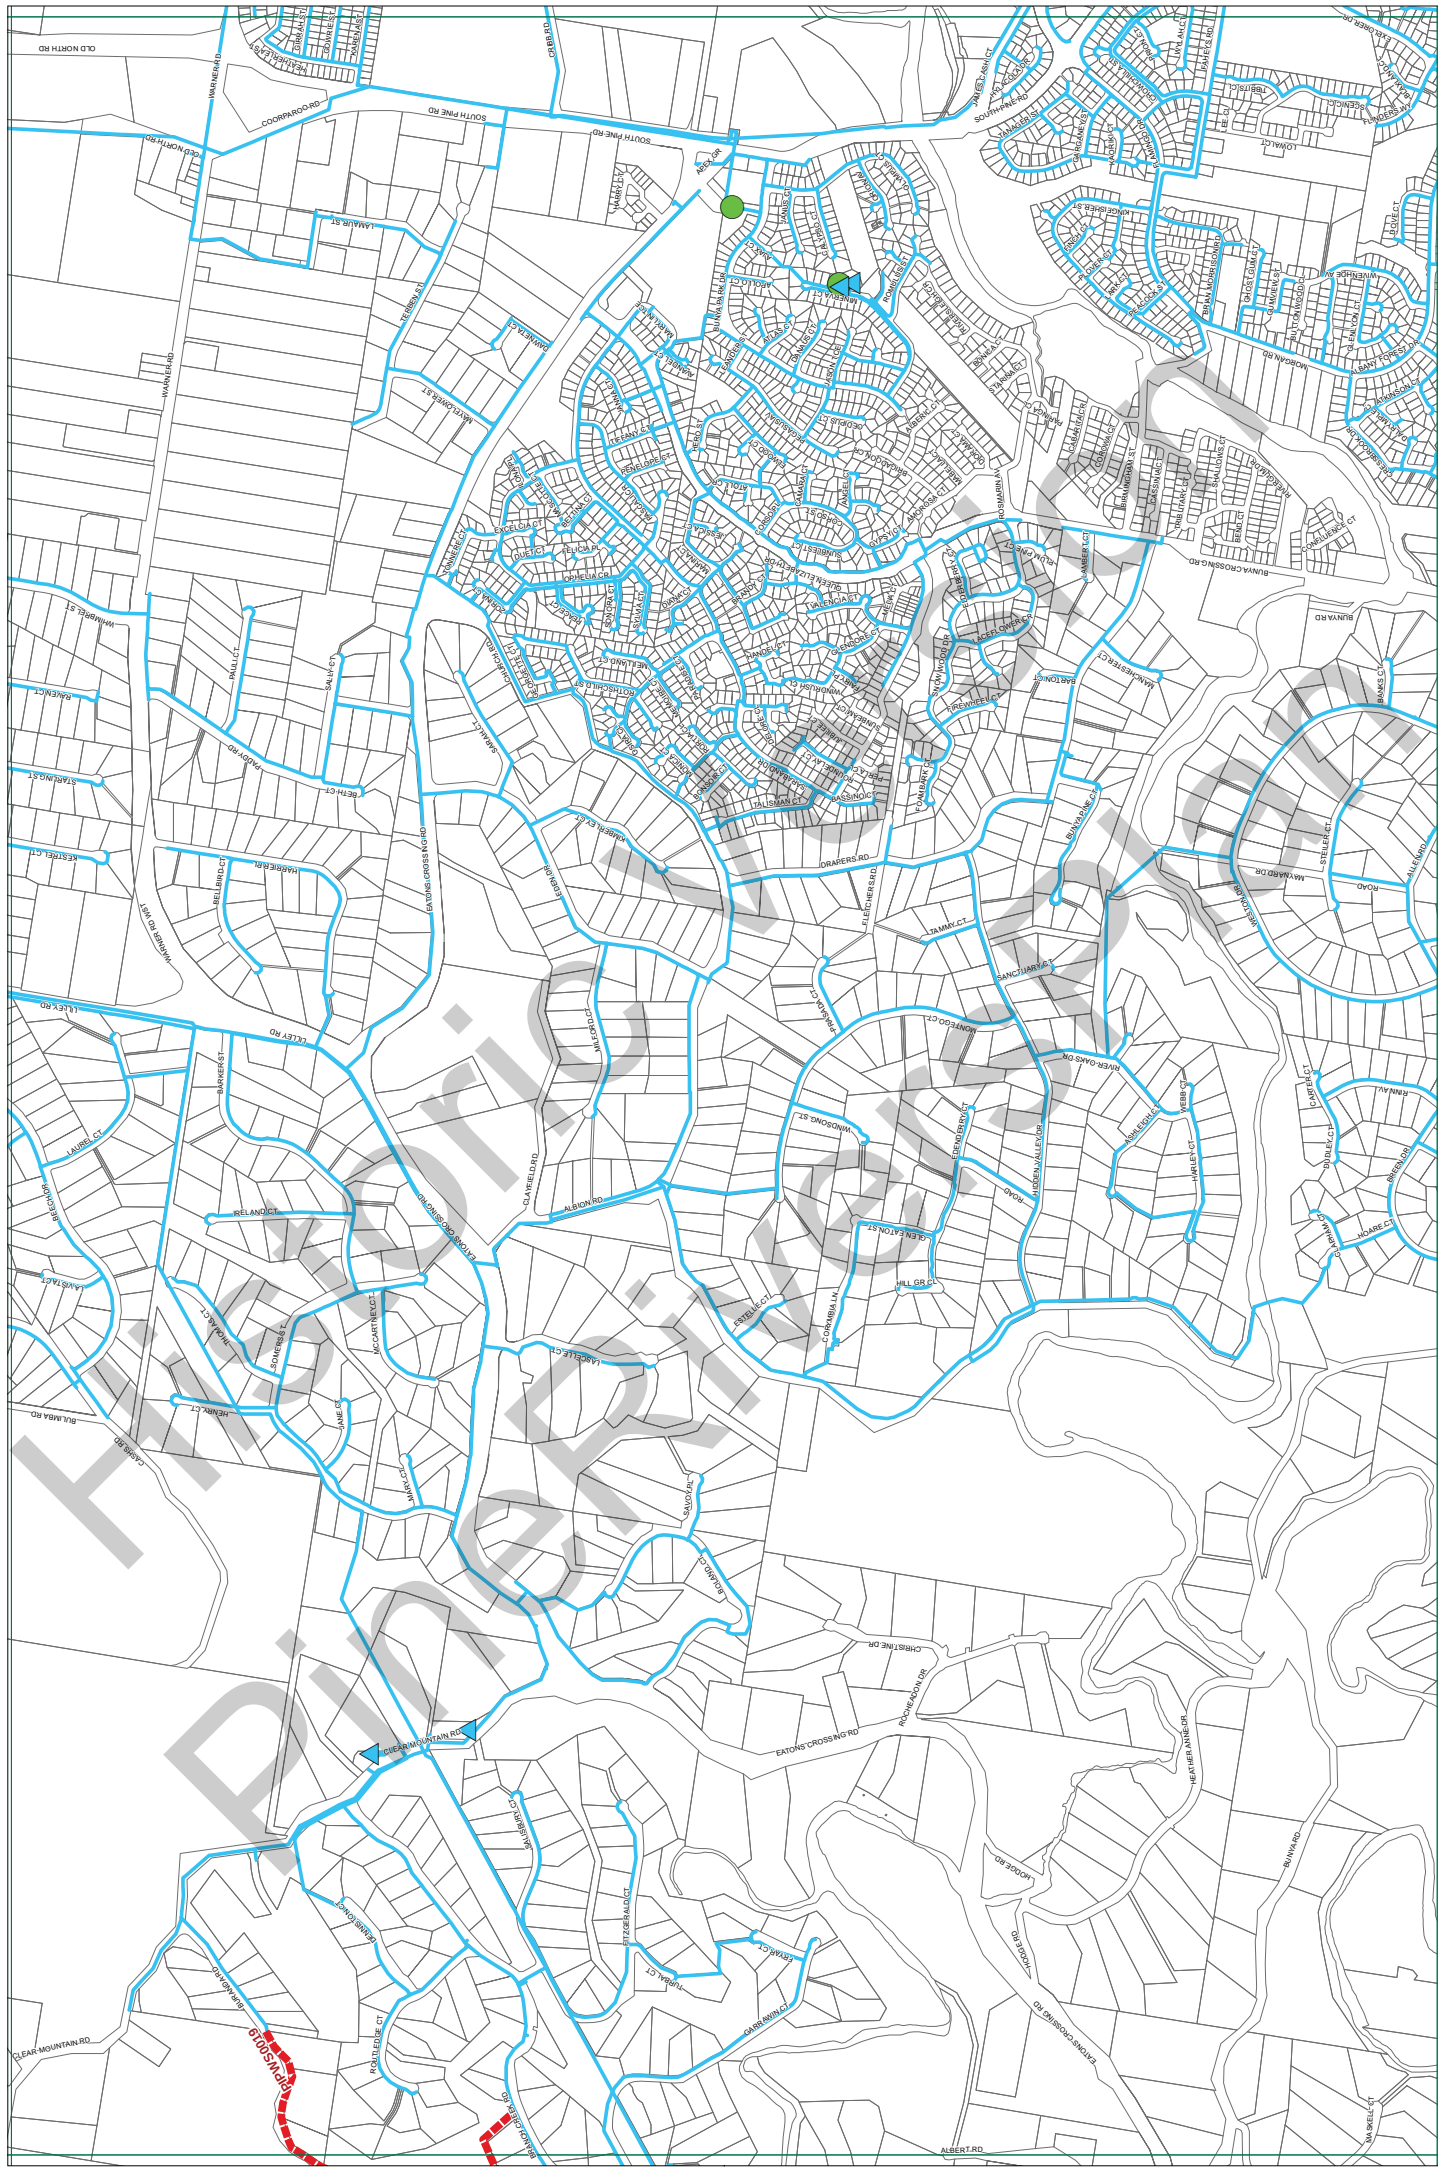



13.7	13.9	13.11
15.7	15.9	15.11
17.8		17.10



- WATER ROUTE
 PINE W/ PIPE
 WATER TREATMENT PLANTS
 EXISTING BULK METERS
 EXISTING WATER PUMPS
 FUTURE WATER MAINS
 FUTURE WATER PUMPS
 EXISTING RESERVOIRS
 FUTURE WATER RESERVOIRS

Copyright Merion Bay Regional Council and Department of Natural Resources and Wildlife
Merion Bay Regional Council supplies this map under the following conditions: Mapping details
are supplied from information contained in the Council's records which may have been furnished
to the Council by other persons. Merion Bay Regional Council gives no warranty or guarantee
as to any level, expressed implied, or statutory, to the correctness or accuracy of the map details or
any detail of compliance with any Council's policies in this matter. Persons making decisions with
reference to high potential flood risk areas prior to April the map was issued and the Merion Bay
Council (and its officers and agents) accept legal responsibility for any loss or damage
suffered as a result of placing reliance upon this information.



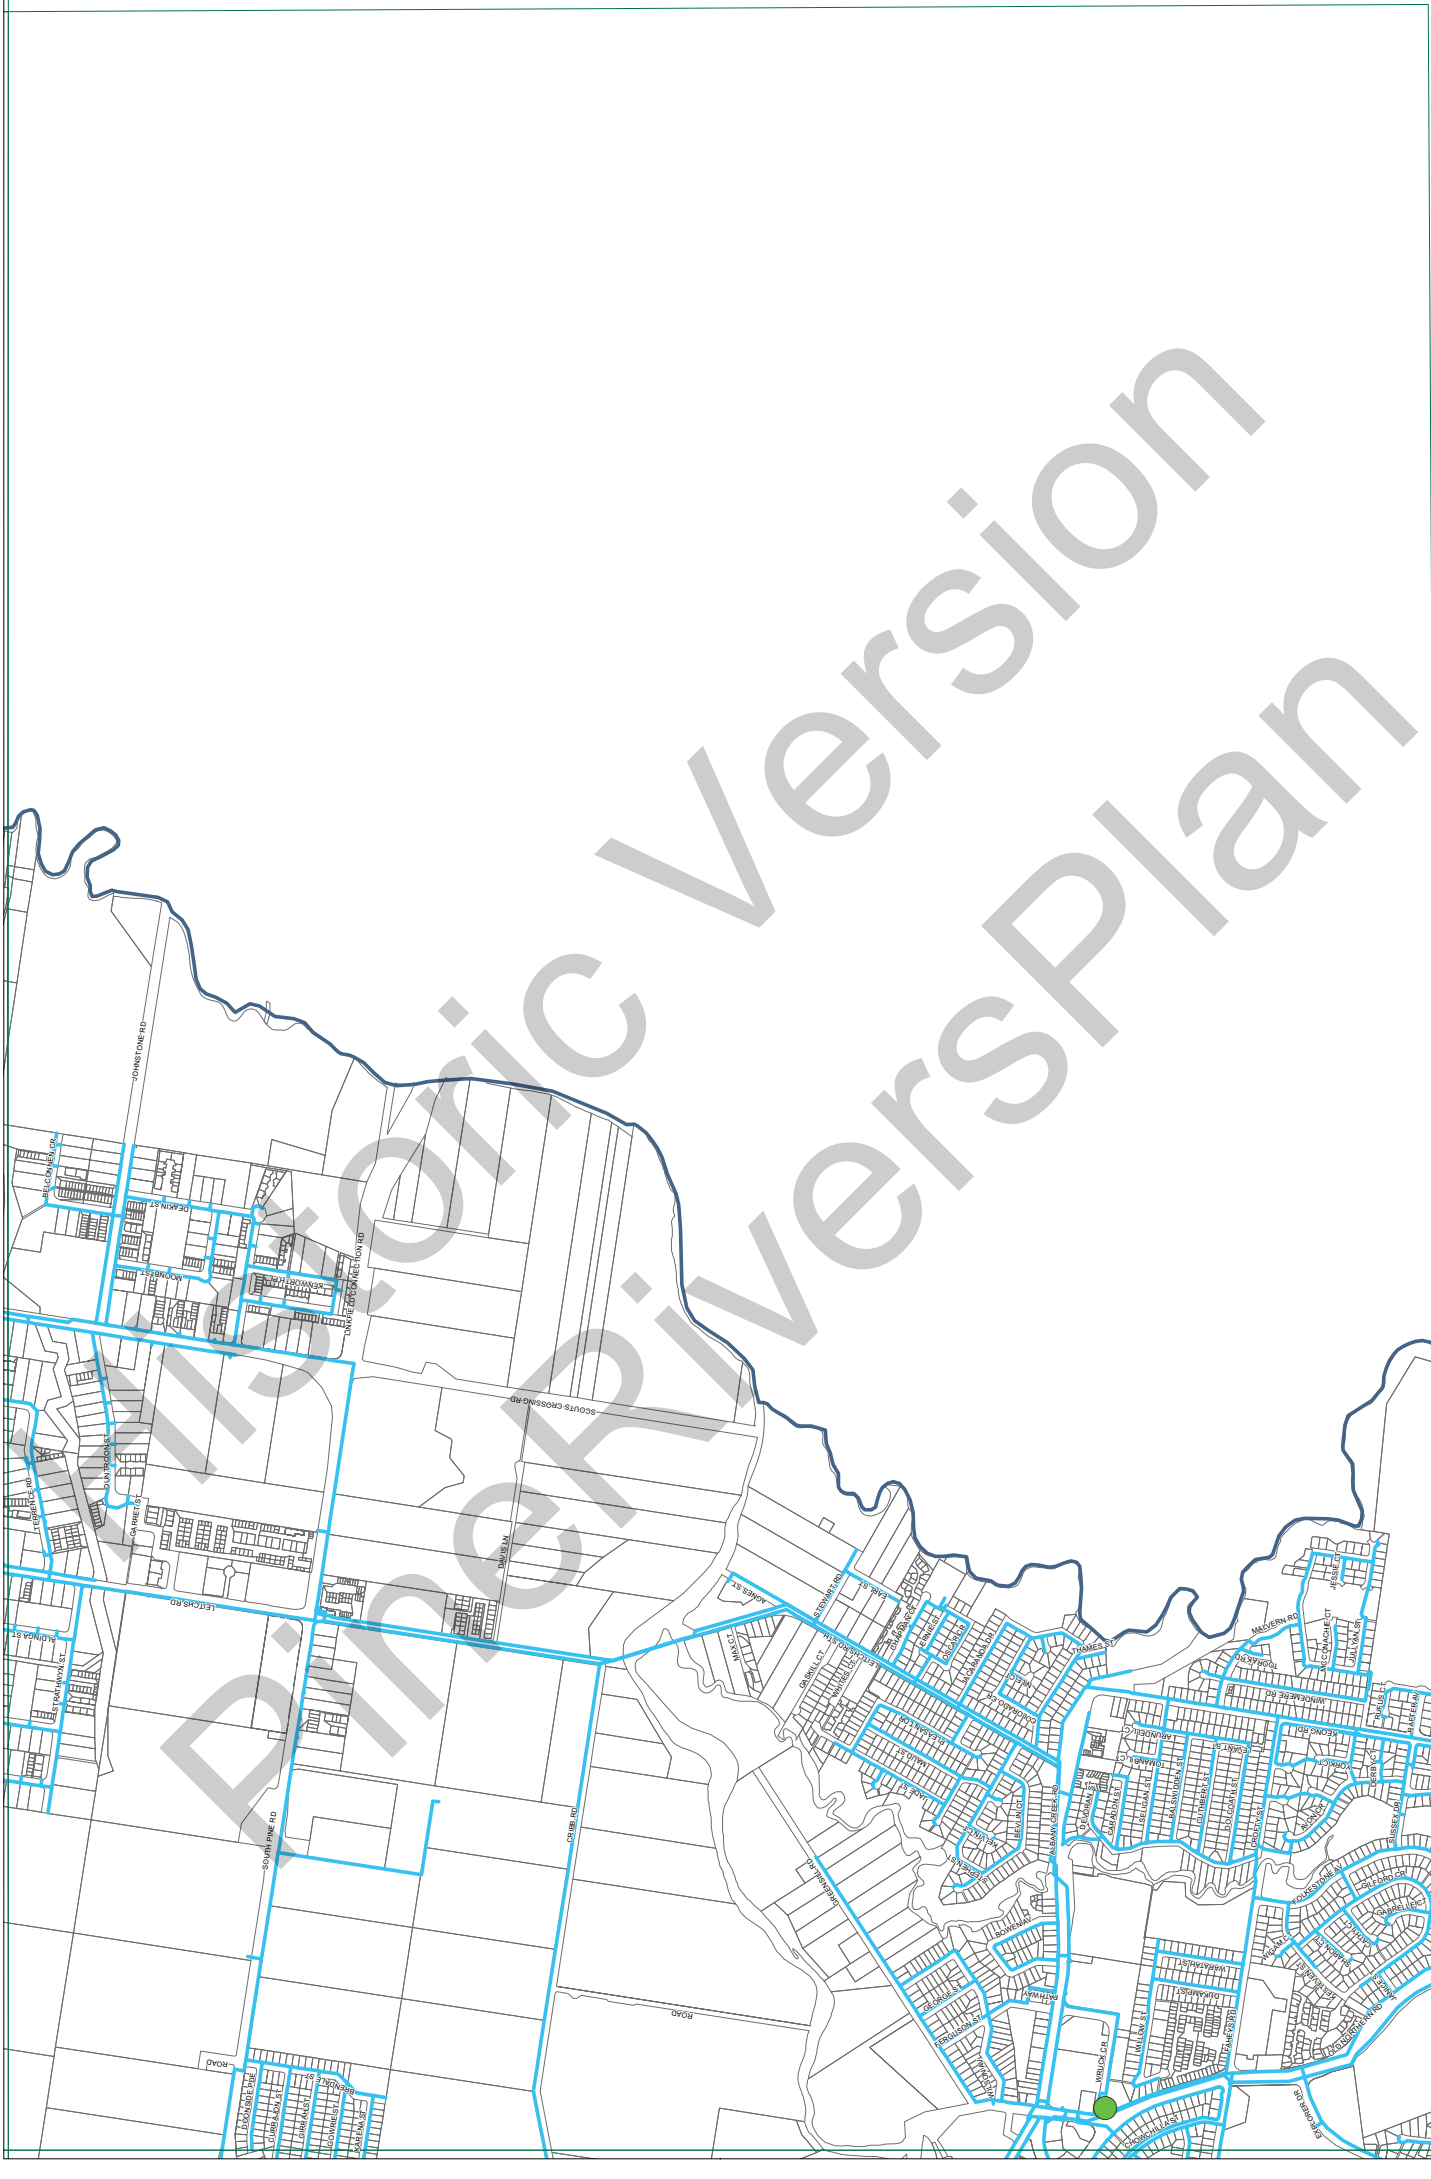

0 62.5 125 250 375 500
Metres

Base material supplied under the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006

Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and are not to be used for any purpose other than that intended.
In the Council's opinion, Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness to the map. The map is provided as a guide only. The Council
accepts no responsibility for any loss or damage arising from the use of the map.
Council (and its officers and agents) expressly disclaims responsibility for any loss or damage
arising from the use of the map.

WATER ROUTE
— WATER ROUTE
— PINE WM PIPES
— WATER TREATMENT PLANTS

EXISTING BULK METERS
● EXISTING BULK METERS

EXISTING WATER PUMPS
● EXISTING WATER PUMPS

EXISTING RESERVOIRS
▲ EXISTING RESERVOIRS

LAKE KUNWONGSHI FACILITIES
▲ LAKE KUNWONGSHI FACILITIES

FUTURE WATER MAINS
■ FUTURE WATER MAINS

FUTURE WATER PUMPS
● FUTURE WATER PUMPS

FUTURE WATER RESERVOIRS
▲ FUTURE WATER RESERVOIRS

13.11 13.13
15.11

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY NETWORK ASSETS
Map Number 15.11




0 62.5 125 250 375 500
Metres

Base material supplied to the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006


Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and do not constitute a guarantee of accuracy. The Council
accepts no liability for any errors or omissions. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness. Moreton Bay Regional Council is not responsible for any loss or damage
arising from the use of this map. The Council is not responsible for any loss or damage
arising from the use of this map. The Council is not responsible for any loss or damage
arising from the use of this map.

- WATER ROUTE
- WATER WM PIPES
- Water Treatment Plants
- Existing Bulk Meters
- Existing Water Pumps
- Future Water Pumps
- Existing Reservoirs
- Future Reservoirs
- Future Water Mains
- Future Water Reservoirs



15.5	15.7	17.4	17.6	17.8
19.4	19.6	19.8	19.9	20.1

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009

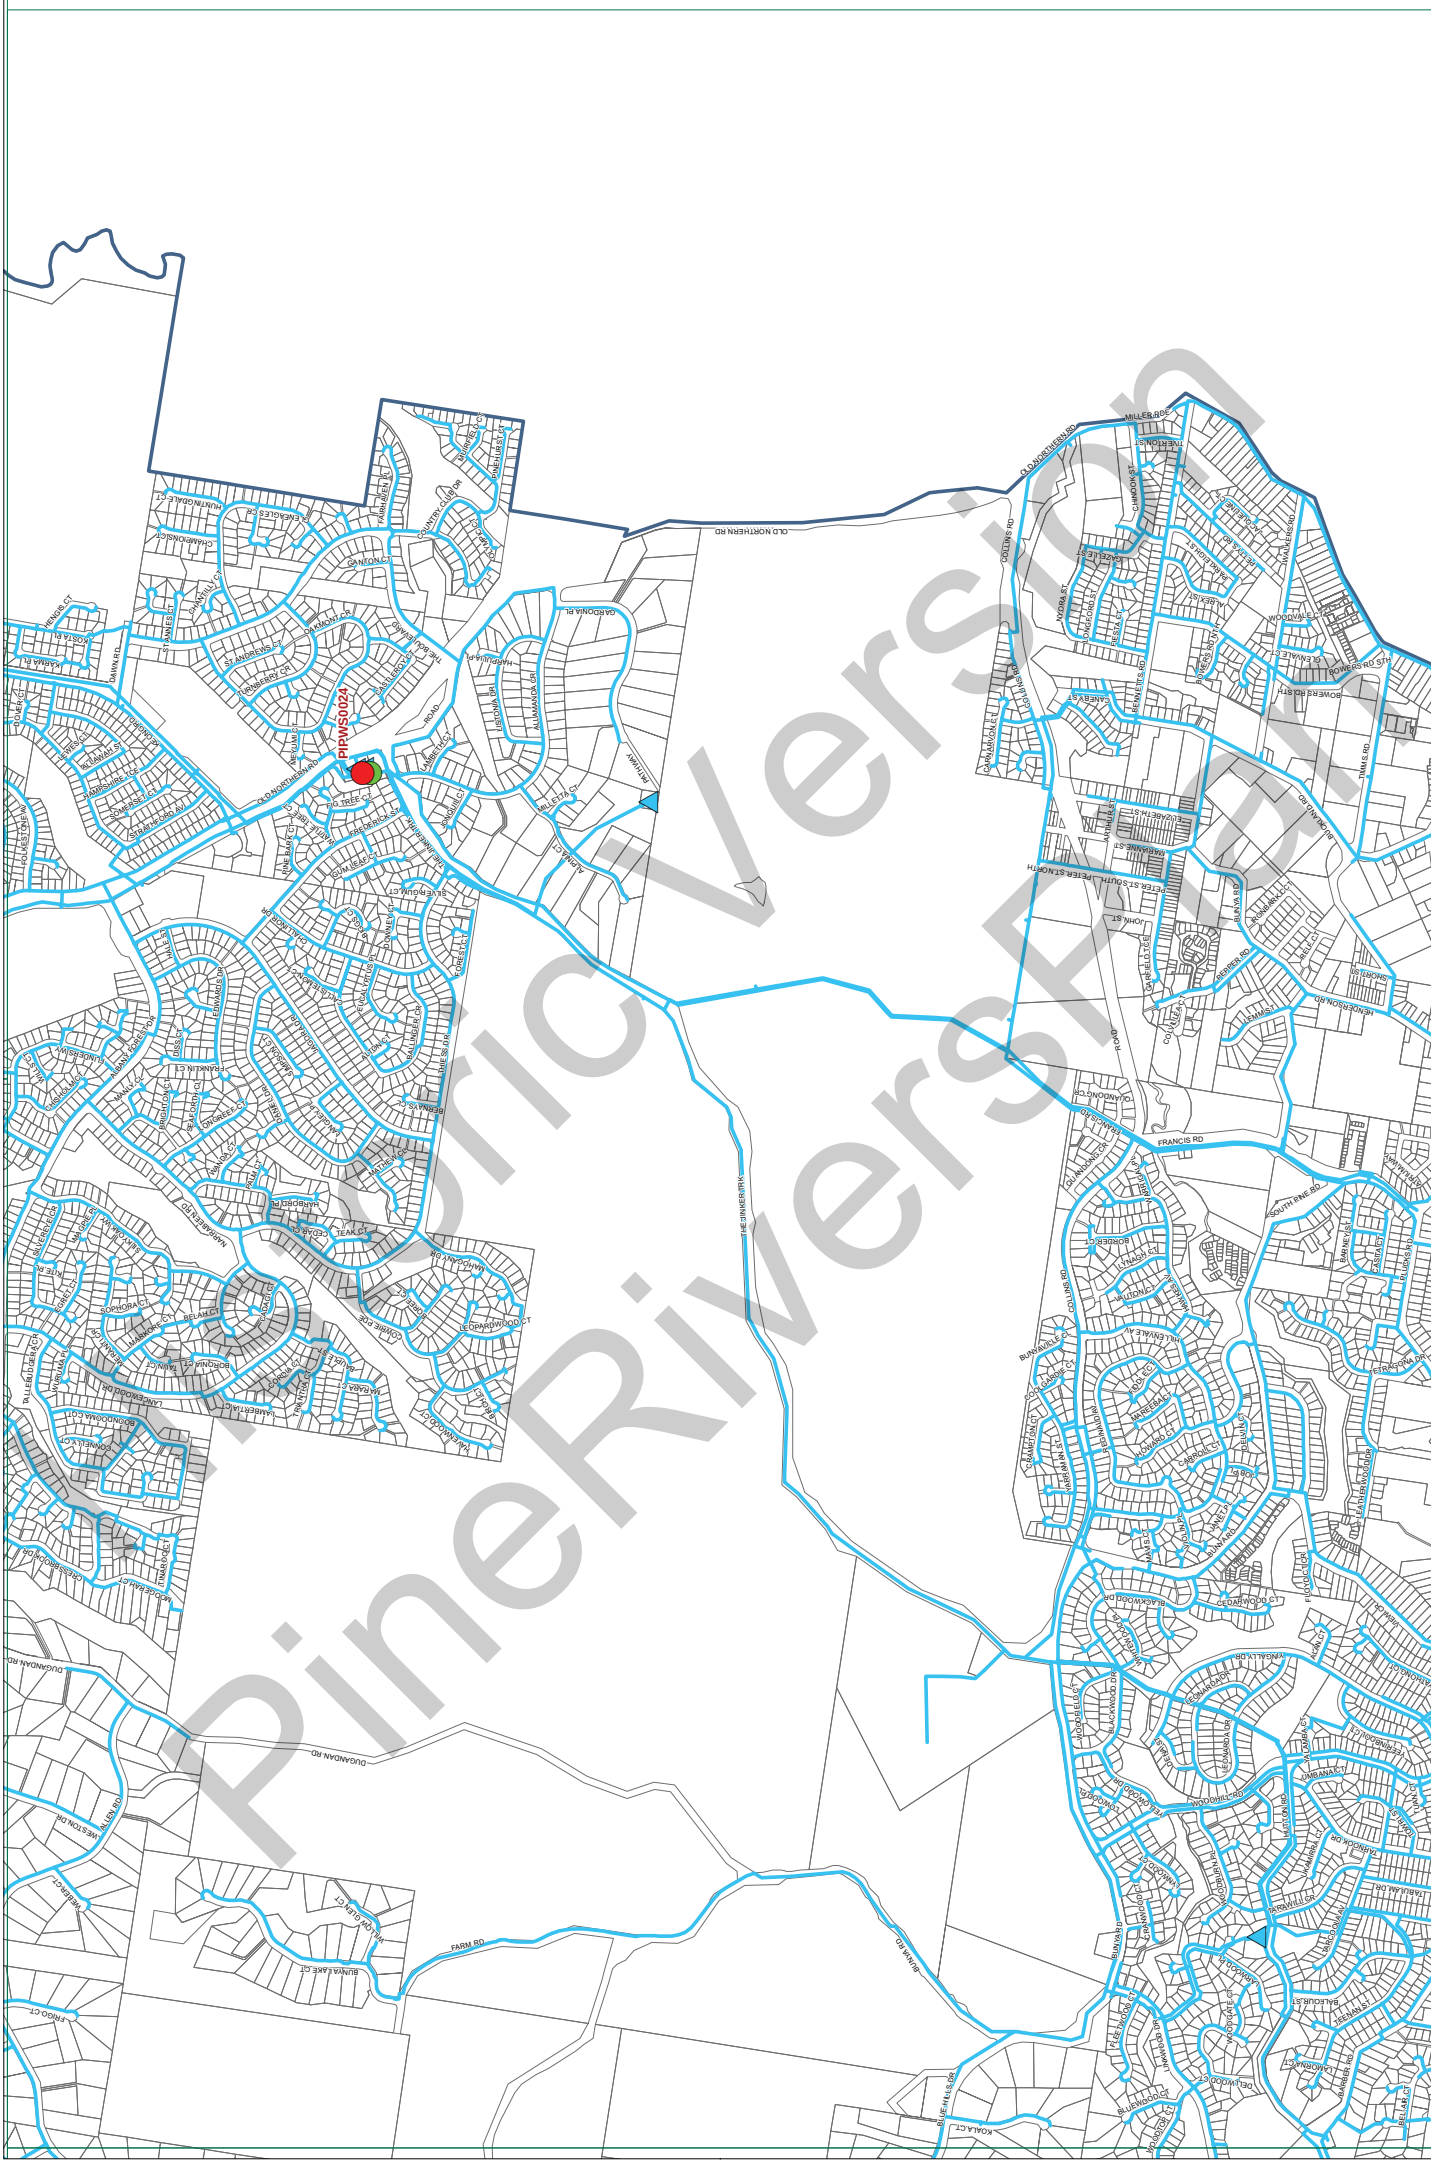


0 62.5 125 250 375 500
Metres

Base material supplied under the permission of the
Director-General, Dept. of Natural Resources.
Copyright The State of Queensland
Copyright Pine Rivers Shire Council 2006



Copyright Moreton Bay Regional Council and Department of Natural Resources and Water
Moreton Bay Regional Council supplies this map under the following conditions: Mapping details
are for general information only and do not constitute a warranty or guarantee of accuracy.
The Council is not responsible for any errors or omissions. Moreton Bay Regional Council gives no warranty or guarantee of
accuracy or completeness. Users of this map do so at their own risk. The Council is not responsible for any errors or omissions.
Users of this map do so at their own risk. The Council is not responsible for any errors or omissions.
Council (and its officers and agents) disclaims all liability for any loss or damage.

- WATER ROUTE
- PINE WM PIPES
- Water Treatment Plants
- Existing Bulk Meters
- Existing Water Pumps
- Future Water Pumps
- Existing Reservoirs
- Future Reservoirs
- Lake Kurungbush Facilities
- Future Water Reservoirs





15.7	15.9	15.11
17.8	17.10	19.10
19.8	19.10	

PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009

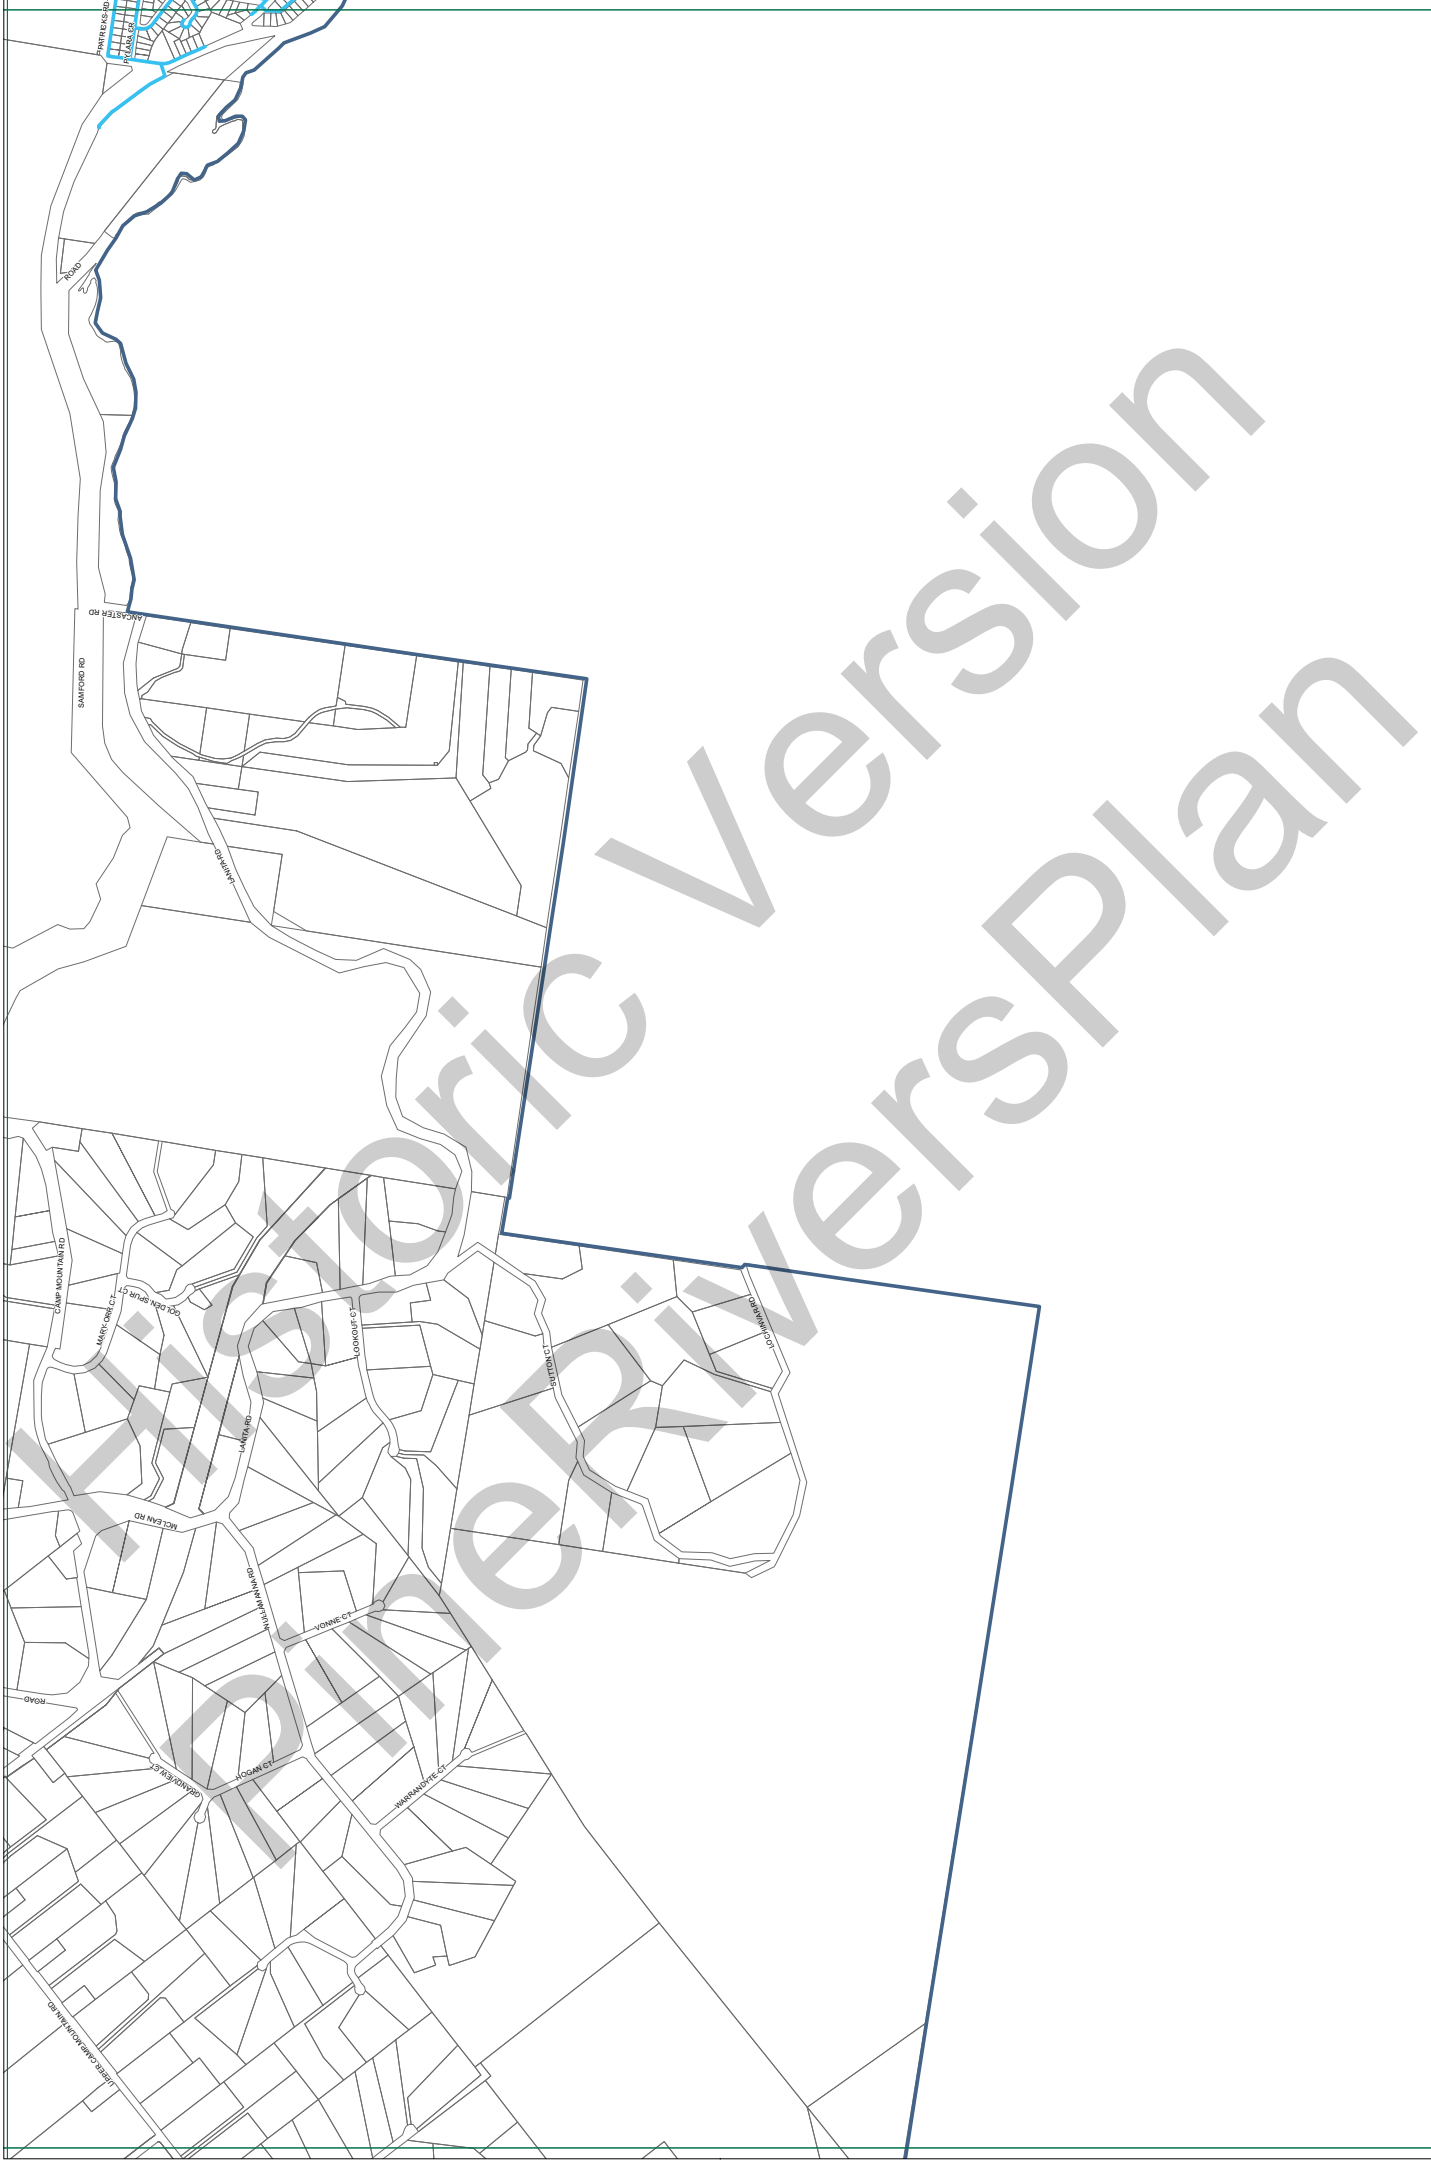

17.6	17.8	17.10
19.6	19.8	19.10

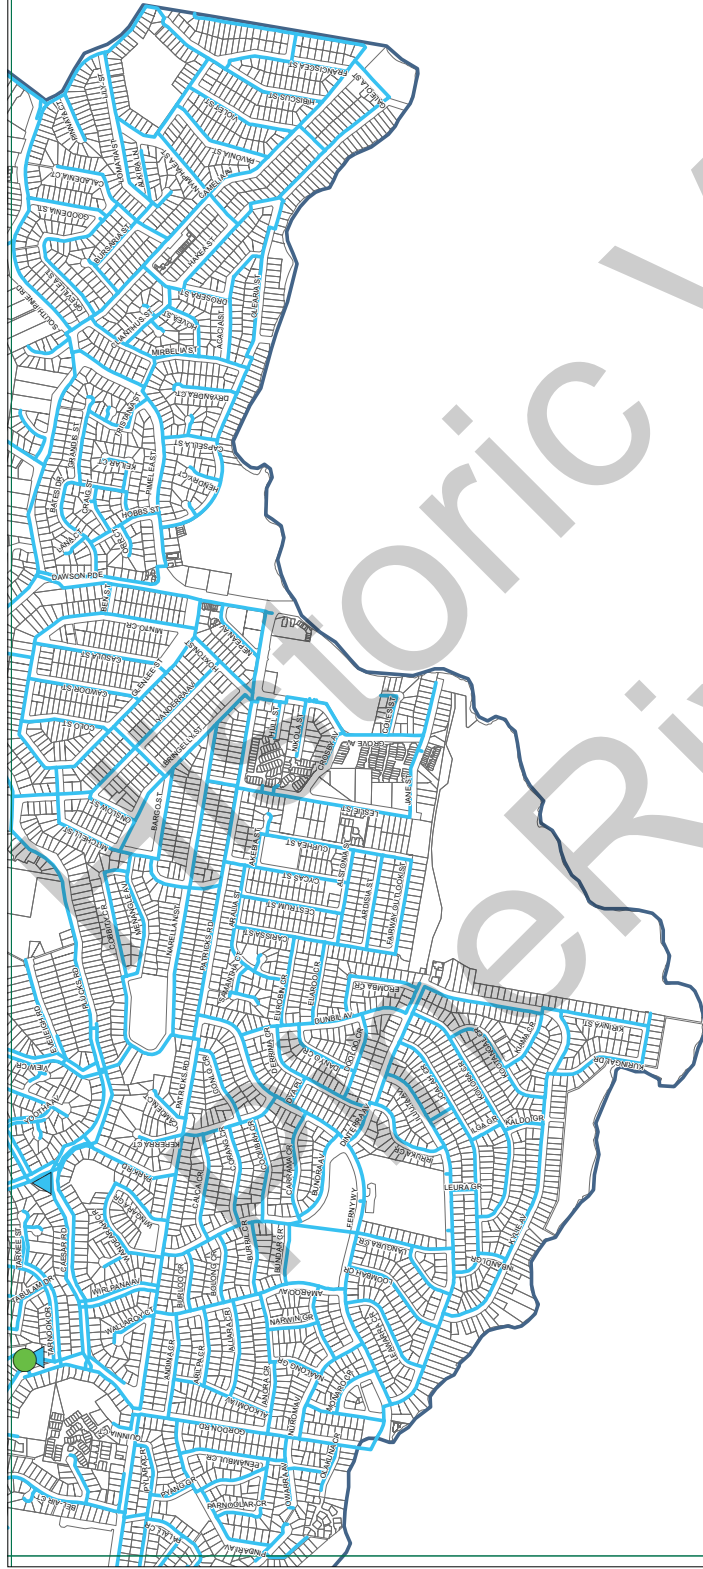

Copyright Merston Bay Regional Council and Department of Natural Resources and Water
Merston Bay Regional Council supplies this map under the following conditions:- Mapping details
are supplied from information contained in the Council's records which may have been furnished
to the Council by other persons. Merston Bay Regional Council gives no warranty or guarantee of
any kind, expressed or implied, to the correctness or accuracy of the map details or the
degree of compliance with any Council standards in this matter. Persons making decisions with
financial or legal implications must not rely on the map details shown on the plan for the purpose
of determining whether any particular title or circumstances thereof and the Merston Bay Regional
Council (and its officers and agents) expressly disclaim responsibility for any loss or damage
suffered as a result of (relying) placing reliance upon this information.

-  WATER ROUTE
 PINE WM PIPES
 Water Treatment Plants
 Existing Bulk Meters
 Lake Kurungbuh Facilities
 Existing Water Pumps
 Future Water Reservoirs
 Future Water Mains



PLANNING SCHEME POLICY PSP22
DEVELOPMENT CONTRIBUTIONS FOR
TRUNK INFRASTRUCTURE -
WATER SUPPLY
EFFECTIVE FROM 29 October 2009

MORETON BAY REGIONAL COUNCIL
Pine Rivers Shire
WATER SUPPLY NETWORK ASSETS
Map Number 19.10

Schedule E: Desired Standards of Service

The Desired Standards of Service (DSS) for water supply and sewerage trunk infrastructure within the Designated Infrastructure Service Area have been determined in accordance with the requirements of the Water Supply (Safety and Reliability) Act 2008. Moreton Bay Water's approved Strategic Asset Management Plan and Total Management Plan detail ongoing practice and future initiatives to achieve and maintain the published standards of service.

The Desired Standards of Service for water supply and sewerage infrastructure provision under this policy are expressed in terms of 'Operational Objectives' and 'Detailed Design Parameters'.

The 'Operational Objectives' and 'Detailed Design Parameters' are aimed at achieving the stated purpose of the Integrated Planning Act while satisfying the relevant requirements of the Environmental Protection Act. The detailed design parameters are the means by which the performance requirements of the operational objectives are achieved.

The Guidelines prepared by the Queensland Government for design of urban water supply and a survey of current practice of local governments in South-East Queensland have also been used in establishing the desired standards of service and design criteria for the water supply systems. Authorities that were consulted to confirm current practice in South-East Queensland included Ipswich Water, Redland Water, Brisbane Water, former CalAqua, former Cooloola Shire, Wide Bay Water, Logan Water and Gold Coast Water.

Operational Objectives for Trunk Water Supply Services

Each of the 'Operational Objectives' for the provision of water supply services in Moreton Bay Regional Council's local government area is examined in the context of corresponding user benefits and environmental effects. The Primary Objectives adopted for water services in this policy are set out in Table E1.

Table E1 – Water Supply Operational Objectives

Objective	User Benefit	Environmental Effect
• Corporate / Business Objective	• Community and Customer Service • Quality and Safety	• Environmental Protection
Drinking water will comply with the Australian Drinking Water Guidelines.	- Uniform quality of water monitored in relation to recognised standards. - Safe and reliable water supply	Improves community health
Designs will comply with State Government Guidelines, and Council's Planning Scheme Policy PSP 28 "Civil Infrastructure Design".	- System will be adequate in terms of; - day-to-day reliability, - long term continuity of supply; - delivery of high quality drinking water to the consumer ;and - minimum life cycle cost (i.e., optimum maintenance, replacement and operation costs). - Cost effective service for community.	- Maintains the health of the community. - Chemicals are stored and handled in accordance with relevant legislation to ensure safety of worker, public safety and to protect the environment. - Minimisation of Greenhouse gas emissions. - Optimum use of resources.
Minimise water loss	- Extend asset life - Defer system augmentation - Conserve raw water supply - Minimise energy consumption - Optimise size of elements within water supply network.	- Improve environmental flows - Minimisation of Greenhouse gas emissions.
Effective management of water consumption (Demand Management)	- Reduced cost of water - Defer requirement for new water source - Minimise energy consumption - Optimise size of elements within water supply network.	- Improve environmental flows - Minimisation of Greenhouse gas emissions.
Implement environmental responsibilities with respect to water supply operations	- Noise control - No adverse visual impact - Control of overflows from system. - Management of flushing water. - Maintain flows or storage in raw water sources for environmental purposes.	- Improves community health - Maintain amenity (e.g., visual and noise characteristics) of locality. - Reductions in discharges that have concentrations of free chlorine greater than 1 mg/l. - Control of discharge of turbid water to stormwater drainage

Objective	User Benefit	Environmental Effect
Corporate / Business Objective	- Community and Customer Service - Quality and Safety	Environmental Protection
		- during construction of infrastructure and flushing or scouring operations. - Required environmental flows maintained
System design will aim to minimise energy consumption and optimise the use of green energy	- Reduced energy costs. - Cost effective service for community.	
The design of the water supply network shall provide fire fighting flow and specified water pressures and flow to the consumer.	- Reliable water supply - Adequate supply for community services - Adequate pressures and flow for fire fighting purposes.	Maintains health and safety of the community.
Infrastructure will be designed, constructed and operated in accordance with Workplace Health and Safety Legislation.	Minimisation of risk to workers and community (reduction in accidents and insurance premiums).	- Minimise risk of pollution events. - Safer work environment for staff and public.

Detailed Design Parameters – Water Supply

Following an examination of the Queensland Government Guidelines and a survey of current practice of local governments in South East Queensland, Moreton Bay Regional Council has adopted the parameters summarised in Table E2 for design and assessment of water supply systems.

These factors are applied in accordance with procedures detailed in the Queensland Government Guidelines.

The summary outlined in Table E2 must be interpreted in conjunction with the design and construction standards for water supply set out in other Planning Scheme Policies of the relevant planning scheme.

Table E2 - Water Supply Design Parameters

Item	Description	Adopted Design Parameter
Water Demand		
1	Average Day Demand (AD)	Existing and Future Demand – 296 L/EPW/d AD is calculated as follows: $AD = (230 \times 1.2) + \text{System Losses}$ Where: 230 L/EPW/day is the demand target under SEQ 'permanent water conservation measures'; 1.2 is an operational flexibility factor that provides sufficient capacity to maintain an adequate level of service in the event that an element of the trunk infrastructure fails; and - System Losses = 20 L/EPW/day
Peaking Factors		
2	Mean Day Maximum Month (MDMM/AD)	1.2 x AD (355.2 L/EPW/day)
3	Maximum Day (MD/AD)	1.6 x AD (473.6 L/EPW/day)
4	Maximum Hour (MH/AD)	4.3 x AD (53.03 L/hr/EPW)
System Pressure		
5	Minimum Operating Pressure	- At maximum hour demand the minimum pressure at the water meter shall not be less than 22m. - In isolated high level areas, the minimum operating pressure may be reduced to 16 m above the highest elevation on any lot with the water level in the reservoir not more than 1.0 m above reservoir floor level.
6	Maximum Operating Pressure	80 m at the property's water meter
Fire Fighting Requirements		
7	System Pressure	12 m minimum pressure head at the hydrant/dedicated service location, and minimum 6m pressure head at any location in the water supply zone during the fire event with model conditions as detailed in Items 8, 9 and 10.
8	Fire Flow	Predominantly residential development not more than 3 storeys - 15 L/s

Item	Description	Adopted Design Parameter
		simultaneous with background demand as defined in Item 9 for a period of 2 hours.
		- Predominantly commercial/industrial and residential buildings greater than 3 storeys - 30 L/s simultaneous with background demand as defined in Item 9 for a period of 4 hours. - Special risk/hazard land use – to be assessed.
9	Background demand	- Predominantly Residential Area - 2/3 of MH demand - Predominantly Commercial/Industrial Area - MH demand (generally between 10 am to 4 pm)
10	Reservoir level	- At the commencement of the fire fighting event the reservoir level should be set at Mid-Water Level; where: Mid-Water Level = (Top Water Level + Floor Level) ÷ 2 (AHD). - The reservoir must not empty during the fire fighting event for the duration of the event specified in item 8 with supply pumps turned off.
Storage		
11	Design Condition	- Reservoirs must not empty in less than 3 consecutive MD demands. - During MDMM demand the reservoir shall have net positive inflow and shall be capable of continuous operation under this demand.
12	Ground Level Storage	Required Storage = [3 x (MD – MDMM)] + Fire Fighting Storage. Where: Fire Fighting Storage = 4 hrs of MDMM demand or 0.5 ML whichever is the greater.
13	Elevated Storage	Required Storage Volume = Operating Volume + Fire Fighting Reserve Where: - Operating Volume = 6 x (MH – 1/12 MDMM) - Fire storage = 150 kL
Pumping Capacity		
14	Duty pump capacity to serve ground level reservoirs.	Supply MDMM demand in 20 hours of operation in any 24 hour period.
15	Pumps serving elevated storage.	Pump must discharge not less than; [(6 x MH) – Operating Volume]/(6 x 3600) Where: Operating Volume is defined in item 13 above.
16	Standby Pump Capacity	Equal to the capacity of the largest pump
Pipeline Design		
17	Trunk Main Capacity	Sized for MDMM flows
18	Reticulation Capacity	Sized for Maximum Hour and Fire Flow
19	Friction Default Values	Hazen Williams Coefficients of Friction: - C = 100 (diameters ≤ 150 mm) - C = 110 (150 mm > diameter < 300 mm) - C = 120 (diameter ≥ 300 mm)
20	Maximum Flow Velocity	2.5 m/s
Pressure and Leakage Management		
21	District Meter Area (DMA)	- The sizes of the reticulation mains should be designed according to the planned DMAs. - Existing DMA boundary should not be breached.

REVIEW TRIGGERS

This policy is reviewed internally for applicability, continuing effect and consistency with related documents and other legislative provisions when any of the following occurs:

- (1) The related documents are amended;
- (2) The related documents are replaced by new documents;
- (3) Amendments which affect the allowable scope and effect of a policy of this nature are made to the head of power; and
- (4) Other circumstances as determined from time to time by a resolution of Council.

RESPONSIBILITY

This policy is to be:

- (1) implemented by the Senior Manager Development Services; and
- (2) reviewed and amended in accordance with the "Review Triggers" by the Senior Manager Strategic Direction and Sustainability in consultation with the Senior Manager Development Services, the Senior Manager Regional and Environmental Planning and the Senior Manager Planning and Strategic Asset Management.

VERSION CONTROL

CEO Approval Date

15/09/2009

Related Links:

ENDNOTES

Amendment No – 2/2008	Date Adopted – 19 August 2008	Effective Date – 1 September 2008
Planning Scheme Policy Reference	Description of Amendment	
PSP 22	- To reflect updated network planning - Update infrastructure contribution rates - Incorporate additional material, for example, desired standards of service - Re-wording and restructuring of the document to improve readability - Revised demand factors	

Amendment No – 1/2009	Date Adopted – 8 September 2009	Effective Date – 29 October 2009
Planning Scheme Policy Reference	Description of Amendment	
PSP 22	- To reflect updated network planning - Update infrastructure cost estimates - Update infrastructure mapping - Incorporate discounted cash flow methodology for the calculation of contribution rates	